

Assessing the undesired impacts on water sustainability from climate change mitigation technologies in fossil-based power generation

Authors:

Prebantha Moodley, Kevin Harding, Thomas A Adams II

Date Submitted: 2024-08-07

Keywords: Water, Life Cycle Analysis, Carbon Dioxide

Abstract:

This work investigates the water impact of carbon capture technologies employed in coal and natural gas power generation, viz. integrated gasification combined cycle, oxy-fuel combustion, solid oxide fuel cells and post-combustion solvent-based. The Water Impact per CO₂ Avoided (WICa) metric was developed to understand the tradeoff between water usage and global warming potential, and additionally as a decision-making tool. It relates the impact on available water resources to greenhouse gas reduction over the cradle-to-plant-exit lifecycle by leveraging existing metrics, including the Water Impact Index (WII), water withdrawal, water consumption, water quality, and Water Scarcity Index (WSI). The results show that some carbon capture technologies increase the overall water usage of power generation plants, thereby increasing the water impact per CO₂ avoided. Solid oxide fuel cells and oxy-fuel technology, though not mature in comparison to post-combustion capture, have the least water impact per CO₂ avoided. Furthermore, water withdrawal and consumption are shown to trend with the WII in specific scenarios, implying that, in the absence of water quality and WSI data, the metric's use as a stakeholder decision-making tool remains. The potential to reduce global warming via carbon capture technologies in the power generation industry can create additional water resource challenges for countries if not carefully considered.

Record Type: Postprint

Submitted To: LAPSE (Living Archive for Process Systems Engineering)

Citation (overall record, always the latest version):

LAPSE:2024.1646

Citation (this specific file, latest version):

LAPSE:2024.1646-1

Citation (this specific file, this version):

LAPSE:2024.1646-1v1

DOI of Published Version: <https://doi.org/10.1039/d4ew00122b>

Embargoed Until: 2025-08-07

Assessing the undesired impacts on water sustainability from climate change mitigation technologies in fossil-based power generation

Prebantha Moodley^a, Kevin Harding^b and Thomas A. Adams II^{* c}

This work investigates the water impact of carbon capture technologies employed in coal and natural gas power generation, viz. integrated gasification combined cycle, oxy-fuel combustion, solid oxide fuel cells and post-combustion solvent-based. The Water Impact per CO₂ Avoided (WICa) metric was developed to understand the tradeoff between water usage and global warming potential, and additionally as a decision-making tool. It relates the impact on available water resources to greenhouse gas reduction over the cradle-to-plant-exit lifecycle by leveraging existing metrics, including the Water Impact Index (WII), water withdrawal, water consumption, water quality, and Water Scarcity Index (WSI). The results show that some carbon capture technologies increase the overall water usage of power generation plants, thereby increasing the water impact per CO₂ avoided. Solid oxide fuel cells and oxy-fuel technology, though not mature in comparison to post-combustion capture, have the least water impact per CO₂ avoided. Furthermore, water withdrawal and consumption are shown to trend with the WII in specific scenarios, implying that, in the absence of water quality and WSI data, the metric's use as a stakeholder decision-making tool remains. The potential to reduce global warming via carbon capture technologies in the power generation industry can create additional water resource challenges for countries if not carefully considered.

^a School of Chemical and Metallurgical Engineering, University of the Witwatersrand, Johannesburg, 1 Jan Smuts Ave, Braamfontein, Johannesburg, 2050, South Africa

^b School of Chemical and Metallurgical Engineering, University of the Witwatersrand, Johannesburg, 1 Jan Smuts Ave, Braamfontein, Johannesburg, 2050, South Africa

^c Department of Energy & Process Engineering, Norwegian University of Science and Technology (NTNU), Kolbjørn Hejes v 1B, Trondheim 7034, Norway

*Corresponding Author: thomas.a.adams@ntnu.no

1 1. Introduction

2 1.1 Climate Change Mitigation & Water Sustainability

3 One unintended consequence of most carbon capture (CC) technologies for power generation is the requirement
4 of additional water over the entire cradle-to-plant-exit lifecycle (1–4). Additionally, despite the benefit in reducing
5 greenhouse gas emissions, water data for some of these technologies are not available, and the data that are available
6 cannot be used meaningfully.

7 Reviews over the last decade are seemingly comprehensive, focusing on differentiating between CC technologies
8 and carbon separation technologies, relative technology readiness and sustainability based on environmental impacts
9 assessments(5,6). The research highlighted and compared different technology requirements and configurations,
10 included optimisation of parameters relative to reduction of greenhouse gas emissions, and reported approximately
11 90% CO₂ removal for some technologies (Data set of Adams *et al.* (7)). However, all fall short in terms of commentary
12 on water usage which is essential and critical to the operation of these technologies.

13 To further emphasize the importance of water consideration in carbon capture technology, global water demands
14 projected for 2050 show increases for manufacturing and thermal power generation of 400% and 140% respectively
15 (8). This demand, together with increasing water scarcity and water degradation further strains water resources
16 globally and the impact is far greater in countries with an already depleted water supply. The access to clean water
17 for human activities, including power generation and agriculture, underpins economic and social progress (9), and the
18 adoption of CC technology would “commit humanity” to increased water use. (4)

19 Choosing between different CC technologies is simple from a greenhouse gas (GHG) emissions perspective but
20 complex from a water impact perspective. The extent of the impact to water resources are user determined by
21 understanding their water usage requirements. Requirements include water body water quality and local water
22 availability. With power generation and similar industries, the impact is expanded to the volume and quality of water
23 that is returned. Fully understanding the impact of CO₂ emissions reduction on water resources is crucial, not only
24 from a volume perspective but from a quality and location perspective.

25 The value is in knowing the trade-off between green initiatives and their impact on natural resources. Making
26 responsible and accountable decisions on climate change mitigation technology requires a holistic view including its
27 impact on water sustainability.

28 As an example, the cost of CO₂ avoided (CCA) metric is useful to illustrate the comparative value of unlike CO₂
29 mitigation processes, with the aim of finding the most cost-effective CO₂ reduction solution. Similarly, mapping the
30 impact to water resources to carbon dioxide avoided will identify carbon capture technologies in power generation
31 that might benefit a region's water resources and conversely will also identify technologies that could place a region's
32 water resources under further stress. While no metrics exist to assess the trade-off between water sustainability and GHG
33 emissions reduction for CC technology in power generation, there are well known metrics available to construct such a model.

- 34 i. Volume of water (consumption and withdrawal): In power generation design, water provision is based on
35 the requirements of the facility which are more closely related to withdrawal rather than consumption.
36 Reporting on water withdrawn is critical during project feasibility as a process functions (the design
37 capacity) on volume withdrawn and produces (the operating capacity) on volume consumed especially in
38 the case of cooling technology requirements.
- 39 ii. The quality of water in terms of concentration of pollutants: The quality of water is considered as
40 important in industry as volume of water required, as it limits the use of the specific water resource to a
41 narrower set of applications. Large amounts of water available at less-than-optimal quality can impact
42 overall costs and determine whether certain technologies or operations are feasible. Anecdotally, higher
43 water quality is in higher demand which can, and in most cases does, place further strain on stressed
44 resources. Mikosch *et al.* (10) and Pradinaud *et al.*(11) both comment on the challenges and importance
45 of considering water quality when assessing water impact.
- 46 iii. Water scarcity, in terms of the degree of water scarcity in the location that water is required: Hydrological
47 irregularities and high human use (catalysed by population growth and urbanisation) contribute to
48 increasing water scarcity. Water scarcity is a global issue affecting all areas of protection and can impact
49 the successful adoption of technology if not properly considered. At the same time, increasing water usage
50 in industrial applications can directly increase water scarcity, as the demand for high quality water
51 increases, and this is especially crucial in a country where water resources are threatened.

52 1.2 Water Data (un)availability

53 Water data for CC technology is uncommon and often heterogenous (12–14). Notable work on water usage in
54 power generation include some information on CC technology but does not offer sufficient data to assess the trade-
55 off between water usage from a volume perspective or water impact (because of that usage), and carbon dioxide

56 avoided. Reviews on carbon capture technologies over the last decade concentrate on positioning the best
57 technologies for addressing the global warming potential of power generation. This hierarchy between technologies
58 is based largely on cost (Adams *et al.* (7), and Simpson *et al.* (15) investigated the levelized cost of electricity (LCOE)
59 as well as cost of CO₂ avoided (CCA)), carbon dioxide capture rates as well as heat efficiencies. Water usage data is
60 seldom reported in carbon capture technology studies(5–7).

61 Generally, natural gas technologies have low literature representation. Meldrum *et al.* (2) cover 18 natural gas
62 plants versus 61 coal plants (utilising various cooling types). Macknick *et al.* (1) covers 20 natural gas plants versus 55
63 coal plants. Most research efforts are coal focused because of its higher CO₂ intensity than natural gas (7).

64 Consumption and withdrawal data are readily available for cooling operations given the recognised contribution
65 of cooling in power generation however data availability is also low for the fuel cycle and other operational activities
66 required for electricity generation, leading to an overall incomplete water requirements understanding (1).
67 Investigations by Macknick *et al.* (1) and Meldrum *et al.* (2) estimate water usage data for coal and natural gas systems
68 including different cooling technologies, based on available literature. Macknick *et al.* (1), focusses on operational
69 water usage only (excludes the fuel cycle) and Meldrum *et al.* (2) covers the full life cycle (fuel cycle and operations).
70 Specifically, these works consolidate water usage for selected power generation technologies and the impact of
71 different cooling methods within them. While the studies do not focus on CC technology, they note that carbon
72 capture has the potential to increase or decrease water consumption depending on the type of cooling.

73 For example, cooling towers consume twice as much water per unit of electricity generated versus once-through
74 cooling. However, once-through cooling uses a withdrawal of between 10-100x more water than cooling towers(1).
75 The type of cooling technology plays a significant role in water usage for power plant operations and having access
76 to sufficient high-quality water is crucial to power generation plant operations.

77 Similar observations are noted in Feng *et al.* (16) who reported on water consumption alone in their work on the
78 integration of post combustion CC on a coal-fired power plant in assessments of water use. In their work on water
79 consumption of a retrofitted oxyfuel combustion facility, Zhu *et al.* (17) observed that that once through cooling is
80 superior to recirculating cooling purely based on the water consumption value. However, water consumption alone
81 is only half the picture and relates the water used within the process and does not consider the general water
82 requirements necessary to operate a process which is crucial to determining water impacts.

83 The lack of general water quality data is also a concern. Part of the problem is the complexity of water quality data
84 and the extensive amount of parameters that need tracking (18). Damania *et al.* (18) found that this is a global issue
85 and regardless of economic status all countries experience the same challenges when it comes to water pollution. In
86 fact, they highlighted that pollution does not decline with economic growth instead the variety of pollutants increases
87 with “prosperity”. Water data is key to being able to assess impacts to water resources, to creating meaningful
88 sustainability metrics and ultimately more sustainable processes.

89 1.3 Existing Water Sustainability and Climate Change Impact Assessment Methods

90 Climate change impact assessment methodologies are well documented, robust, and accepted. Using ISO 14044
91 and the Intergovernmental Panel on Climate Change (IPCC) global warming potentials (GWP), the climate impacts of
92 different chemical emissions are comparable.

93 Water impact assessment, however, is more challenging. Many variables contribute to the impacts with some
94 being contested. We identify current noteworthy methods and present gaps preventing them from being suitable to
95 assess environmental trade-offs related to water sustainability.

96 1.3.1 Water footprinting methods

97 The water footprinting method is presented by the Water Footprint Network (WFN) (19) and in ISO 14046 (20)
98 (the international standard on water footprinting), which approaches water footprinting as a water-targeted
99 approach to life cycle assessment (LCA). LCA methodologies are the most common tool for assessing impacts of
100 processes and products and has been standardised in ISO 14044. Bayart *et al.* (21) point out that the life cycle impact
101 assessment (LCIA) methods on which they rely on do not sufficiently address water specifically “freshwater scarcity” and
102 “availability”. They summarize further limitations and efforts to capture the nuances presented by the quality and scarcity of water
103 within these assessment methods. They point out this similar observation on LCI data. LCI data only offer details on the
104 volume of freshwater used for systems. With often, limited information provided on the type of resource (origin) and
105 nothing about its discharge (fate) in terms of volume and quality. They concluded that these methods overlook the
106 major environmental consequences of the reduction in quality and availability of freshwater. LCA characterise the
107 impact to water from pollutant emissions, as is observed from the impact categories, however impacts from water
108 unavailability are not quantified (22). The Water use in LCA (WULCA) group developed a consensus based method
109 known as AWARE (Available water remaining) which is aimed at addressing the shortcoming of water scarcity,
110 influenced by several parameters, for use in LCA ((23), (24)) as well as water scarcity footprint assessments.

111 Water quality will impact access to water and intensify water scarcity; therefore, it must be considered to obtain
112 a complete picture of the impact to water resources however the mechanics of including water quality concepts in
113 water impact assessment is still uncertain (11). This is also observed in the Water footprinting where there is no
114 consensus on how to address water quality deterioration (10).

115 The WFN defines water footprinting as the volume of both direct and indirect freshwater use over the entire supply chain to
116 produce a product(19). It is generally reported as a single value. ISO 14046 defines water footprint as “metric(s) that quantify the
117 potential environmental impacts related to water”, reported as single value or set of impact indicators. For non-comprehensive
118 assessments, the environmental impact categories per ISO 14046 are water availability footprint (impact due to high demand on
119 water), water scarcity footprint (when water availability focuses on scarcity) and water footprint that addresses water degradation
120 (environmental impacts due to water quality).

121 1.3.2 The Water Impact Index (WII)

122 The WII (25) is a single indicator, based on the Water Footprinting method, used to assess the reduction in available
123 freshwater due to human activities. It integrates water volume, water quality, and water scarcity. Negative values
124 suggest an increase in water availability whereas positive values indicate a decrease in water availability. An index
125 feature is the inclusion of quality in the withdrawal and return terms which creates a penalty for using high quality
126 water and discharging poor quality water. The WII, as defined in Bayart *et al.*(25) is:

$$127 \quad WII = \sum_i [W_i Q_{W_i} WSI_i] - \sum_j [R_j Q_{R_j} WSI_j] \quad (1)$$

128 where WII is the Water Impact Index expressed as volume unit water impact index equivalent, W_i and R_j are quantities
129 of water withdrawn from water body i and returned to body j . Q_{W_i} and Q_{R_j} are unitless quality indices of water
130 withdrawn from water body i and returned to body j , and range between 0 (worst quality) and 1 (best quality) (25).
131 WSI_i and WSI_j are unitless water scarcity indices for water bodies i and j , calculated by the water stress index equation
132 outlined in Pfister *et al.* (13) (Further details provided in the electronic supplementary information)

133 The quality index is based on the chosen penalising pollutant p and takes on the value of 1 when $c_p \leq c_{ref,p}$

$$134 \quad Q = \min \left(1; \frac{c_{ref,p}}{c_p} \right) \forall p \quad (2)$$

135 where Q is the quality index, $c_{ref,p}$ is the reference concentration of a specific pollutant and, c_p is the actual
136 concentration of that pollutant present in the water body (either withdrawal or discharge.)

137 This is a modification from the original form of the equation in Bayart *et al.* (25), where in that work p is not a set
138 of many different pollutants considered in the analysis, but rather a single “most penalizing pollutant”. In their
139 formulation, p is chosen as “worst case” pollutant p which is the one that the minimum $C_{ref,p}/C_p$ in a set of all
140 possible pollutants. Both approaches will find the same Q , but only if the “most penalizing pollutant” is known *a priori*.
141 This was a known weakness in the formulation as indicated by the authors in their discussion. Therefore, we use a
142 more generalized form that allows the user to consider a set of all pollutants of interest without needing to know the
143 “most penalizing pollutant” *a priori*.

144 Water quality is central to determining water availability. For water withdrawal, a quality index of 1 means a lower
145 overall water availability for other users because less high quality water is available to them. In the case of water
146 returned – a quality index of 1 means a higher overall water availability (the full amount returned is available to other
147 users at high quality).

148 The usefulness and meaning of relating water scarcity and water volume has been debated (26). However, in the
149 absence of a holistic method the WII offers a simple way to quantitatively measure the degree of impact.

150 Additionally, we observe the following about the WII:

- 151 i. WSI for water bodies in the same region does not change materially as the WSI is determined based on the
152 ratio of water consumed by all users to total water available. The WSI was developed based on available
153 watershed (feed to a water body) information which were available in aggregate regionally and not per
154 watershed as suggested by the WII definitions. Independent watershed data would be ideal, however, its
155 absence means that the WSI represents a country or region’s position and not a single water body. Our
156 approach uses the country WSI for the WSI of the withdrawal and returned water bodies. These are therefore
157 identical in the WII equation.
- 158 ii. Once the value is calculated, freshwater availability is indicated without exposing the underlying water
159 quality. A negative value (resulting from the withdrawal term being smaller than the returned term) is
160 interpreted as increase in water availability, however this value cannot distinguish between pollutants. This
161 overall scenario is useful when determining whether water is available for other users.
- 162 iii. The WII can aid comparisons of the same system (before and after water treatment or application of other
163 technologies) as with the example presented in Bayart *et al.* (25) and seen later in this work.

1.3.3 Available Water-Carbon Metrics

Rosa *et al.* (4) examined the water footprint of CO₂ captured (in m³ water per tonne of CO₂ captured) of four CC technologies. Rosa *et al.* (4) acknowledge that high water footprints could exacerbate the water scarcity status in regions however their results indicate water that is solely consumed and not the possible impacts related to the use of that water, dependent on spatial and temporal factors. (27). While the work does confirm quantitatively the water consumption of some CC technology, it does not fully relate the benefit of the reduction in carbon dioxide emissions to water. Additionally, the work does not specify certain parameters that will allow fair comparison such as cooling requirements, heat rate or higher heating values.

The Water-carbon-abated ratio (WCAR) (28) is a similar metric. Its water impact is based on LCA data, specifically water consumption only. This work does include water scarcity footprinting (calculated as the product of water consumption and a WSI factor), however, it is not used in the calculation of the WCAR. The calculation of WCAR has its merits as an indicator of trade-offs between technologies in terms of water consumption and GHG emissions avoided but the lack of factoring of a quality value or a scarcity factor means that there is no understanding of the impact to water once the water is consumed.

Both efforts consider water impact as the availability to other users post consumption, but neither include quality or scarcity directly.

Other work, such as that of Rosa *et al.* (29) investigated the effects on water scarcity of retrofitting four different carbon capture technologies to existing coal fired based facilities. Specifically: absorption with amine solvents, membrane separation, and adsorption into solid sorbents by either pressure swing adsorption (PSA) or temperature swing adsorption (TSA) processes. They show that while retrofitting does not significantly increase water scarcity; certain regions may lack the water resources to meet the additional water demands of carbon capture technologies. Additionally, they highlight that currently 43% of global coal fired plants experience water scarcity for one month a year while 32% can experience water scarcity for five months or more suggesting that influences to water scarcity must be considered in water impact assessment. Therefore, this work is appropriately positioned and builds on this key finding of Rosa *et al.* (29)

1.4 Proposed Metric and Contribution of the work

In this work we propose the Water Impact of CO₂ avoided (WICa) metric; an easy, usable, high-impact way to assess the trade-off between reduction of GWP, as CO₂ equivalent emissions avoided, and the impact on water resources for CC technologies in the power generation industry. Previous integrated metrics (Table 1) indicate water that is consumed but lack the impacts related to the use of that water, which also varies temporally and spatially (27). By expanding the consideration beyond volumetric withdrawal, return and consumption to other key parameters

Table 1: Summary of characteristics in water sustainability captured by proposed metrics in the literature.

Characteristics	Water footprinting (Water Footprint Network) (19)	Water footprinting ISO14046(20)	Water footprint of CO ₂ Captured Rosa <i>et al.</i> (4)	WCAR Water-carbon-abated ratio Habib (28)	WII Water Impact Index Bayart <i>et al.</i> (25)	WICa Water Impact of Carbon Avoided (This work)
Water consumption	✓	✓	✓	✓	✓	✓
Water withdrawal					✓	✓
Water returned					✓	✓
Water quality		✓			✓	✓
Water scarcity		✓			✓	✓
GHG emissions/GHG emissions avoided			✓	✓		✓

such as water quality and water scarcity, we will be able to better understand the impacts of water use. A perspective supported in literature (30,31). Table 1 summarizes and compares the proposed metric to the previously available metrics in the literature and the characteristics they employ to assess water impact. The WICa metric is the first to incorporate all of the major water metric characteristics (consumption, withdrawal, return, quality, and scarcity) as well as the GHG emissions avoided. WICa combines all of these factors into a single number especially useful for the cross comparison of green technologies.

The WICa metric is made up of two parts, the numerator is the change in water impact between a base case and green case and the denominator is the change in global warming potential (GWP) between the same base case and green case. Water impact is assessed using the WII, which covers the key variables that are identified as important when understanding water impact. The change in GWP avoided is similar to cost of carbon avoided metric and is calculated as the difference between the CO₂ equivalent emissions of the green case (with CC technology) and the base case (without CC technology).

$$WICa = \frac{WII_{Green\ Case} - WII_{Base\ Case}}{GWP_{Base\ Case} - GWP_{Green\ Case}} \quad (3)$$

207 Where WII is calculated as m^3 water equivalents per MWh ($\text{m}^3\text{e}/\text{MWh}$) which is based on water data available,
208 and in some cases, estimated, for power generation plants, and GWP is the global warming potential reported as
209 tonne (t = tonne = 1000kg) CO_2 equivalents per MWh ($\text{tCO}_2\text{e}/\text{MWh}$). The resultant WICa metric units is therefore m^3
210 water equivalents per tCO_2 equivalents.

211 The base case and green case subscripts are further described in the following sections. The WII is calculated for
212 the base case at a specified withdrawn and returned water quality and WSI. It is then calculated for the green case at
213 the same water quality (withdrawn, returned and WSI) as the base case. Assuming that only a single water body, *i*, is
214 used for withdrawal and return (discharge) and that the water bodies are in the same regions and share the same
215 WSI value.

216 We explore the usefulness and value of WICa in a climate change mitigation case study. This will both demonstrate
217 the value of the metric and provide new insights into the water sustainably and GHG emissions trade-offs of several
218 different climate change mitigation technologies for different countries. We assess several of these technologies in
219 fossil-based power plant systems, together with varying water qualities and country water stress indices to put
220 forward the holistic view of their impact on water resources.

221 **2. Case Study: Comparing 65 different low- CO_2 fossil-based power plant systems**

222 Power generation is responsible for over 40% of energy-related greenhouse gas emissions (32) and global water
223 demands projected for 2050 show a 140% increase in thermal power production(8). The incorporation of CC
224 technology, as part of a strategy to reduce this GWP, impacts this global view. The adoption of certain CC technologies
225 increases the energy requirements, reduces efficiency and thereby increasing overall water usage requirements.

226 Water is required for two purposes: (i) for unit operations as a processing fluid and (ii) for cooling. Typical uses and unit
227 operation interactions for process and cooling water, based on Adams *et al.* (7)and NETL reports referenced in this work. are
228 illustrated in Figures 1 to 4. For detailed water allocation breakdowns see Gerdes and Nichols (33)and, Zhai and Rubin (34). The
229 process water system “block” in Figures 1 to 4 encompasses the water requirements for the boiler feed water system (makeup
230 and blowdown), as well as flue gas desulphurisation (makeup and dewatering) and any other unit operations that require water.
231 Within the CC process this would include CO_2 capture recovery and CO_2 compression knockout.(33). The following subsections
232 describe the five general categories of carbon capture in power plant design, with a focus on how water is used within the process.

2.1 Post-Combustion Solvent-Based Capture from Coal

Post-combustion capture from coal (Figure 1) is the most mature of the CC technologies. It is also the easiest to retrofit to an existing plant (5). It can be retrofitted into current power plant systems without much modification to the original plant as it can be appended to the flue gas system following environmental controls such as NO_x and SO₂ removal. CO₂ reduction is significant, but the overall plant efficiency is reduced due to the additional fossil-fuel

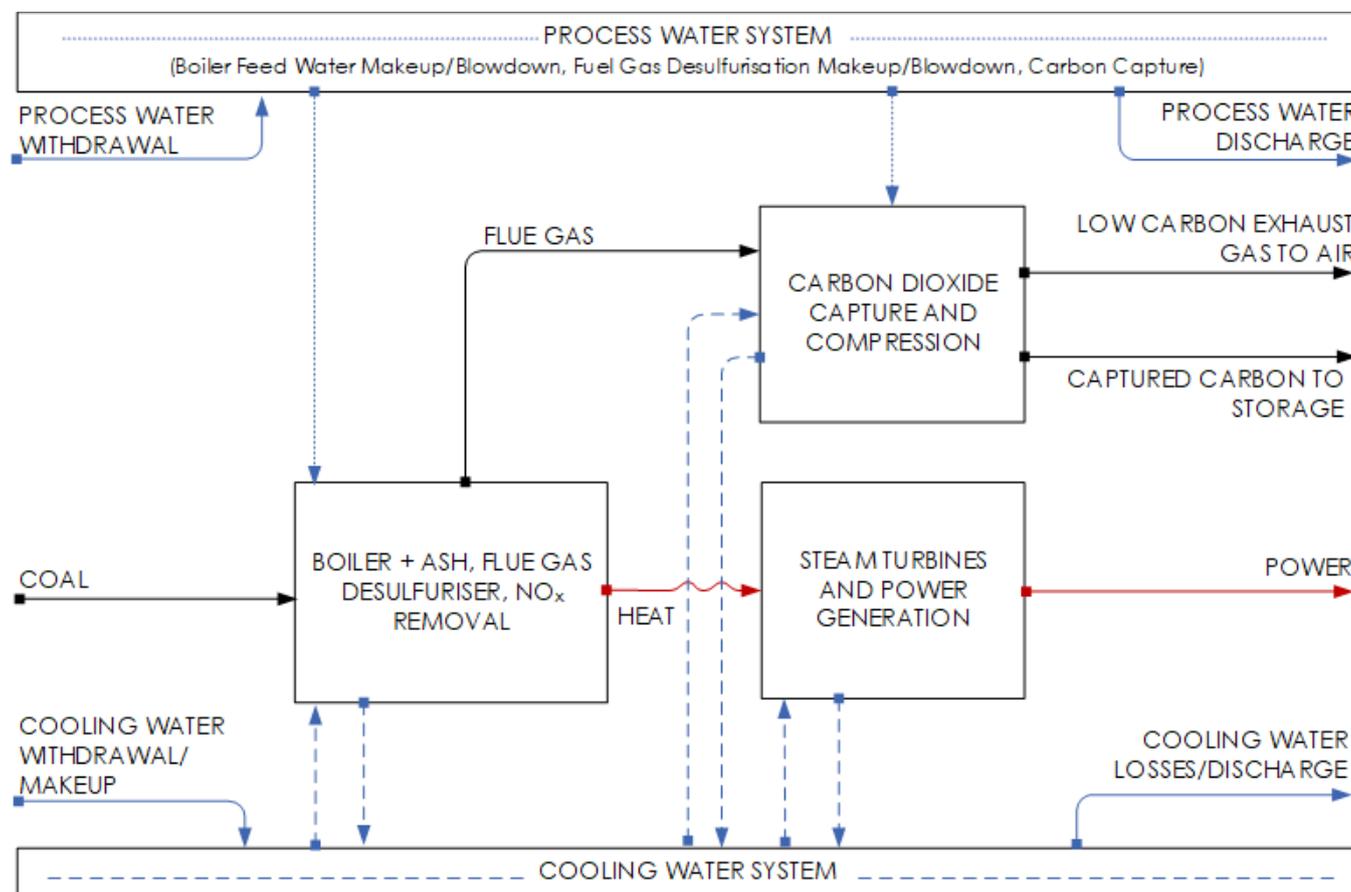


Figure 1. Post combustion schematic for coal-fired plants

consumption. More cooling is required to meet increased energy requirements than plants without carbon capture, thus increasing over all water usage.

Coal is combusted with air in the furnace at high temperature to produce steam at high pressure and high temperature, which produces power via the steam turbine and generator. The flue gas exhaust leaving the furnace generally goes through ash, NO_x and sulphur removal. For solvent based CC technologies, gas is sent to an absorber where it comes into contact with the solvent and CO₂ is removed/captured from the gas. The captured CO₂ is then compressed, for transport and storage. The balance of the now low-carbon flue gases are vented to the atmosphere.

2.2 Post-Combustion Solvent-Based Capture from Natural Gas

Based on the example in Adams *et al.* (7), the natural gas combined cycle is an example of post combustion solvent-based capture from natural gas (Figure 2). Both a gas combustion turbine and steam turbine are used to generate power.

A generator converts the mechanical power from the combustion turbine (in which natural gas is combusted with compressed air) to electric power. Additional electric power is created by the steam turbines using steam created by

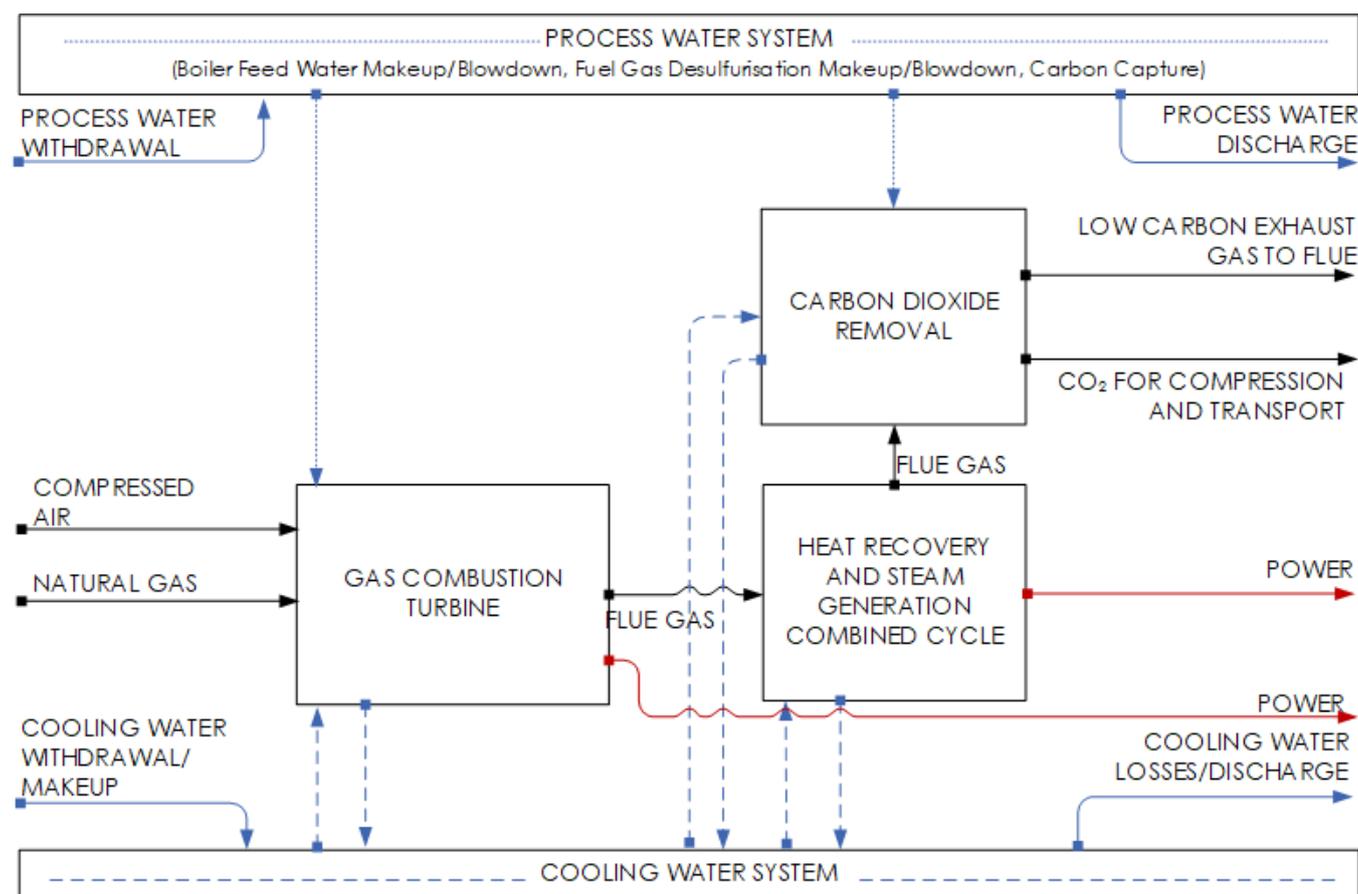


Figure 2. Post combustion capture in natural gas power generation plants

the heat exchange of the high temperature combustion exhaust. CO₂ removal occurs in the absorber column that utilises a solvent to scrub CO₂ from the cooled combustion gas. The rich solvent is regenerated in a stripper column where the lean solvent is recovered, and CO₂ distillate is then compressed for transport.

2.3 Pre-Combustion Solvent-Based Capture from Coal

Pre-combustion (Figure 3) is used in coal- gasification power plants and involves the pretreatment of the fuel prior to combustion. In the case of coal, coal is partially combusted in a gasifier in an oxygen-lean environment creating syngas. The syngas goes through the water shift gas shift reaction and series of absorbers to remove H₂S and CO₂ separately. The CO₂ is then

259 compressed, transported, and stored. The sequencing of gasification together with the water gas shift reaction (IGCC) results in a
 260 high-energy stream predominantly of H_2 and CO_2 where all the coal ends up as CO_2 . Hydrogen is then combusted in gas turbine to
 261 produce power. Despite the higher CO_2 capture efficiencies due to the higher pressures and concentrated CO_2 stream, the cost
 262 associated with gasification make pre-combustion costly. From a water perspective, and as will be seen in this work, pre-
 263 combustion technology uses less water than solvent-based post-combustion for about the same CO_2 emissions, but more than all
 264 other technologies investigated in this work.

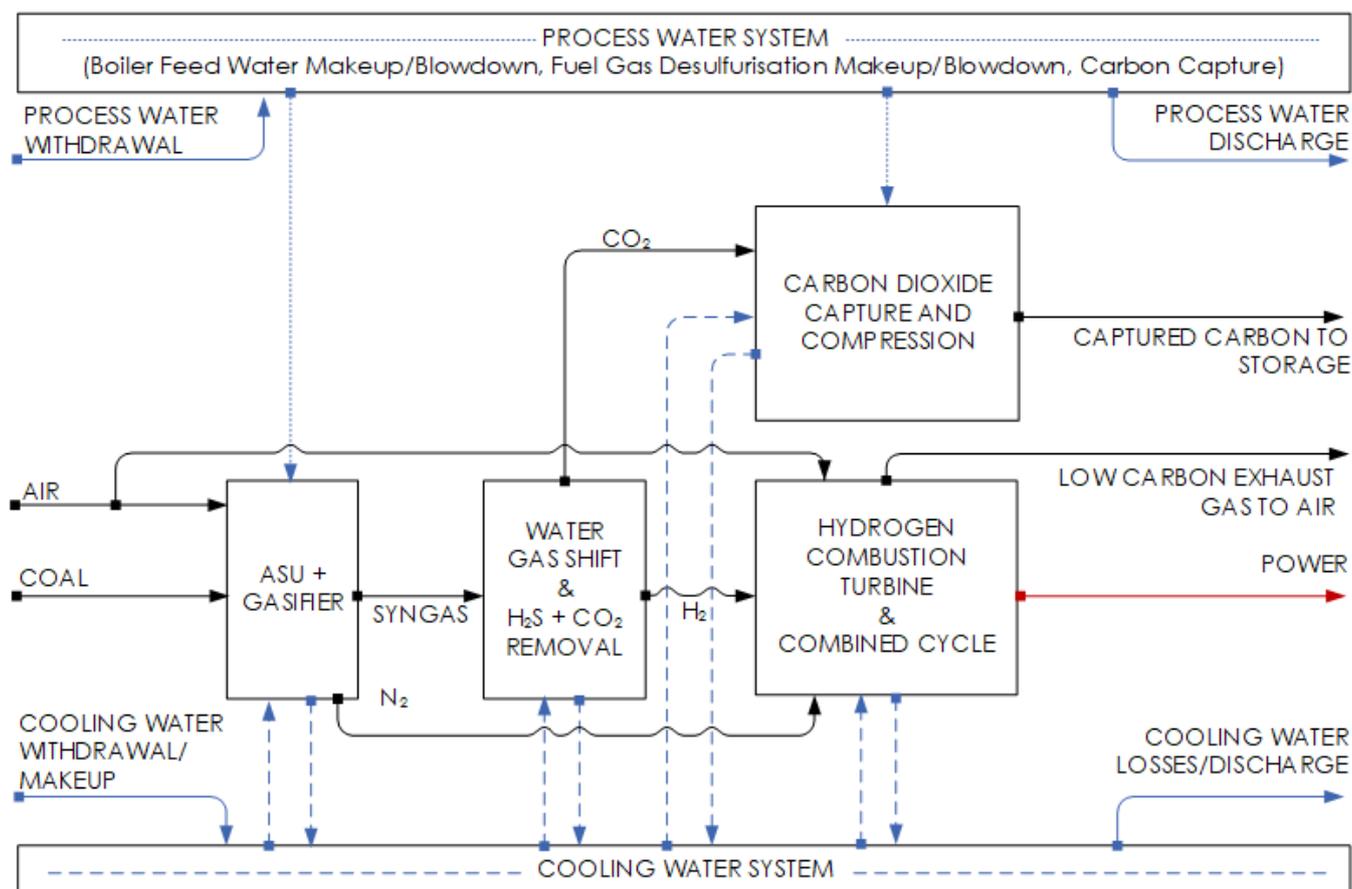


Figure 3. Precombustion capture in coal-fired plants (IGCC)

2.4 Oxy-Fuel Combustion with Post-Combustion Capture from Coal

265 In oxy-fuel combustion (Figure 4), fuels, typically coal or natural gas, are combusted in a N_2 lean environment. An
 266 air separation unit is used to separate O_2 from air, in which the fuel is combusted resulting in flue gasses with high
 267 CO_2 and water content (6). The exhaust of the heat recovery and steam generation unit typically contains H_2O and
 268 CO_2 , which goes through a series of condensers and flash drums that separate the CO_2 and H_2O . Oxy-fuel combustion
 269 systems are less mature than post- and pre-combustion options.
 270
 271

2.5 Solid Oxide Fuel Cells with Post- Oxidation Capture from Coal and Gas

Solid oxide fuel cell systems operate similarly to oxy-fuel post-combustion systems. Air is fed directly into the cathode of the SOFC, therefore an air separation unit is not needed. The oxygen in the air migrates to the anode and reacts directly with the fuel. This means that the fuel cell achieves both power generation and air separation. The separation strategy is also similar to that of post-combustion oxyfuels, where unspent fuel is catalytically oxidized, and then water is condensed out of the resulting gas stream, leaving a stream containing high purity CO₂. The CO₂ is compressed for transport and storage. This process means that water recovery is possible and a natural and necessary complementary outcome of the CO₂ capture process. Fuel cell technology in CC is expensive and commercially challenging due to low cell lifetime and manufacturing, however, the low water usage and GHG emissions make it a technology worth exploring.

For detailed reviews on each technology see Adams *et al.* (7).

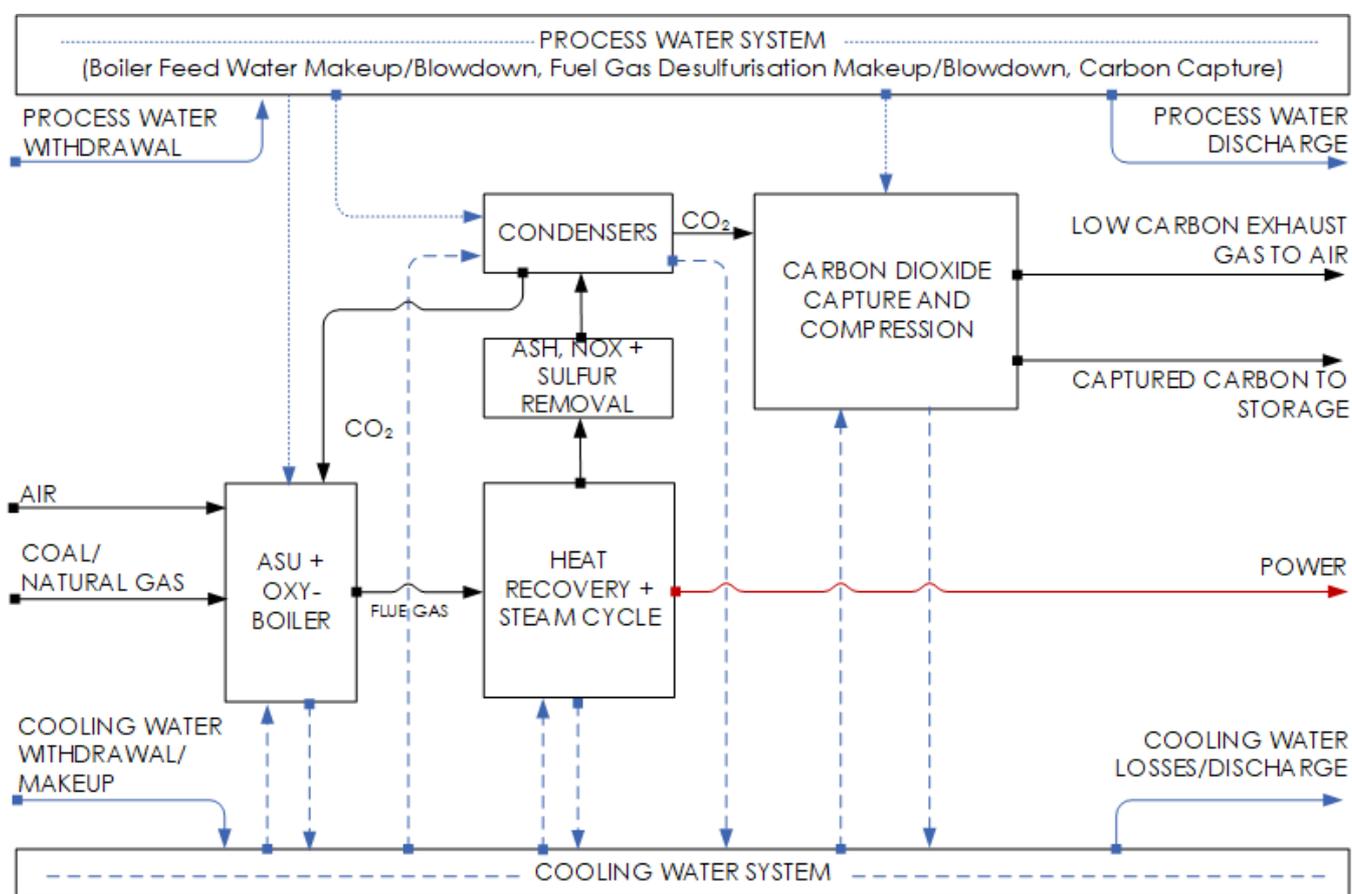


Figure 4. Oxy-fuel combustion schematic for coal- or natural gas -fired plants

3. Research Method

We compare different carbon mitigation technologies using the data set from Adams *et al.* (7). This data set contains a quantitative summary of over 100 proposed coal and natural gas power plants with CC technologies in the literature. The record for each power plant includes information such as efficiency, heat rate, fuel costs, non-fuel costs, and the cradle-to-plant-exit life cycle GHG emissions. The data set was normalized to have consistent supply chains, plant sizes, and boundaries of analyses, such that results taken from across the literature could be compared to each other on a consistent and fair basis. The data set was chosen due to its completeness, wide coverage of CC technologies and the effective consolidation of data by creating a consistent basis of metrics for comparison. However, the data set contained no information related to water consumption and therefore water information had to be determined in this work.

Not all technologies in that data set could be used in our work because relevant water data for the cited works could not be determined from the published information available nor could they be estimated (through methods described later) due to insufficient data. Therefore, our final dataset used in this work includes a subset of 65 data points, covering coal and natural gas power generation plants, with the data being predominantly focussed on coal. The dataset for coal-based CC technologies used in this work includes supercritical pulverised coal (SCPC), integrated gasification combined cycle (IGCC), coal-based oxy-fuel combustion (COXY) and integrated gasification solid oxide fuel cell (IGFC). For natural gas the dataset consists of natural gas combined cycle (NGCC) and natural gas solid oxide

300 fuel cell (NGFC). These technologies are referred to as the green cases. Four categories of data are necessary to
 301 compute the WICa metric: (i) CO₂ emissions (avoided) over the cradle-to-plant-exit life cycle for CC technologies; (ii)

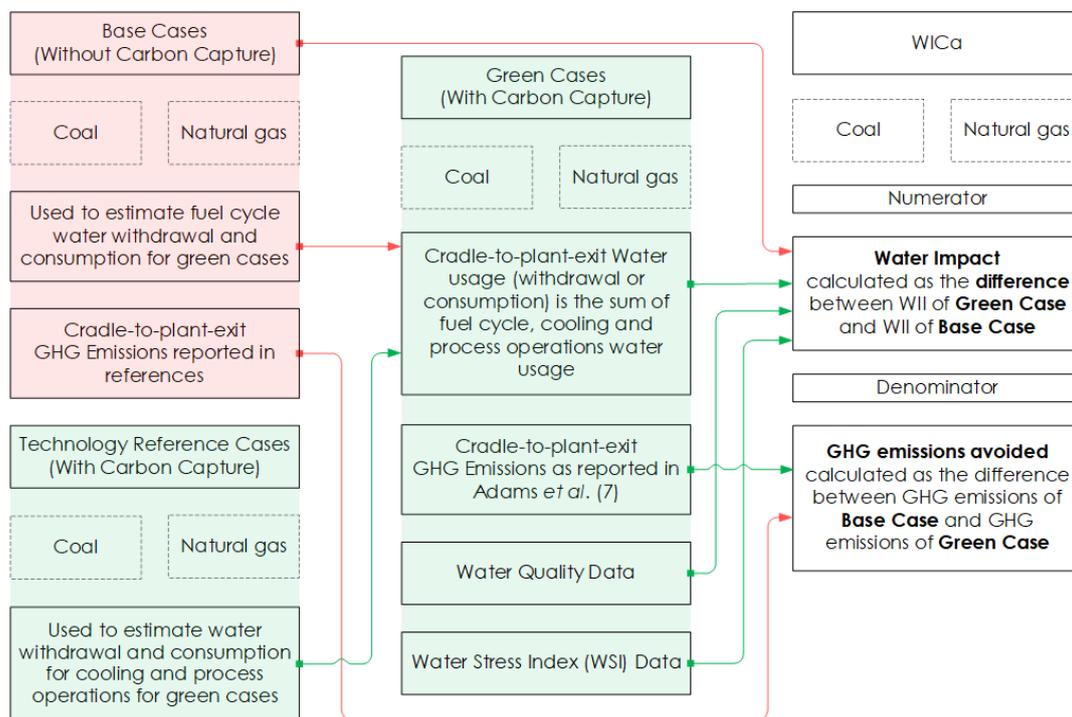


Figure 5. Method for assumptions and calculation of WICa metric

302 water data necessary to assess the WII which must include water withdrawal, water consumption and water returned
 303 (generally calculated by difference) for each stage of the cradle-to-plant-exit life cycle for the CC technologies; (iii) the
 304 water qualities; and (iv) regional WSI data.

305 The methodology used in this work is summarized in Figure 5. First, base cases are selected, one for coal and one
 306 for natural gas. These are used as “business as usual” cases. For each of the 65 “green” cases used in this study, the
 307 CO₂ emissions avoided are calculated by comparing the base case to the green case. When the information necessary
 308 to compute water metrics are not available for the green cases, estimates are computed where necessary. To help

Table 2: Base cases for coal and natural gas fuel type

Property/units	Supercritical Pulverised Coal (SCPC)	Natural Gas Combined Cycle (NGCC)
Fuel type	Bituminous Coal	Conventional Pipeline Natural gas
Net Plant power output (MWe)	650	727
Heat rate (MJ _{HHV} /MWh)	8957	6714
Water withdrawal		
Cooling operations (m ³ /MWh)	1.938	0.905
Process operations (m ³ /MWh)	0.185	0.002
Water Consumption		
Cooling operations (m ³ /MWh)	1.477	0.701
Process operations (m ³ /MWh)	0.185	0.002
Cradle-to-plant-exit CO ₂ emissions (tCO ₂ e/MWh)	0.950	0.406
Type of cooling	Mechanical Draft, Evaporative cooling tower	Mechanical Draft, Evaporative cooling tower
Reference	Schmitt <i>et al.</i> (35)	

Table 3: Literature fuel cycle water usage data (median values) from Meldrum *et al.* (2). ^aThis value is the ^awater use per MWh divided by the heat rate (MJ_{HHV}/MWh from Table 2) which is used in the estimation of the fuel cycle water usage of the green cases described in Section 3.2.1.

Fuel	Subcategory	Water withdrawn		Water consumed	
		^a m ³ /MWh	^b m ³ /MJ _{HHV}	^a m ³ /MWh	^b m ³ /MJ _{HHV}
Coal (SCPC)	Underground mining	0.216	2.14 x 10 ⁻⁵	0.212	2.37 x 10 ⁻⁵
Natural gas (NGCC)	Shale Gas	0.064	9.53 x 10 ⁻⁶	0.061	9.09 x 10 ⁻⁶

309 with these estimates, we have selected technology reference cases (with carbon capture) which are detailed studies
 310 of a single relevant power plant that contains sufficient information about water use in the process. We use that
 311 detailed water information to help generate estimates for other green cases where water information is missing, for
 312 example, by assuming that water consumption per unit cooling in the green case is the same as in the technology
 313 reference case. The details are explained in the following subsections.

Table 4: Technology reference cases used to estimate the water use in the cooling operations and process operations where published data are unavailable.

Property/units	Coal Cases			Natural Gas Cases		
	Supercritical Pulverised Coal (SCPC)	Integrated gasification Combined Cycle (IGCC)	Coal based oxy-fuel combustion (COXY)	Integrated gasification solid oxide fuel cell (IGFC)	Natural Gas Combined Cycle (NGCC)	Natural Gas solid oxide fuel cell (NGFC)
Classification of process/primary CO ₂ capture	Bituminous Coal/Solvent Based – EconFG+	Solvent Based-Selexol	Oxy-fuel	Atmospheric pressure	Solvent Based - Econamine FG+	Atmospheric pressure
Net Plant power output (MWe)	550	497	550	550	559	650
Heat rate (MJ _{HHV} /MWh)	11077	11538	11613	9105	7877	6220
Water withdrawal						
Cooling operations (m ³ /MJ _{HHV})	2.50 x10 ⁻⁴	1.74 x10 ⁻⁴	1.52 x10 ⁻⁴	7.43 x10 ⁻⁵	2.06 x10 ⁻⁴	1.13 x10 ⁻⁴
Process operations (m ³ /MJ _{HHV})	4.36x10 ⁻⁵	5.00 x10 ⁻⁵	1.24 x10 ⁻⁵	1.32 x10 ⁻⁵	1.64 x10 ⁻⁶	8.90 x10 ⁻⁶
Water Consumption						
Cooling operations (m ³ /MJ _{HHV})	1.83x10 ⁻⁴	1.34 x10 ⁻⁴	1.09 x10 ⁻⁴	4.55 x10 ⁻⁵	1.54 x10 ⁻⁴	7.72 x10 ⁻⁵
Process operations (m ³ /MJ _{HHV})	4.28x10 ⁻⁵	4.97 x10 ⁻⁵	1.24 x10 ⁻⁵	1.20 x10 ⁻⁵	1.64 x10 ⁻⁶	8.90 x10 ⁻⁶
Total Cradle-to-plant-exit GHG emissions (tCO ₂ e/MWh)	0.286	0.251	0.197	0.088	0.115	0.064
Type of cooling	Mechanical Draft, Evaporative Cooling Tower	Mechanical Draft, Evaporative Cooling Tower	Mechanical draft, counter-flow cooling tower	Recirculating Wet Cooling Tower	Mechanical Draft, Evaporative Cooling Tower	Mechanical draft, wet cooling tower
Reference	Fout <i>et al.</i> (44) – Case B12B	Fout <i>et al.</i> (45) - Case B1B	Haslbeck <i>et al.</i> (38) - Case: S12F	Iyengar <i>et al.</i> (46) - Case 1-1	Fout <i>et al.</i> (44) – Case B31B	Iyengar <i>et al.</i> (47) -Case ANGFC0B

Table 5: Water Scarcity Indices for selected countries. ^aWTA values are obtained from Luo *et al.* (36) and are used to calculate WTA*. ^bWTA* as defined in Pfister *et al.* (13) are used to calculate WSI values used in this work. ^cDefined in Luo *et al.* (36), this ranks countries according to their water stress.

Rank ^d	Country	WTA ^a	WTA* ^b	WSI ^c (used in this work)
1	Unite Arab Emirates	1	1.80	0.999
31	India	0.740	1.33	0.981
46	China	0.637	1.15	0.940
50	South Africa	0.595	1.07	0.906
58	Philippines	0.527	0.95	0.813
76	Poland	0.367	0.661	0.490
87	Finland	0.291	0.523	0.224
96	Canada	0.207	0.37	0.099
115	Norway	0.103	0.19	0.032

3.1 Water stages

The overall water use for each technology case can be categorized into three contributing “water stages” which cover the cradle-to-plant-exit life cycle, as summarized in Figure 6. The first stage is the fuel cycle. Meldrum *et al.* (2) define the fuel cycle activities as fuel extraction, processing and transportation which aligns with the fuel cycle activities defined in Adams *et al.* (7). Cooling operations are cooling services typically provided by cooling towers, such that the water involved is isolated from the process and does not mix with other material streams in the process. Process operations considers any other water stream that is not involved in cooling. For example, this includes water that is a reagent for chemical reactions such as water gas shift or gasification, water recovered from a flue gas that was produced by combustion, and makeup water for losses in steam cycles and absorption cycles.

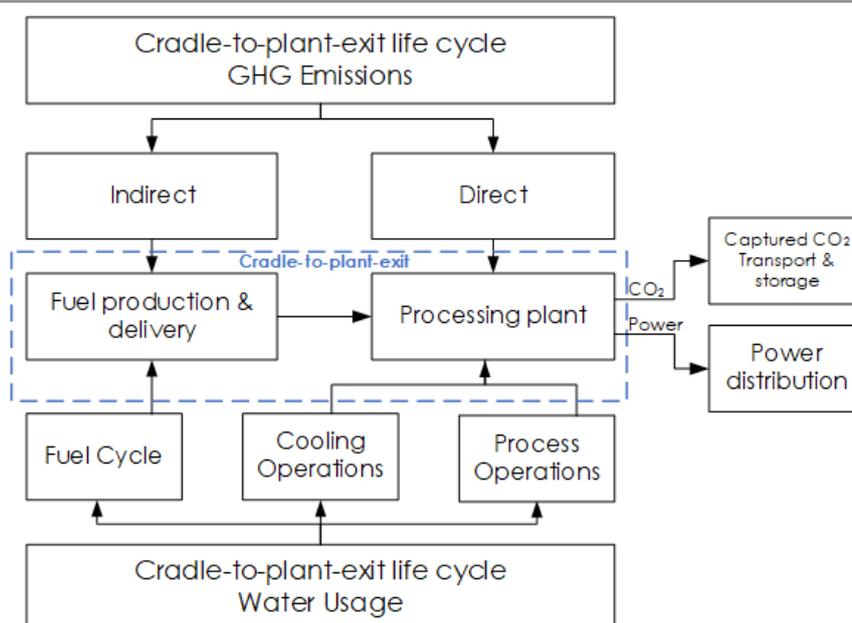


Figure 6. Cradle-to-plant-exit life cycle water stages corresponding to GHG emissions.

3.2 Base cases

Two base cases(35) (power generation plants without CC) are chosen based on water data availability and serves as the primary reference condition when calculating WICa, one for coal and one for natural gas. The coal base case is a supercritical pulverized coal (SCPC) power plant without CC. The natural gas base case is a natural gas combined cycle (NGCC) power plant. It is important to choose a base case that is representative of the “status quo” or “business-as-usual” at the appropriate scale of the study (on the order of 600-750 MW net power output). There must also be sufficiently detailed information about each base case, including mass and energy flows of the process containing all

Table 6: Water quality scenarios used in the sensitivity analysis.

Scenario	Water quality of withdrawn water	Water quality of returned water	Scenario Commentary
1	1	0.01	This scenario describes high quality withdrawal and poor-quality return. It is unlikely that water return would be this low, however we use this as the worst case scenario in this work.
2	0.02	0.02	In these scenarios water qualities are the same and range from low to high values. This means that the concentration of the major pollutant (C_p) ranges from 50 to 0 times more than the reference concentration of the major pollutant in both the withdrawn and returned water.
3	0.5	0.5	
4	0.6	0.6	
5	1	1	
6	0.01	1	This scenario presents the “best case”, creating an overall benefit for the water for the next user—withdraw poor quality water and return high-quality water. It is however unrealistic in the case on power generation. It is an unlikely scenario and is therefore not investigated.

water aspects. The base cases selected in this work are different than those chosen in Adams *et al.* (7) because we chose to use more recently published information, and because the chosen work had detailed water information. The choice of base case will of course affect the WICa value, and choosing different cases would result in slightly different WICa values. However, since all 65 green cases are compared to the same base cases, very useful conclusions can be made by their direct comparison to each other. Relevant water and emissions data for the base cases are shown in Table 2.

3.2.1 Estimating fuel cycle water withdrawal and consumption

To estimate the water usage of the fuel cycle we first use the heat rate of the base cases (Table 2) and the literature fuel cycle water estimations from Meldrum *et al.* (2) (Table 3) to create a generalised base line. This value is in the form of $\text{m}^3 \text{ water} / \text{MJ}_{\text{HHV}}$ also presented in Table 3. The fuel cycle water usage of each of the 65 green cases is then calculated by multiplying the heat rate of the green case to this generalised baseline (Equation (4)) and is reported in $\text{m}^3 \text{ water} / \text{MWh}$. Meldrum *et al.* (2) based water estimations for coal underground mining on US mining data and associated activities as described above. For natural gas we used their shale gas estimations which includes drilling, fracturing, processing and transport. We used these conservative estimates opposed to their reported values for conventional natural gas and surface mining. We assumed that the water requirements for the fuel cycle are comparable within each fuel type for the green cases, due to similar activities within the cycle.

$$\text{Fuel_Cycle_Water_Usage}_{\text{Green Case}} = \text{Heat Rate}_{\text{Green Case}} \times \left(\frac{\text{Fuel Cycle Water Estimations}_{\text{Literature}}}{\text{Heat Rate}_{\text{Base case}}} \right)_{\text{Generalised baseline}} \quad (4)$$

3.2.2 Calculating carbon dioxide emissions avoided

In this work, total cradle-to-plant-exit CO_2 process emissions are the sum of the direct (from the plant itself, including the cooling system) and indirect (from the production and delivery of fuel) emissions (Figure 6). The GWP

used to compute the CO₂ emissions avoided and thus the WICa metric, is computed using IPCCs 100-year time horizon and is reported as CO₂ equivalents (CO₂e).

3.3 Technology reference cases

Technology reference cases are chosen to help estimate the water data for any of the 651 green cases where that information is lacking in the literature for that specific green case. This includes information for the cooling and process operations stages of the cradle-to-plant-exit lifecycle. One technology reference case is selected for each type of technology and used to fill in the gaps of missing information in the green cases where needed (Table 4). Details of these cases follow.

3.3.1 Estimating water withdrawal and consumption for cooling and process operations

The water usage estimations for cooling and process operations are calculated similarly to the fuel cycle water usage estimations (discussed in 3.2.1). We use the heat rate of the technology reference case (TRC) with the reported water data in the literature (Table 4) to create a generalised baseline for each withdrawal and consumption for cooling and process operations. The heat rate of the green case is then multiplied by this baseline to estimate the water usage (for each water use and operations). The technology reference cases are chosen based on the availability of water data in the literature. The water data must include withdrawal and consumption for both the cooling and process operations to be used. The resultant baseline values are shown in Table 4 for coal and natural gas in m³/MJ_{HHV}.

$$\text{Operations_Water_Usage}_{\text{Green Case}} = \text{Heat Rate}_{\text{Green Case}} \times \left(\frac{\text{Operations_Water_Usage}_{\text{TRC}}}{\text{Heat Rate}_{\text{TRC}}} \right) \quad (5)$$

3.3.2 Variations in Plant Location

The WICa metric considers both water quality and the WSI, which vary from location to location. Therefore, the specific location of each of power plant and its context within the regional or national water supply affect the WICa on a case-by-case basis. We consider water quality and WSI as variables subject to sensitivity analysis.

Water quality data is challenging to source in literature and varies from location to location and implementation to implementation. Site-specific factors include the definitions of what constitutes a pollutant p , its corresponding safe limits $c_{ref,p}$, and the quality of the local water supply from which water is withdrawn. The purpose of this work is to compare the 65 different green cases generally. Therefore, we take water quality as a sensitivity parameter in the form of quality scenarios. The worst-case scenario would be to take high quality water and return poor quality water. The best-case scenario would be to take poor quality water and return high quality water – this is an unrealistic

380 scenario. A likely, best-case scenario would be to return the same quality water as withdrawn. The quality scenarios
381 used are shown in Table 6.

382 Table 5 shows the water stress data for selected representative countries used in this work. It is assumed that the
383 water bodies for withdrawal and return are located in the same region and thus have the same WSI (calculated per
384 country). The most recent WTA data are available from Luo *et al.*(36) as part of the WRI's Aqueduct water stress
385 projections and is described further in Luck *et al.* (37). These values were calculated based on contributions from 3
386 sectors: industry, domestic and agriculture. They presented three scenarios: business as usual, optimistic, and
387 pessimistic. We have used the business-as-usual projections for 2020 in Table 5.

388 The variation factor of 1.8 was used to determine the WTA* for non-strongly regulated flows as described in Pfister
389 *et al.* (13) . This accounts for water stress that may be experienced due to precipitation variability. The resulting WSI
390 values are computed using equation (1) from the electronic supplementary information and presented in Table 5. We
391 note that for studies that have location-specific information and considerations, a WSI specific to that location should
392 be used instead of these general country-level statistics.

393

Table 7: Water and GHG emissions data for carbon-capture technologies in coal-fired plants. ^aFrom Adams et al. (7)

Tag	Green Technology/Process	^a Net Plant output	^a Electrical Efficiency	^a Heat Rate	^a CO ₂ Removed	^a Cradle-To-Plant-Exit GWP	CO ₂ avoided	Water withdrawal	Water consumption	Net Water Discharge
(Units)		MWe	%HHV	MJ _{HHV} /MWh	%	tCO ₂ e/MWh	tCO ₂ e/MWh	m ³ /MWh	m ³ /MWh	m ³ /MWh
SCPC-2	Solvent Based	525	27.4	13139	90	0.327	0.623	4.18	3.29	0.89
SCPC-3	Solvent Based - Adv.amine	837	36.1	9972	90	0.275	0.675	3.17	2.5	0.68
SCPC-4	Solvent Based - Cansolv	822	33.8	10651	90	0.279	0.672	3.39	2.66	0.73
SCPC-5	Solvent Based - Amine	546	27.2	13235	90	0.323	0.627	4.21	3.31	0.9
SCPC-6	Solvent Based - Adv.Amine	616	36.5	9863	90	0.271	0.679	3.14	2.47	0.67
SCPC-7	Solvent based-Chilled Ammonia	548.7	28.4	12676	90	0.314	0.637	4.03	3.17	0.86
SCPC-8	Solvent based-Chilled Ammonia	549.3	31.5	11429	90	0.292	0.658	3.64	2.86	0.78
SCPC-9	Solvent based-Chilled Ammonia	558.7	27.9	12903	90	0.325	0.625	4.11	3.23	0.88
SCPC-10	Solvent based-Chilled Ammonia	614	36.6	9836	88.4	0.276	0.674	3.13	2.46	0.67
SCPC-11	Solvent Based-Amine	519	25.6	14063	94	0.291	0.659	4.48	3.52	0.96
IGCC-1	Solvent Based-Selexol	543	32.6	11043	90	0.241	0.709	2.74	2.29	0.45
IGCC-2	Solvent Based-Selexol	513	31	11613	90	0.251	0.699	2.88	2.41	0.48
IGCC-4	Data not available	500	29.9	12040	86	0.307	0.644	2.99	2.5	0.49
IGCC-5	Solvent Based-Selexol NS	694	32	11250	90	0.241	0.71	2.79	2.33	0.46
IGCC-6	Solvent Based - Shift + Selexol	455	35.1	10256	94	0.197	0.753	2.55	2.13	0.42
COXY-1	Oxy-fuel	376.1	34.3	10493	91	0.16	0.79	1.98	1.52	0.46
COXY-2	Oxy-fuel	352.9	32.2	11180	90	0.178	0.772	2.11	1.62	0.49
COXY-3	Oxy-fuel	670.3	34.7	10369	94	0.136	0.814	1.96	1.5	0.45
COXY-4	Oxy-fuel with 10% air added	669.3	34.7	10384	94	0.137	0.814	1.96	1.51	0.45
COXY-5	Oxy-fuel with 20% air added	666.2	34.5	10432	94	0.137	0.813	1.97	1.51	0.46
COXY-6	Oxy-fuel with 30% air added	661.2	34.3	10511	94	0.138	0.812	1.98	1.52	0.46
COXY-7	Oxy-fuel with 40% air added	654.1	33.9	10626	94	0.14	0.811	2.01	1.54	0.46
COXY-8	Oxy-fuel with 50% air added	645.1	33.4	10775	94	0.142	0.809	2.03	1.56	0.47
COXY-9	Oxy-fuel	238.5	32.3	11149	90	0.231	0.719	2.11	1.62	0.49
COXY-10	Oxy-fuel	533.2	32.7	10996	93	0.147	0.804	2.08	1.6	0.48
COXY-11	Oxy-fuel w/ compres, dehydration	310	33.8	10648	100	0.091	0.859	2.01	1.54	0.47
COXY-12	Oxy-fuel w/ double flash purification	270.6	29.5	12199	92	0.189	0.762	2.3	1.77	0.53
COXY-13	Oxy-fuel w/ distillation purification	265.8	29	12418	90	0.214	0.737	2.34	1.8	0.54
COXY-14	Oxy-fuel	574	36.6	9836	90	0.203	0.747	1.86	1.43	0.43
COXY-16	Oxy-fuel (Case: S22F)	549	30.1	11960	90.9	0.201	0.749	1.81	1.29	0.52
COXY-17	Oxy-fuel (USC-subbituminous)	509	31.5	11429	90	0.203	0.748	2.16	1.66	0.5
COXY-18	Oxy-fuel (SCPC-bituminous)	501	31	11613	98	0.12	0.83	2.19	1.68	0.51
COXY-19	Oxy-fuel (SCPC-bituminous)	510	31.5	11429	90	0.203	0.748	2.16	1.66	0.5
COXY-20	Oxy-fuel (USC-subbituminous)	833	34.1	10557	90	0.182	0.768	1.99	1.53	0.46
COXY-21	Oxy-combustion Supercrit.	550	29.3	12287	99.5	0.105	0.845	2.32	1.78	0.54
COXY-22	Oxy-combustion Supercrit.	555.1	29.5	12203	99.4	0.104	0.846	2.3	1.77	0.53
COXY-23	Oxy-combustion Supercrit.	549	29.3	12287	96.9	0.132	0.819	2.32	1.78	0.54
COXY-24	Oxy-combustion Supercrit.	548.7	29.2	12329	85.5	0.182	0.769	2.33	1.79	0.54
COXY-25	Oxy-combustion Ultra-supercrit.	550	33	10909	99.4	0.093	0.857	2.06	1.58	0.48
COXY-26	Oxy-combustion Ultra-supercrit.	545.3	32.7	11009	93.2	0.154	0.796	2.08	1.6	0.48
IGFC-1	Minimized CO content in SOFC feed	719	42	8571	100	0.073	0.877	0.96	0.7	0.26
IGFC-2	IGFC-1 w/ seasonal shutdowns	719	42	8571	100	0.073	0.877	0.96	0.7	0.26
IGFC-3	IGFC-1 w/ integrated energy storage	719	41.5	8675	100	0.074	0.876	0.97	0.71	0.26
IGFC-4	IGFC-2 w/ integrated energy storage	719	40.6	8867	100	0.076	0.875	0.99	0.72	0.27
IGFC-5	Cyngas directly in SOFC	719	38.4	9375	100	0.08	0.87	1.05	0.76	0.29
IGFC-6	IGFC-5 w/ seasonal shutdowns	719	38.4	9373	100	0.08	0.87	1.05	0.76	0.28
IGFC-7	IGFC-5 w/ integrated energy storage	719	38	9474	100	0.081	0.869	1.06	0.77	0.29
IGFC-8	IGFC-5 w/ integrated energy storage	719	37.4	9626	100	0.082	0.868	1.08	0.78	0.29
IGFC-9	Atm-Pressure IGFC Plant	253	49.4	7287	99	0.064	0.887	0.82	0.59	0.22
IGFC-10	Pressurized IGFC	253	56.2	6406	99	0.056	0.894	0.72	0.52	0.19
IGFC-11	Part. methane Syngas IGFC (TREMP)	846.6	44.4	8115	99	0.072	0.878	0.91	0.66	0.25
IGFC-12	Part. Methane Syngas IGFC (HICOM)	925	48.5	7425	99	0.07	0.881	0.83	0.61	0.23
IGFC-13	IGFC-DIRECT	865	45.3	7943	99	0.075	0.876	0.89	0.65	0.24
IGFC-14	Liquid-tin anode SOFC	93.9	57.2	6294	100	0.054	0.897	0.7	0.51	0.19

4. Results and Discussion

4.1 Calculated water flows

The raw data used in this study (performance and emissions data), including the results of the water withdrawal, consumption, and discharge calculations, is presented for coal and natural gas in Tables 7 and 8 respectively. These numbers apply to all 65 green cases generally, regardless of where the plant is located. (7)

Figure 7 shows the overall water withdrawal, consumption and process water discharge for all the coal-based CC technologies. The first data bar is the coal base case (SCPC w/o CC). The consumption and process water discharge portions are normalized to withdrawal such that their sum is equivalent to the withdrawal.

SCPC and IGCC technologies with CC have worse water withdrawal than the high CO₂-emitting base case, illustrating the tradeoff between water impacts and CO₂ emissions avoidance. However, the less mature oxyfuel combustion and SOFC technologies have lower water impacts than even the base case, because as a necessary part of the CO₂ capture process, they capture water that would be otherwise emitted in the flue gas. Since this water can be recycled or discharged, it is a positive synergistic benefit on the water cycle. The IGFC technology is superior in terms of water withdrawal for the cradle-to-plant-exit life cycle as compared to all other technologies presented.

Water data for the COXY-16 technology case is obtained from Haslbeck *et al.* (38) and not calculated as described above. All relevant water data is available in the report. We observed that reported water consumed is the same as the reported water withdrawn, implying a zero process water discharge. Nothing about the process suggests the possibility of this outcome and we reason this to be an error in the text. We therefore recalculated the water

Table 8: Water and GHG emissions data for carbon-capture technologies in gas-fired plants. ^aFrom Adams *et al.* (7)

Tag (Units)	Green Technology/Process	^a Net Plant output MWe	^a Electrical Efficiency %HHV	^a Heat Rate MJ _{HHV} /MWh	^a CO ₂ Removed %	^a Cradle-To-Plant Exit GWP tCO ₂ e/MWh	CO ₂ avoided tCO ₂ e/MWh	Water withdrawal m ³ /MWh	Water consumption m ³ /MWh	Net Water Discharge m ³ /MWh
NGCC-2	Solvent Based - MEA	789.0	46	7809	90%	0.115	0.291	1.69	1.29	0.41
NGCC-3	Solvent Based - Advanced Amine	804.0	47	7660	90%	0.113	0.293	1.66	1.26	0.40
NGCC-4	Solvent Based - Econamine FG+	448.9	43	8451	90%	0.123	0.283	1.83	1.39	0.44
NGCC-5	Solvent Based - Amine	485.0	42	8491	90%	0.122	0.284	1.84	1.40	0.44
NGCC-6	Solvent Based - Amine	389.0	41	8824	94%	0.110	0.296	1.91	1.45	0.46
NGFC-1	SOFC base case	693.0	74	4865	100	0.044	0.362	0.59	0.42	0.18
NGFC-6	Low pressure ATR, 6 parallel SOFC sections. (BASELINE CASE1-1)	550.0	56	6394		0.059	0.347	0.67	0.4485	0.22
NGFC-7	Low pressure ATR, 8 parallel SOFC sections. Smaller ASU (CASE 1-7)	550.0	62	5825		0.053	0.353	0.61	0.41	0.20
NGFC-8	High pressure ATR (CASE 2-1)	550.0	65	5556		0.055	0.351	0.70	0.55	0.15
NGFC-9	High pressure ATR. Smaller ASU (CASE 2-3)	550.0	65	5556		0.055	0.351	0.48	0.31	0.16
NGFC-10	No ATR (CASE 3-1)	550.0	66	5463		0.050	0.356	0.52	0.35	0.17

413 consumption based on withdrawal and process water discharge data provided in the report and the values are aligned
414 with other oxy-fuel technology cases.

415 Figure 8 summarizes the results for natural gas. Like the coal case, the post-combustion capture processes had
416 worse water impacts than the base case (without CC) but the SOFC based cases had reduced water impacts since
417 water produced from natural gas oxidation could be captured and returned to the environment.

418 Figure 9 illustrates the technologies investigated in this work with regard to their total water consumption and
419 their total greenhouse gas emissions. Two key observations from this figure are noteworthy: (1) there are distinct
420 clusters between the different technologies and fuel types; (2) water consumption and greenhouse gas emissions for
421 CC technology for coal-based plants are higher than all natural gas technologies except for IGFC which has lower GHG
422 emissions and water consumption than oxy-fuels, IGCC and solvent based post-combustion technologies (SCPC).

423 The base cases are also shown for coal and natural gas, creating ideal regions of water consumption and GHG
424 emissions relative to the base cases. All technology cases have reduced total GHG emissions than both base cases as
425 can be seen within the regions created by the vertical and horizontal lines drawn through the base case points.
426 However, SCPC cases and IGCC cases have higher water consumption relative to the SCPC base case. Oxy-fuels and
427 NGCC have lower water consumption than the SCPC base case but higher water consumption than the natural gas
428 base case.

429 The natural gas based SOFC systems are the best in terms of water consumption and greenhouse gas emissions.
430 Coal based SOFC systems are second in terms of water consumption and greenhouse gas emissions. This trend
431 between NGFC and IGFC, was observed in Adams *et al.* (7) with regard to levelized cost of electricity (LCOE) and
432 greenhouse gas emissions.

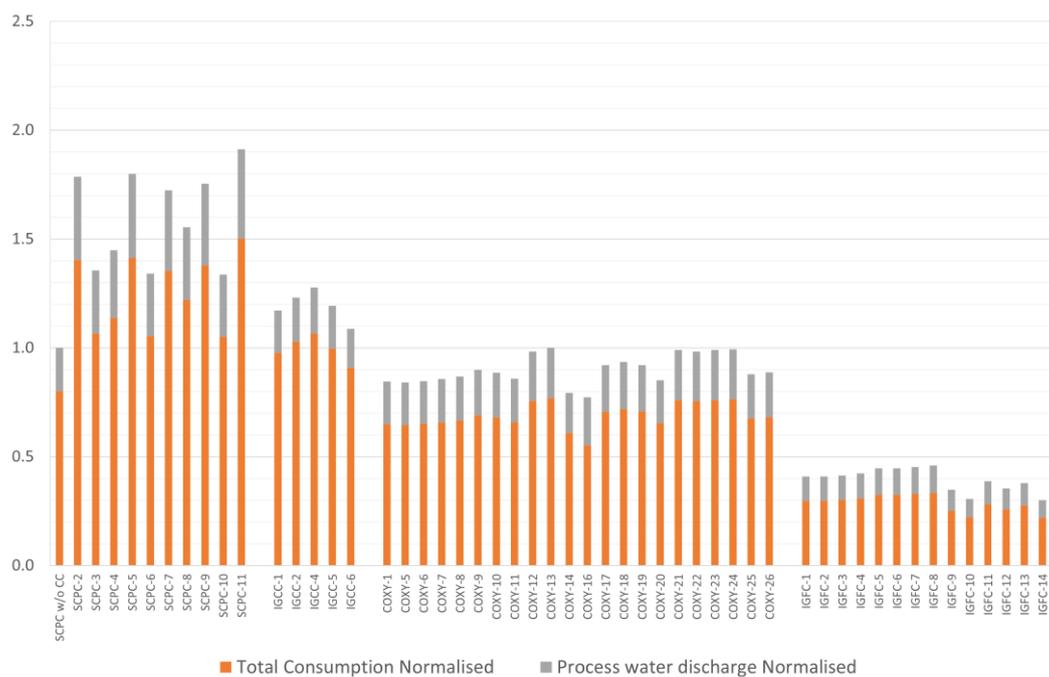


Figure 7: Overall water usage data for carbon capture technologies in coal-fired plants

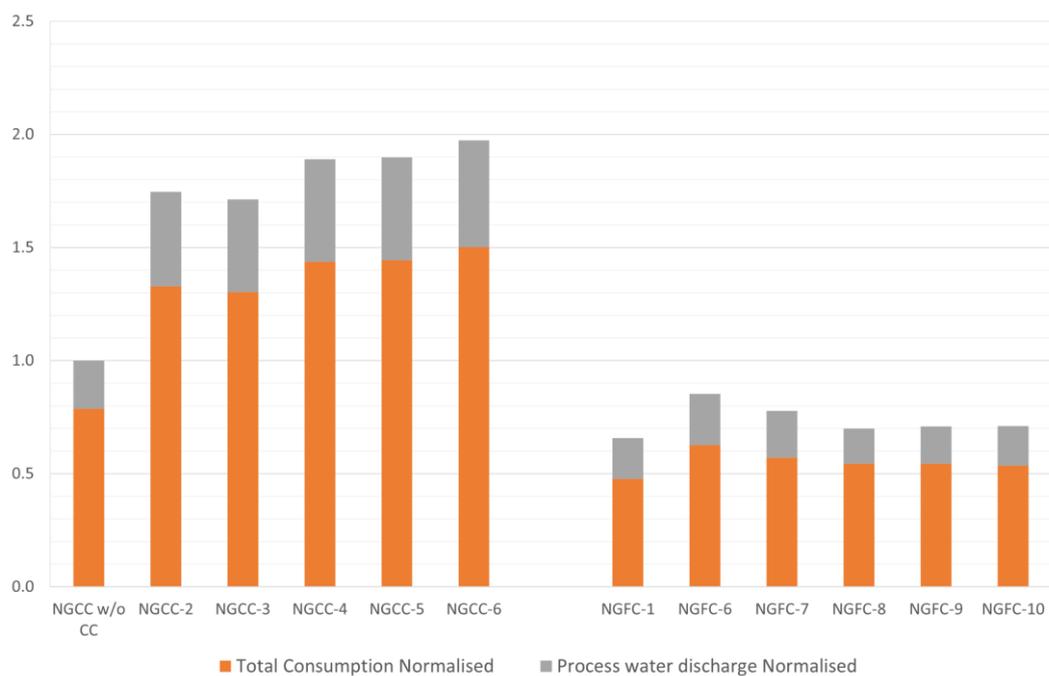


Figure 8: Overall water usage data for carbon capture technologies in gas-fired plants

433 This figure gives a good broad perspective on the water requirements of the different technologies, relative to
 434 their GHG emissions. However, some impacts of these technologies are unclear. What are the impacts to water quality
 435 and how does this compare to plants without CC? What are the impacts of consumption in locations with high and

436 low water scarcity? These considerations enhance the decision-making process by creating holistic awareness around
 437 technology choices and are examined next.

438 4.2 Sensitivity analysis of WII to water quality (Q_{Wi} and Q_{Ri})

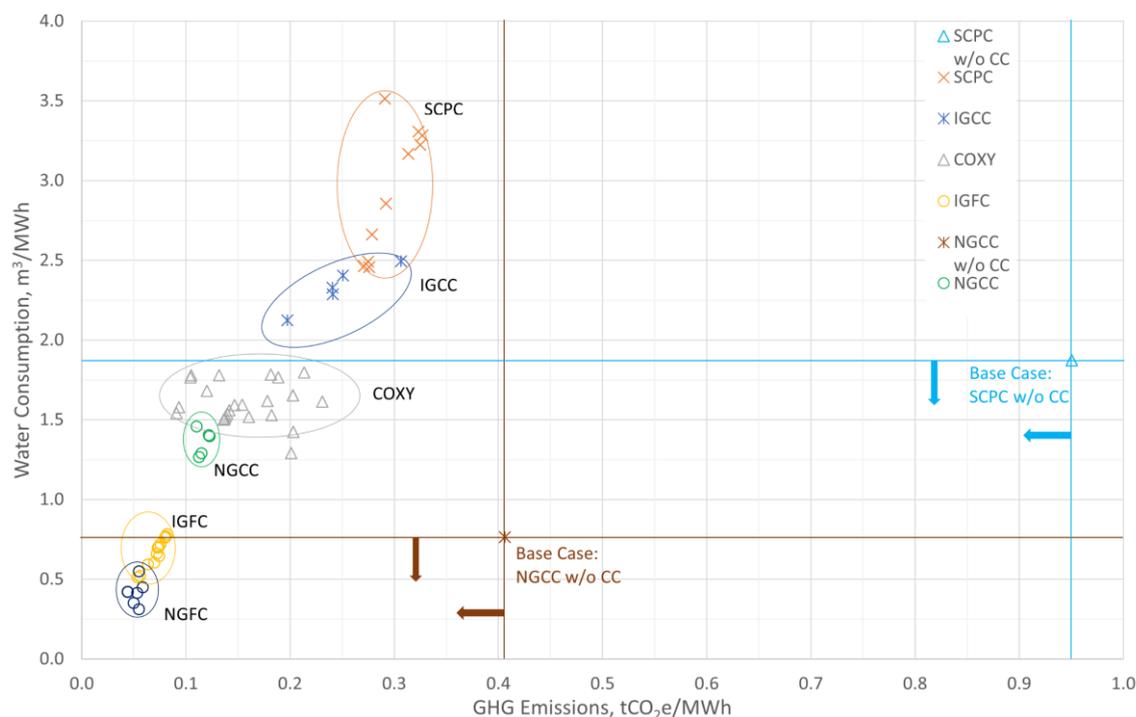


Figure 9: Water consumption vs GHG emissions of coal and natural gas fired carbon capture technologies.

439 To show the sensitivities to water quality in the withdrawn and returned water, we use WSI = 0.999 (reflecting the
 440 highest national water scarcity index in the world). The WII is then calculated for the different withdrawal and return
 441 qualities shown in Table 6 at this WSI and shown in Figure 10. For a WSI of approximately 1, the water withdrawal
 442 maps the worst-case scenario accurately. This means that water withdrawal can be used to approximate the WII when
 443 the water quality is very low. Water withdrawal is also the worst-case upper bound to the WII. When water quality is
 444 high (water withdrawn and returned are both equal to 1), the WII correlates to the total water consumption exactly.
 445 Thus, water consumption can be used to approximate WII in very high-quality situations, or to form a lower bound
 446 on WII. This creates a range of potential water impacts of technologies when data is unknown.

447 As the quality improves the WII increases (*i.e.* withdrawing higher quality water means less high quality water is
 448 available for other users). In the case of water quality = 0.02, the lower impact is misleading. Withdrawing poor quality
 449 water might reflect low impact however this water requires pre-treatment to either cooling or process water quality.

450 Our work assumes that all the cited processes work the same regardless of water quality. Therefore, the impact of
451 that pre-treatment will not be reflected in the results and would ultimately increase the LCOE of the plant.

452 This raises an important point: the consideration of water quality and pre-treatment in the calculation of LCOE. In
453 the previous study, no standardisation was performed on water quality and how that might affect pre-treatment
454 costs. The water impact in an absolute sense differs greatly depending on the quality of water (see the next section)
455 and the relative water scarcity. Treatment costs may also vary based on these factors. Although out of scope of this
456 study, it should be considered in future work.

457 The WII results are presented in Figure 11 for different water quality values. The green case is normalised against
458 the base case for the different metrics.

459 From Equation (3), substituting an equivalent and, for this purpose, arbitrary value of 0.5 for Q_{Wi} and Q_{Rj} , with a
460 $WSI = 0.999$ for the green case the equation is now:

461

$$WII_{\text{Green Case}} = [(0.5)(0.999)(W_i - R_j)]_{\text{Green Case}} \quad (6)$$

462

463 To normalise this, we divide by the WII of the green case with the same water quality and WSI values of the base
464 case. The normalised equation is:

$$WII_{\text{Normalised, same quality}} = \frac{[(0.5)(0.999)(W_i - R_j)]_{\text{Green Case}}}{[(0.5)(0.999)(W_i - R_j)]_{\text{Base Case}}} \quad (7)$$

465

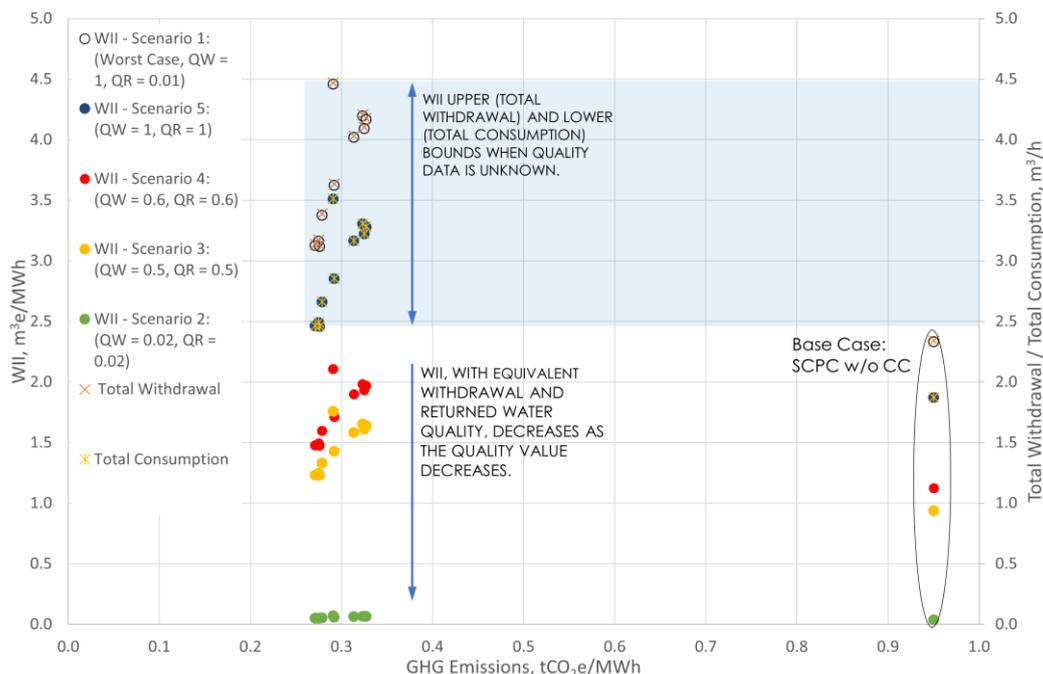


Figure 10: WII vs greenhouse gas emissions for high water scarcity index and varying water qualities for SCPC cases.

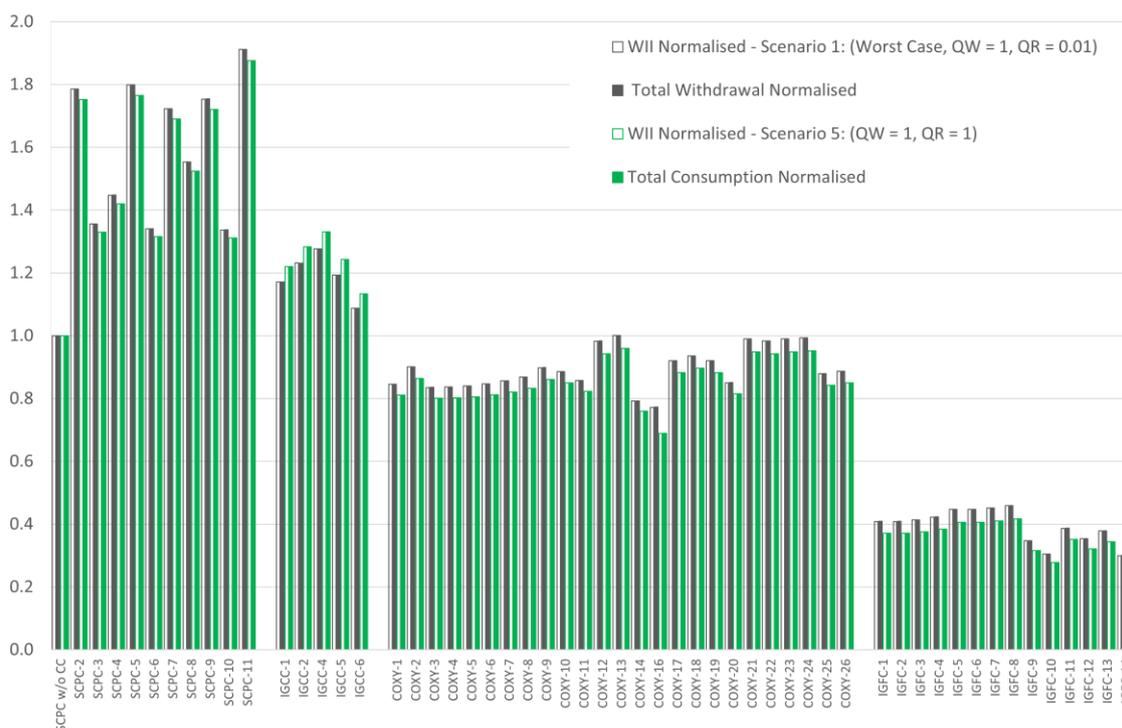


Figure 11: Relationship between normalised WII's and normalised withdrawal and consumption values for coal fired carbon capture technologies at high WSI.

466 Reduced further:

467

$$WII_{\text{Normalised, same quality}} = \frac{(W_i - R_j)_{\text{Green Case}}}{(W_i - R_j)_{\text{Base Case}}} \approx \frac{C_{\text{Green Case}}}{C_{\text{Base Case}}} \quad (8)$$

The difference between withdrawal and return is consumption (C_i). The normalised WII for all values of WSI with equal withdrawal and return water qualities are the same, and, are also equal to the normalised consumption values. In the normalised sense, only when the qualities are equal, the qualities and WSI are irrelevant. A similar effect can be seen for the worse-case scenario where $Q_{W_i} = 1$ (high water quality) and $Q_{R_j} = 0.01$ (low water quality).

We replace these values in equation (7) maintaining the WSI of 0.999:

$$WII_{\text{Normalised, worse case}} = \frac{(W_i - 0.01R_j)_{\text{Green Case}}}{(W_i - 0.01R_j)_{\text{Base Case}}} \quad (9)$$

We can approximate for a returned water of very low quality that:

$$W_i - 0.01R_j \approx W_i \quad (10)$$

Then the normalised WII for the worse case is approximately the normalised total withdrawal:

$$WII_{\text{Normalised, worse case}} \approx \frac{W_i_{\text{Green Case}}}{W_i_{\text{Base Case}}} \quad (11)$$

The normalised figure below shows these relationship

For IGCC values the normalised consumption value is greater than the normalised withdrawal value which is not observed in other technologies. It is important to remember that this bar graph must be read relative to the base case only and not the other parameters. However, this anomaly is not unusual for IGCC technology. The water data for IGCC reflects that there is a higher percentage of the withdrawn water that is consumed as compared to the base case and compared to all technologies investigated for both coal and natural gas. In the works of Macknick *et al.* (1) and Meldrum *et al.* (2) the percentage of water withdrawn for consumption in IGCC technology with CC is greater than SCPC cases. The additional water consumption can be attributed to the additional absorption steps and the gasifier.

In summary, when water quality and scarcity data is unknown, the data should be normalised to make comparative decisions between the categories. The most reasonable values to use are water qualities from the worst-case scenario. When geographical data is available, absolute values can be used to obtain a more rigorous meaningful result.

488 It is worthwhile mentioning that the water quality equation presented in (25) does create some boundaries around
 489 the water quality, specifically the returned water quality. The equation considers only one penalising pollutant (the
 490 worst case one) which has been raised as a challenge by the authors. If we are to consider any local or national
 491 regulations on the concentrations of compounds that are considered to be pollutants, these regulations prohibit

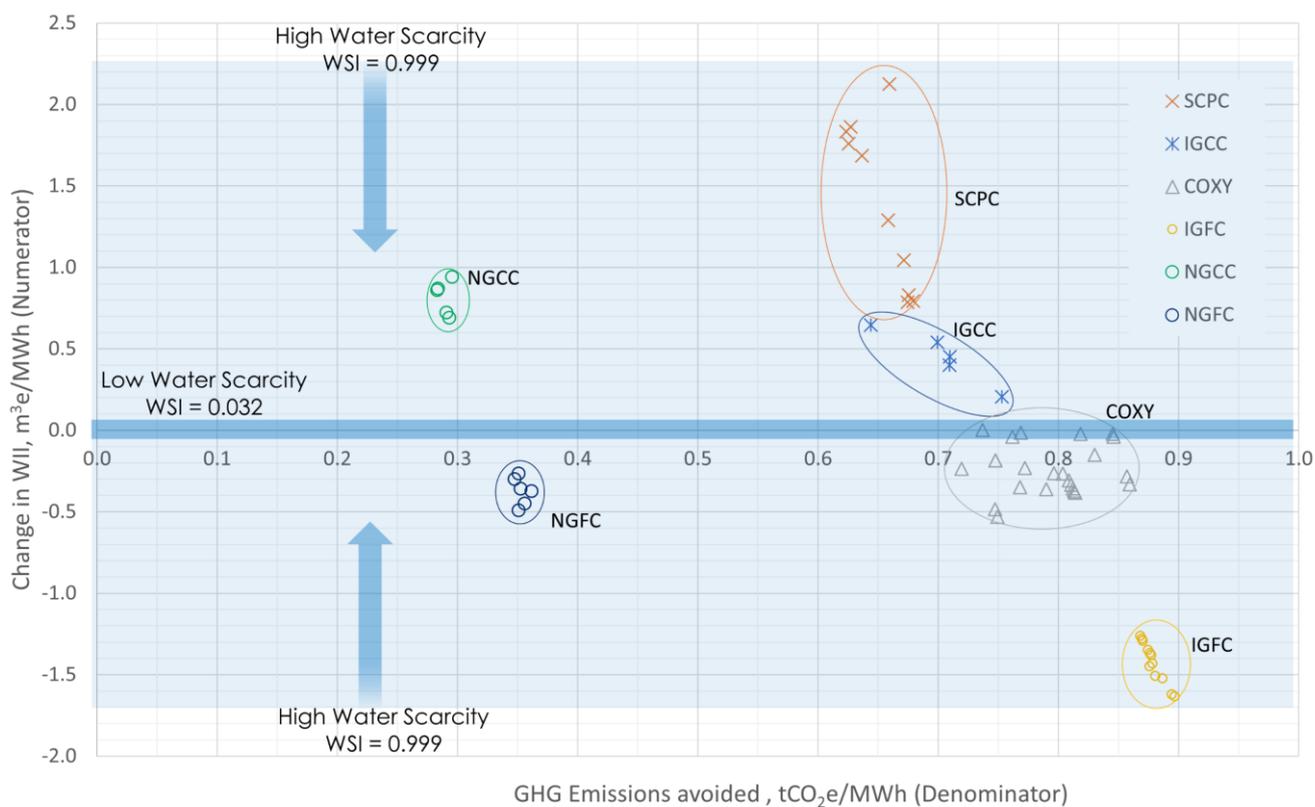


Figure 12: Change in WII relative to carbon dioxide avoided using the worst-case scenario for water qualities and a high water scarcity index (WSI = 0.999). Blue shading reflects the impact of decreasing water scarcity; the data range moves in the direction of the arrows as WSI decreases. See Figure 13 for the magnified version of the darker blue shading at low water scarcity= 0.03

492 industries from discharging/returning water with concentrations higher than the concentration of the reference
 493 pollutant. Equation 4 is then always 1 in any normal situation in which a plant is operating legally. It is unclear if this
 494 is a feasible or realistic approach especially when one pollutant is considered. The idea of improving water quality is
 495 not new. Consider desalination or inter-basin transfer (39). Within the power generation context however, high
 496 volumes of high-quality water is necessary and planning and securing these resources is key to meeting power

497 demands. The “basin” is unlikely to be shared with other users. We put forward these various scenarios to emphasize
 498 the equal importance of water volume and water quality.

Table 9: Change in WII (numerator of WICa) for different WSI values of countries for SCPC technology, presented in descending order to illustrate the boundary of the impact. These values are based on Scenario 1 (worst-case) quality values.

World ranking	1	31	46	50	58	76	87	96	115
Country	United Arab Emirates	India	China	South Africa	Philippines	Poland	Finland	Canada	Norway
WSI	0.999	0.981	0.940	0.906	0.813	0.409	0.224	0.099	0.032
SCPC-11	2.126	2.087	2.000	1.928	1.731	0.870	0.477	0.211	0.068
SCPC-5	1.863	1.830	1.753	1.690	1.517	0.763	0.418	0.185	0.060
SCPC-2	1.833	1.800	1.725	1.662	1.492	0.750	0.411	0.182	0.059
SCPC-9	1.758	1.727	1.654	1.594	1.431	0.720	0.394	0.174	0.057
SCPC-7	1.686	1.656	1.587	1.529	1.373	0.690	0.378	0.167	0.054
SCPC-8	1.291	1.267	1.214	1.170	1.051	0.528	0.289	0.128	0.042
SCPC-4	1.044	1.025	0.983	0.947	0.850	0.428	0.234	0.103	0.034
SCPC-3	0.829	0.814	0.780	0.752	0.675	0.339	0.186	0.082	0.027
SCPC-6	0.794	0.780	0.748	0.720	0.647	0.325	0.178	0.079	0.026
SCPC-10	0.786	0.772	0.739	0.713	0.640	0.322	0.176	0.078	0.025

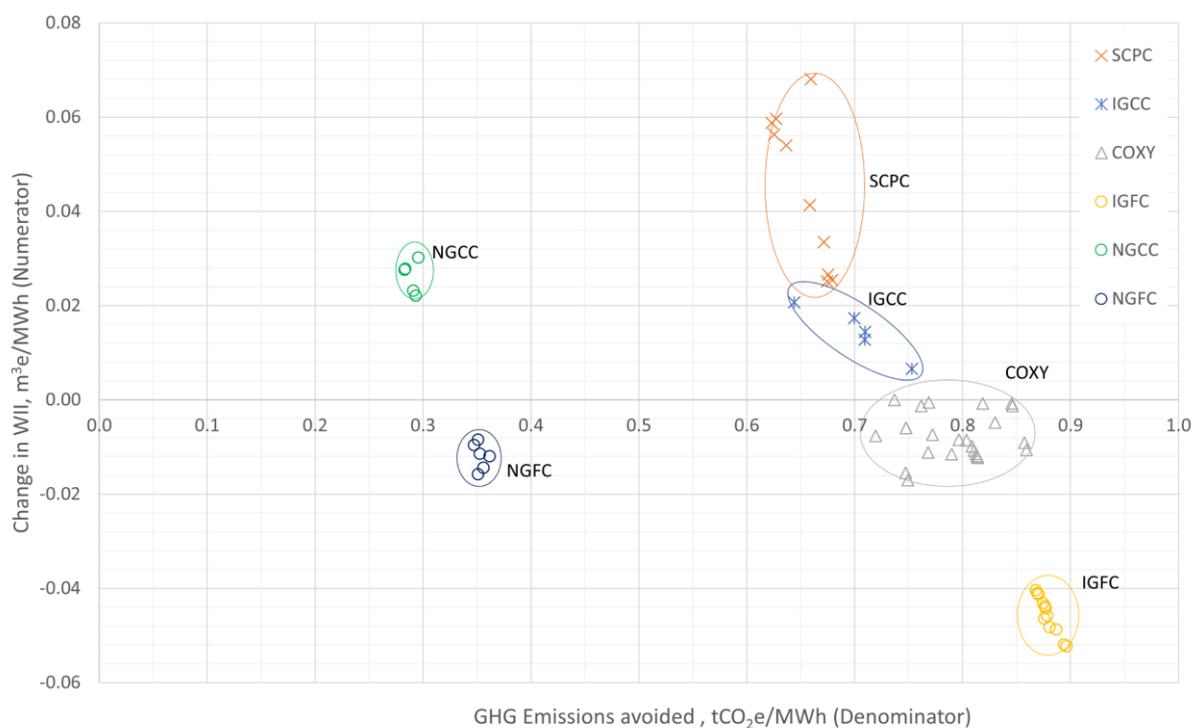


Figure 13: Change in WII relative to carbon dioxide avoided using the worst-case scenario for water qualities and a low water scarcity index (WSI = 0.032). The expanded graph at high water scarcity (WSI = 0.999) is shown in Figure 12.

499 4.3 Sensitivity analysis of WII to WSI

500 Figure 12 and 13, and Table9 demonstrate, using SCPC technology as an illustrative example, the effect of water
 501 scarcity on the overall water impact for different countries. We calculate the WII based on the worst-case quality

502 scenario. In Table 9 the technologies have been ordered to show the range of WSI values. This range is shown by the
503 larger blue shading on Figure 12 (WSI = 0.999 (UAE)). As WSI decreases (WSI = 0.032 (Norway)) the impact is lessened
504 as seen by the values in Table 9 and the narrower range, shown by the smaller blue shaded region on Figure 12. Figure
505 13 is a zoomed in version of this smaller darker blue shaded region. The SCPC values in Table 9 present varying data
506 with a significant difference between SCPC-11 and SCPC-10 for all values of WSI. As noted earlier, the WII maps the
507 water withdrawal data at the worst-case water quality scenario and a high WSI. This means that the change in WII is
508 in fact the difference in withdrawal rates between the base case and the green case; for SCPC-10 the change is less
509 compared to the change for SCPC-11. For these specific SCPC cases, these values are attributed to, and are
510 proportional to, the differing heat rates of these technology cases (Table 7), SCPC-10 has a heat rate of 9836 MJ_{HHV}-
511 /MWh and SCPC-11 has a heat rate of 14063 MJ_{HHV}/MWh. Another difference between these two cases is the type
512 of solvent used; SCPC-10 uses chilled ammonia whereas SCPC-11 is amine based. Depending on the actual mechanism
513 of solvent use (washing steps and heat exchange), water usage can be affected. Matin *et al.* (40), investigated varying
514 concentrations monoethanolamine (MEA) as an amine solvent in their LCA work. It was found that these
515 concentrations do not impact the water consumption impact category as much as the CO₂ emissions.

516 Table 9 also highlights that, higher water impacts are experienced in regions of high-water scarcity (WSI = 0.999,
517 UAE) as seen in the range of values across the countries for each SCPC technology case. The same trend is observed:
518 when high-quality water is consumed, the impact increases. However, the impact of using high-quality water is far
519 greater in a region with a higher water scarcity index because it is in greater demand (39).

520 In the normalised sense, as shown in Figure 11, the value of WSI doesn't not change the normalised impact,
521 however comparative conclusions can still be drawn. In a region with high water stress, withdrawing good quality
522 water will mean less water available to other users. There is a challenge in choosing the most realistic scenario without
523 having a full picture of the process. These graphs show that by varying water quality of withdrawn and returned water,
524 eventually the water impact maps the water withdrawn in the worst-case scenario and then maps the water
525 consumed in the case of the same water quality. In the case of same water quality, we see that the normalised value
526 for the technology is the same and the real difference comes from the worst case scenario (Scenario 1). Additionally,
527 Figure 13, shows that two distinct categories of technologies can be identified. NGFC, IGFC and COXY have a net
528 benefit for the environment in terms of water sustainability whereas the other technologies illustrate the negative
529 trade-off between water impact and GWP.

4.4 Discussion

Figure 12 is the metric presented as the numerator (change in water impact between the green case and base case) against the denominator of the metric (CO₂ emissions avoided) for all technologies investigated. A negative change in WII implies that the WII of the green case is less than that of the base case.

Firstly, we observe the distinct trends between the natural gas-based technologies and the coal-based technologies. It is important to remember that the natural gas based case studies reflect a lower amount of GHG emissions avoided as compared to the coal based case studies purely because the total cradle-to-plant-exit GHG emissions for the natural gas base case is lower than that for the coal base case.

Both coal and natural gas SOFC technology have a negative change in WII but IGFC has a higher GHG emissions avoided, due to the high emissions of the coal base case. The average GHG emissions of IGFC is 0.07 tCO₂e/MWh and NGFC is 0.05 tCO₂e/MWh (Table 7, reported as cradle-to-plant-exit GWP) making NGFC the better choice in terms of average emissions. However, in a feasibility study natural gas might be the only viable option for various reasons. If the base case of a coal plant was used, the numbers for all the natural gas cases would look very different. There would be a greater change in water impact and a higher amount of GHG emissions avoided.

The next best technology is coal based oxy-fuels (COXY) both in terms of change in WII and GHG emissions avoided, however, consumes more water than NGCC NGFC and IGFC (Figure 9). In this situation, with three closely competing technologies (excluding NGCC due to its positive change in WII), considerations on location (access to natural gas/coal, water and other raw materials), emissions regulations and the land footprint required to construct this kind of facility must be considered. Further to this, feasibility studies are necessary and imperative to understand the impacts (economic, environmental, and social) over the entire supply chain to arrive at a suitable technology, this includes the water impact and GHG emissions.

Table 10 lists the final median WICa metric values, based on a worst-case scenario and a high WSI, for all the technologies investigated in this work and is presented in Figure 14 relative to key water and energy metrics.

Table 10: Median WICa values for the technologies investigated presented in ascending order for both coal and natural gas CC technologies

Fuel type	Technology	WICa Value
Coal	IGFC	-1.57
	COXY	-0.33
	IGCC	0.64
	SCPC	2.30
Natural gas	NGFC	-1.03
	NGCC	3.04

553 Negative WICa values mean that there is a net benefit to water resources and GHG emissions reduction since the
554 WII for the green case is lower than that of the base case. It is interesting to compare the fuel efficiency to the
555 water metrics. Figure 14 shows the anticipated link between electrical efficiency and water usage – higher efficiency
556 technologies have lower water usage - and the overall benefits of less mature but more efficient, technologies. Even
557 though the efficiencies for COXY, IGCC and SCPC technologies are similar, the median water usage are significantly
558 lower for COXY technologies. A closer look, at Table ESI 2 (in electronic supplementary information) shows that the
559 percentage of process operations water withdrawal to total operations water withdrawal (cooling + process) for
560 COXY case studies is 8% whereas for IGCC and SCPC technologies, this percentage is between 15% and 22%. This
561 could suggest two things. Firstly, the water requirements of the individual unit operations are far less than that of
562 SCPC and IGCC. This is a high possibility as solvent based post-combustion and pre-combustion systems have high
563 water requirements. Additionally, due to the complete separation of H₂O and CO₂, COXY systems have the
564 potential of water recovery. This water can be treated and reused within the system thereby reducing raw water
565 withdrawal ((17), (41)) and is enough, in some instances, to satisfy the full water consumption requirement (41). In
566 the cases investigated in this study, it is unclear if this was done. A similar benefit was noted in van der Spek et al.
567 (42) where the comparison of oxyfuel configuration to post-combustion configuration resulted in lower cooling
568 water intensity due to the integration of the steam cycle with downstream processes.

569 Secondly, and conversely, the percentage of the cooling operations water withdrawal to total operations water
570 withdrawal for COXY systems in this work, is more than SCPC and IGCC. The actual withdrawal values are, however,
571 significantly lower. Zhu *et al.* (17) investigated the life cycle water consumption of oxyfuel combustion systems, and
572 found that “operations and maintenance”, which includes cooling, consume the most water over the life cycle.
573 However, within “operations and maintenance” they do not distinguish between cooling and other operations making
574 it impossible to determine if cooling or other unit operations contribute the most to water consumption. Again,
575 further validating earlier observations, the technologies with high efficiencies, low water impact and low water
576 consumption are the fuel cell technologies.

577 5. Conclusions

578 The objective of this work was to create an easy, usable, high impact way to assess the trade-off between global
579 warming mitigation, as CO₂ equivalents avoided, and the impact on water resources for CC technologies in the power
580 generation industry.

581 The analysis shows that, overall, CC technology increases water usage except for IGFC and NGFC technologies. This
582 suggests that capturing carbon can be done in a water efficient way by selecting an appropriate technology. The
583 usefulness of the metric is demonstrated in the absence of specific water quality and water scarcity data—a common
584 situation as often noted in the literature (14,43). Our results show that the worst-case scenario (described as scenario
585 1 in this work), can be used to estimate the WII of different technologies and, in a normalized sense, not knowing the
586 WSI does not impair the comparative conclusions that can be drawn.

587 Our case study of 65 different low-CO₂ fossil-based power plant systems provided a substantial basis from which
588 to estimate water usage data and draw qualitative and quantitative conclusions. Additionally, the exercise drew
589 attention to the water data availability in the literature versus the availability of other data, such as GHG emissions
590 and economic data. The discrepancy between *needing water* in the power generation CC process, and the *reporting*
591 *of water usage* data in power generation CC research was emphasised. Additionally, we also recognise that changes
592 in the cooling employed in the technology reference cases would alter the overall water usage image presented here
593 but potentially not impact overall observations.

594 By varying the quality variable for both water withdrawn, and water returned, for a WSI close to 1 the impact maps
595 the water withdrawal and consumption data points accurately for scenario 1 and the scenarios when the qualities are
596 equivalent. This is especially useful when data are unknown, however it is important to note that the specific impact
597 relies heavily on the water quality. In varying the WSI, we observe greater impact for areas with low WSI versus areas
598 with high WSI. For low impact cases due to poor quality water, considerations related to pretreatment cost must be
599 factored in. These could affect other parameters not included in the scope of this work.

600 We established that NGFC, IGFC and COXY technologies have the most promising WICa values. However, IGFC and
601 COXY have the highest GHG emissions avoided due to the high GHG emissions of the base case. SOFC based CC has
602 the lowest water usage and GHG emissions on an absolute basis compared to all other technologies investigated
603 further supported by their low WICa values.

604 Enabling the CC technology decision making for fossil-based power plants with a water resources impact
 605 dimension was a further goal of this work. The method presented here translates to other contexts and industries
 606 with different water metrics and green initiatives (reducing particulate matter, reducing sulfur etc.). The WICa metric
 607 reflects the key characteristics that are necessary in understanding the potential water impacts of reducing GWP, as

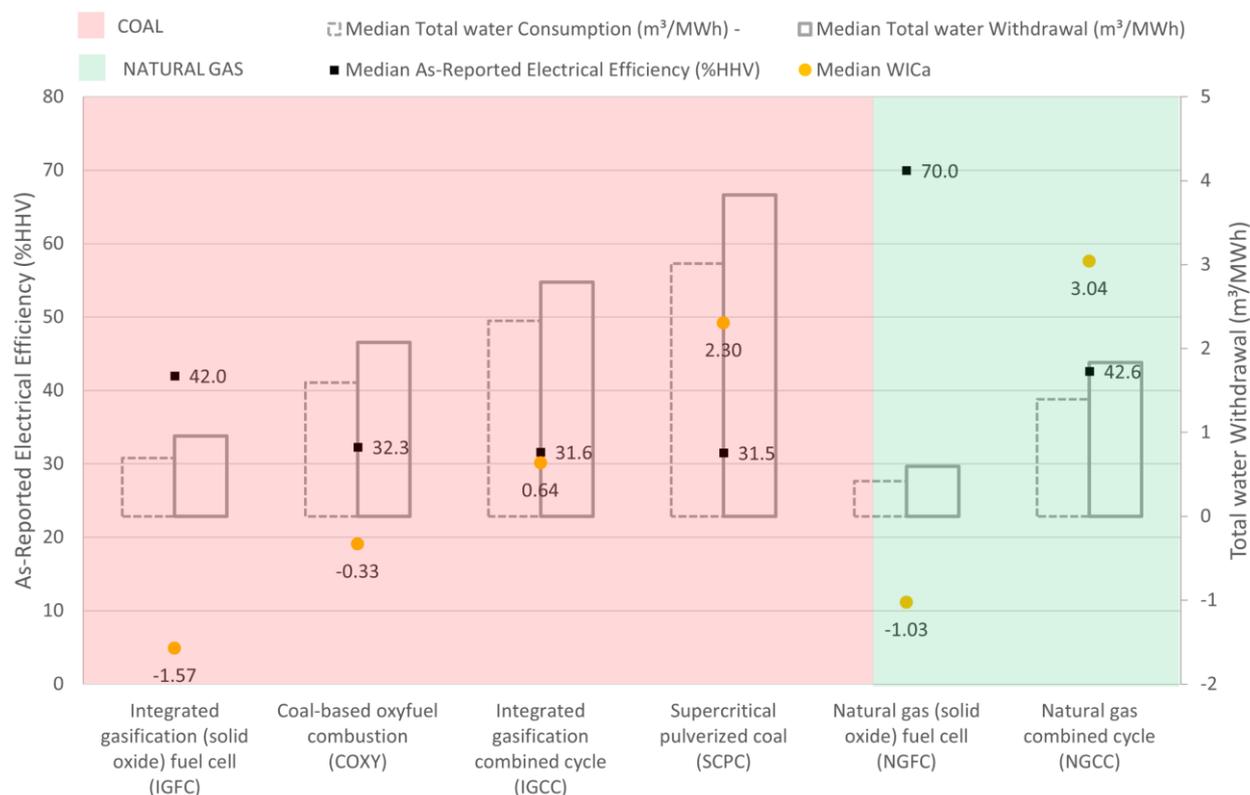


Figure 14: Summary of the relationship between technology efficiencies, water usage and WII.

608 described in Table 1. It is useful in making general assessments of technologies for specific regions and for specific
 609 water qualities. It does not yet include the additional emissions impact for the treatment of water to improve water
 610 quality before use and after disposal.

611 Author Contributions

612 P.M. – Formal analysis and writing – original draft; P.M. and T.A.A – Conceptualisation and methodology; T.A.A. and K.H – Writing – review
 613 and editing, supervision.

614 Conflicts of interest

615 There are no conflicts to declare.

616 Data Availability

617 The data supporting this article have been included as part of the Electronic Supplementary Information (ESI).

618 Acknowledgements

619 No external funding was used to support this research.

620 Electronic supplementary Information

621 Electronic Supplementary Information (ESI) supplied as additional document.

622 Notes and references

- 623 1. Macknick J, Newmark R, Heath G, Hallett KC. Operational water consumption and withdrawal factors for electricity generating
624 technologies: A review of existing literature. Vol. 7, Environmental Research Letters. 2012.
- 625 2. Meldrum J, Nettles-Anderson S, Heath G, Macknick J. Life cycle water use for electricity generation: A review and harmonization of
626 literature estimates. Vol. 8, Environmental Research Letters. 2013.
- 627 3. Zhai H, Rubin ES. Water Use at Pulverized Coal Power Plants with Postcombustion Carbon Capture and Storage. Energy Procedia.
628 2011;4:2238–44.
- 629 4. Rosa L, Sanchez DL, Realmonte G, Baldocchi D, D’Odorico P. The water footprint of carbon capture and storage technologies.
630 Renew Sustain Energy Rev. 2021;138:1–11.
- 631 5. Leung DYC, Caramanna G, Maroto-Valer MM. An overview of current status of carbon dioxide capture and storage technologies.
632 Renew Sustain Energy Rev. 2014;39:426–43.
- 633 6. Yagmur Goren A, Erdemir D, Dincer I. Comprehensive review and assessment of carbon capturing methods and technologies: An
634 environmental research. Environ Res. 2024;240(P1):117503.
- 635 7. Adams II TA, Hoseinzade L, Madabhushi PB, Okeke JJ. Comparison of CO₂ capture approaches for fossil-based power generation:
636 Review and meta-study. Vol. 5, Processes. 2017.
- 637 8. OECD ENVIRONMENTAL OUTLOOK TO 2050 : The Consequences of Inaction Key Facts and Figures. Outlook. 2012.
- 638 9. United Nations. Sustainable Development Goal 6 [Internet]. United Nations. 2023 [cited 2024 Mar 22]. Available from:
639 https://sdgs.un.org/goals/goal6#targets_and_indicators
- 640 10. Mikosch N, Berger M, Finkbeiner M. Addressing water quality in water footprinting: current status, methods and limitations. Int J
641 Life Cycle Assess. 2021;26(1):157–74.
- 642 11. Pradinaud C, Núñez M, Roux P, Junqua G, Rosenbaum RK. The issue of considering water quality in life cycle assessment of water
643 use. Int J Life Cycle Assess. 2019;24(3):590–603.
- 644 12. Fthenakis V, Kim HC. Life-cycle uses of water in U.S. electricity generation. Renew Sustain Energy Rev. 2010;14(7):2039–48.
- 645 13. Pfister S, Koehler A, Hellweg S. Assessing the environmental impacts of freshwater consumption in LCA. Environ Sci Technol.
646 2009;43(11):4098–104.
- 647 14. Larsen MAD, Petrovic S, Engström RE, Drews M, Liersch S, Karlsson KB, et al. Challenges of data availability: Analysing the water-
648 energy nexus in electricity generation. Energy Strateg Rev. 2019;26.
- 649 15. Simpson J, McConnell C, Matsuda Y. Economic Assessment of Carbon Capture and Storage Technologies. 2011.
- 650 16. Feng L, Zhai R, Guo Y. Water consumption of the integration of coal-fired power plant with CO₂ post combustion system with
651 different cooling methods. Int J Greenh Gas Control. 2022 Dec 1;121:103776.
- 652 17. Zhu Y, Chen M, Yang Q, Alshwaikh MJM, Zhou H, Li J, et al. Life cycle water consumption for oxyfuel combustion power generation
653 with carbon capture and storage. J Clean Prod. 2021;281.
- 654 18. Damania R, Desbureaux S, Rodella A-S, Russ J, Zaveri E. Quality Unknown The invisible Water Crisis. World Bank Publications, The
655 World Bank Group. Washington, DC; 2019.
- 656 19. Hoekstra AY, Chapagain AK, Aldaya MM, Mekonnen MM. The Water Footprint Assessment Manual. Setting the Global Standard.
657 Vol. 31, Social and Environmental Accountability Journal. 2011.
- 658 20. ISO 14046. ISO 14046 : 2014 Environmental management — Water footprint — Principles , requirements and guidelines.
659 International Organization for Standardization; 2014.
- 660 21. Bayart J-B, Bulle C, Deschênes L, Margni M, Pfister S, Vince F, et al. A framework for assessing off-stream freshwater use in LCA. Int
661 J Life Cycle Assess. 2010;15:439–53.

- 662 22. Boulay A, Bulle C, Deschênes L. LCA Characterisation of Freshwater Use on Human Health and through Compensation. *Toward Life*
663 *Cycle Sustain Manag.* 2011;(July).
- 664 23. Boulay AM, Bare J, Benini L, Berger M, Lathuilière MJ, Manzardo A, et al. The WULCA consensus characterization model for water
665 scarcity footprints: assessing impacts of water consumption based on available water remaining (AWARE). *Int J Life Cycle Assess.*
666 2018;23(2):368–78.
- 667 24. ISO 14046. A Practical Guide for SMEs ISO 14046 Environmental Management Water footprint. Switzerland; 2017.
- 668 25. Bayart JB, Worbe S, Grimaud J, Aoustin E. The Water Impact Index: A simplified single-indicator approach for water footprinting.
669 *Int J Life Cycle Assess.* 2014;19(6):1336–44.
- 670 26. Hoekstra AY. A critique on the water-scarcity weighted water footprint in LCA. *Ecol Indic.* 2016 Jul 1;66:564–73.
- 671 27. Chenoweth J, Hadjikakou M, Zoumides C. Quantifying the human impact on water resources: a critical review of the water
672 footprint concept. *Hydrol Earth Syst Sci.* 2014;18:2325–42.
- 673 28. Habib R. Life Cycle GHG Emissions and Water Consumption for a Hypothetical 400 MW Coal-Fired Power Plant in Western
674 Australia : Impacts of Carbon Capture and a Comparison of Two Prevailing Carbon Capture Technologies. 2017.
- 675 29. Rosa L, Reimer JA, Went MS, D’Odorico P. Hydrological limits to carbon capture and storage. *Nat Sustain.* 2020;3(8):658–66.
- 676 30. Berger M, Finkbeiner M. Methodological Challenges in Volumetric and Impact-Oriented Water Footprints. *J Ind Ecol.*
677 2013;17(1):79–89.
- 678 31. Pierrat É, Laurent A, Dorber M, Rygaard M, Verones F, Hauschild M. Advancing water footprint assessments: Combining the
679 impacts of water pollution and scarcity. *Sci Total Environ.* 2023;870:161910.
- 680 32. Carbon Dioxide Emissions From Electricity [Internet]. 2022. Available from: [https://world-nuclear.org/information-library/energy-](https://world-nuclear.org/information-library/energy-and-the-environment/carbon-dioxide-emissions-from-electricity.aspx)
681 [and-the-environment/carbon-dioxide-emissions-from-electricity.aspx](https://world-nuclear.org/information-library/energy-and-the-environment/carbon-dioxide-emissions-from-electricity.aspx)
- 682 33. Gerdes K, Nichols C. Water Requirements for Existing and Emerging Thermoelectric Plant Technologies. Vol. 2008, National Energy
683 Technology Laboratory DOE/NETL 402/080108. 2009.
- 684 34. Zhai H, Rubin ES. Performance and cost of wet and dry cooling systems for pulverized coal power plants with and without carbon
685 capture and storage. *Energy Policy.* 2010;38:5653–60.
- 686 35. Schmitt T, Leptinsky S, Turner M, Zoelle A, Woods M, Shultz T, et al. COST AND PERFORMANCE BASELINE FOR FOSSIL ENERGY
687 PLANTS VOLUME 1: BITUMINOUS COAL AND NATURAL GAS TO ELECTRICITY, Revision 4a. Vol. 1. Pittsburgh; 2022.
- 688 36. Luo T, Young R, Reig. P. Aqueduct Projected Water Stress Country Rankings. World Resources Institute. Washington, DC; 2015.
- 689 37. Luck M, Landis M, Gassert F. Aqueduct Water Stress Projections: Decadal Projections of Water Supply and Demand Using CMIP5
690 GCMs. Technical Note (Washington, DC: World Resources Institute). 2015.
- 691 38. Haslbeck JL, Zhang C, Brasington RD, Woods MC, Lewis EG, Black J, et al. Cost and Performance for Low-Rank Pulverized Coal
692 Oxycombustion Energy Plants. Technical Report. 2010.
- 693 39. Pradinaud C, Núñez M, Roux P, Junqua G, Rosenbaum RK. The issue of considering water quality in life cycle assessment of water
694 use. *Int J Life Cycle Assess.* 2019;24(3):590–603.
- 695 40. Matin NS, Flanagan WP. Life cycle assessment of amine-based versus ammonia-based post combustion CO₂ capture in coal-fired
696 power plants. *Int J Greenh Gas Control.* 2022;113:103535.
- 697 41. IEAGHG. Water Usage and Loss Analysis of Bituminous Coal Fired Power Plants, 2010 / 05. IEAGHG. 2011.
- 698 42. Van Der Spek M, Eldrup NH, Skagestad R, Ramirez A. Techno-economic Performance of State-of-the-Art Oxyfuel Technology for
699 Low-CO₂ Coal-fired Electricity Production. *Energy Procedia.* 2017;114(November 2016):6432–9.
- 700 43. Lohrmann A, Lohrmann C, Luukka P. Global and regional models for identification of cooling technology in thermal power
701 generation for water demand estimations in water-energy nexus studies. *J Clean Prod.* 2022 Dec 20;380:134842.
- 702 44. Fout T, Zoelle A, Keairns D, Turner M, Woods M, Kuehn N, et al. Cost and Performance Baseline for Fossil Energy Plants Volume 1a:
703 Bituminous Coal (PC) and Natural Gas to Electricity Revision 3. Vol. 1a, National Energy Technology Laboratory (NETL). 2015.
- 704 45. Fout T, Zoelle A, Keairns D, Turner M, Woods M, Kuehn N, et al. Cost and Performance Baseline for Fossil Energy Plants Volume 1b:
705 Bituminous Coal (IGCC) to Electricity Revision 2b – Year Dollar Update. Vol. 1b, National Energy Technology Laboratory (NETL).
706 2015.
- 707 46. Iyengar AKS, Newby RA, Keairns DL. Techno-Economic Analysis of integrated gasification fuel cell Systems. Vol. DOE/NETL-. 2014.
- 708 47. Iyengar AKS, Noring AA, Mackay JK, Keairns DL. Techno-economic analysis of natural gas fuel cell plant configurations. 2022.
- 709