

Energy Management in Prosumer Communities: A Coordinated Approach

Authors:

Rodrigo Verschae, Takekazu Kato, Takashi Matsuyama

Date Submitted: 2019-01-07

Keywords: demand response, demand-side management, smart community, prosumer community, cooperative distributed protocol, coordinated energy management

Abstract:

The introduction of uncontrollable renewable energy is having a positive impact on our health, the climate, and the economy, but it is also pushing the limits of the power system. The main reason for this is that, in any power system, the generation and consumption must match each other at all times. Thus, if we want to further introduce uncontrollable generation, we need a large ability to manage the demand. However, the ability to control the power consumption of existing demand management approaches is limited, and most of these approaches cannot contribute to the introduction of renewables, because they do not consider distributed uncontrolled consumption and generation in the control. Furthermore, these methods do not allow users to exchange or jointly manage their power generation and consumption. In this context, we propose an augmented energy management model for prosumers (i.e., producer and consumer). This model considers controlled and uncontrolled generation and consumption, as well as the prosumer's ability (i) to plan the intended power consumption; and (ii) to manage real-time deviations from the intended consumption. We apply this model to the energy management of prosumer communities, by allowing the prosumers to coordinate their power consumption plan, to manage the deviations from the intended consumption, and to help each other by compensating deviations. The proposed approach seeks to enhance the power system, and to enable a prosumer society that takes account social and environmental issues, as well as each prosumer's quality of life.

Record Type: Published Article

Submitted To: LAPSE (Living Archive for Process Systems Engineering)

Citation (overall record, always the latest version):

LAPSE:2019.0069

Citation (this specific file, latest version):

LAPSE:2019.0069-1

Citation (this specific file, this version):

LAPSE:2019.0069-1v1

DOI of Published Version: <https://doi.org/10.3390/en9070562>

License: Creative Commons Attribution 4.0 International (CC BY 4.0)

Article

Energy Management in Prosumer Communities: A Coordinated Approach

Rodrigo Verschae *, Takekazu Kato and Takashi Matsuyama

Graduate School of Informatics, Kyoto University, Yoshida-Honmachi, Sakyo-ku, Kyoto 606-8501, Japan; tkato@vision.kuee.kyoto-u.ac.jp (T.K.); tm@i.kyoto-u.ac.jp (T.M.)

* Correspondence: rodrigo@verschae.org; Tel.: +81-75-753-4891; Fax: +81-75-753-4769

Academic Editor: Mark Lemon

Received: 30 November 2015; Accepted: 27 June 2016; Published: 20 July 2016

Abstract: The introduction of uncontrollable renewable energy is having a positive impact on our health, the climate, and the economy, but it is also pushing the limits of the power system. The main reason for this is that, in any power system, the generation and consumption must match each other at all times. Thus, if we want to further introduce uncontrollable generation, we need a large ability to manage the demand. However, the ability to control the power consumption of existing demand management approaches is limited, and most of these approaches cannot contribute to the introduction of renewables, because they do not consider distributed uncontrolled consumption and generation in the control. Furthermore, these methods do not allow users to exchange or jointly manage their power generation and consumption. In this context, we propose an augmented energy management model for prosumers (i.e., producer and consumer). This model considers controlled and uncontrolled generation and consumption, as well as the prosumer's ability (i) to plan the intended power consumption; and (ii) to manage real-time deviations from the intended consumption. We apply this model to the energy management of prosumer communities, by allowing the prosumers to coordinate their power consumption plan, to manage the deviations from the intended consumption, and to help each other by compensating deviations. The proposed approach seeks to enhance the power system, and to enable a prosumer society that takes account social and environmental issues, as well as each prosumer's quality of life.

Keywords: coordinated energy management; cooperative distributed protocol; prosumer community; smart community; demand-side management; demand response

1. Introduction

The traditional power system is a uni-directional centralized system, where the generation is controlled and the demand is mostly uncontrolled. It assumes that a large demand is aggregated, so that consumption is made smoother, making the generation control easier, thus increasing stability and reliability.

During the last 30 years, information and communication technologies have been introduced in the generation, transmission and distribution systems of the power grid. These technologies are commonly known as the "smartgrid" and have been used to improve the power system's reliability. In recent years, advanced countries (e.g., Japan, USA, Germany [1]) have shifted their priorities: (i) to having a better management of the energy consumption; and (ii) to diversifying the generation mix, all these mainly due to environmental concerns and demographics changes (e.g., decrease in population size), or seeking to reduce cost and increase energy security [2]. As a result, these countries have implemented demand management programs to suppress energy usage (e.g., through power efficient appliances), and to reduce high consumption peaks (e.g., through the so-called demand respond programs).

An additional trend has been the recent rapid introduction of uncontrollable renewables (such as Photo-voltaic (PV) and wind). This is the result of (i) the lower cost of renewables and batteries; and (ii) government policies encouraging the installation of renewables (e.g., the feed-in tariff scheme). As a consequence, more consumers have installed their own generation, energy storage and energy management systems (EMS).

In addition to the energy management of individual users, the energy management of groups of users has been addressed through the so called demand response programs, programs that have been mainly used to increase stability and reduce cost. Although these programs have had a positive impact, their ability to control the power consumption is limited. These approaches usually only manage controllable devices, with uncontrolled consumption and generation not being explicitly considered. Therefore, they do not contribute much to the introduction of renewables. Furthermore, these approaches do not provide mechanisms for consumers and producers to exchange power or to jointly manage their generation and consumption. As a result, demand response cannot have a large positive impact on the power system.

In summary, we are observing a rapid introduction of distributed uncontrollable renewables and some advances in the ability to control the demand, in particular of individual users. The question becomes how to manage distributed controllable demand, while taking into account uncontrollable generation and uncontrolled consumption. This general question is the primary problem addressed in this paper.

In this context, each user should be considered as potential prosumer, i.e., a consumer and producer of energy, and therefore an energy management system for a society of prosumers is needed. From the social point-of-view, the introduction of such a system implies that a new market would emerge, where the users would be able: (i) to exchange energy and capacity; and (ii) to coordinate power consumption and generation, among others (e.g., to decide which energy they want to consume based on origin and source type). To implement such prosumer community, a new energy management approach is required.

Most existing demand management technologies have been developed from the generation-side's point-of-view and for the grid (thus the term "smart-grid"). However, such systems should be designed from the user's point-of-view, i.e., from the demand's point-of-view. Our work focuses on the latter direction, and to refer to our primary goal we use the term *energy management*, instead of "smart-grid".

When developing an energy management from the demand-side's point-of-view, it is natural to consider a decentralized management approach, in particular when each user is a potential prosumer. Thus, similar to information networks where small-scale local networks are inter-connected and form a bi-directional distributed network (the Internet) where two end-points can communicate, the energy management system needs to be distributed with all end-points having the ability to control their consumption and generation, and it needs to be bi-directional, with any two end-points being able to coordinate (or exchange) power consumption and generation [3].

Any energy management system, distributed or not, needs to consider the energy markets it interacts with. The structure of existing energy markets is basically the same across countries and regions: a *day-ahead* market seeks to determine (plan) the generation for the day –using economic and technical criteria–, while a *real-time* market seeks to minimize deviations from the intended generation (as defined in the day-ahead market). While large consumers take these markets into account in their energy management, energy management systems associated to small consumers commonly manage these markets independently (e.g., "day-ahead" through time-of-use (TOU) prices, and "real-time" through critical-peak-prices (CPP) or curtailment programs). To achieve an effective management, demand management systems need to take into account both markets, and in particular the day-ahead management needs to take into account the real-time management that will take place during the day.

Seeking to address the issues discussed above, in this work we augment the demand management proposed in [4,5] using the ideas on demand management introduced in [3] and the ideas on coordinated energy management of prosumer communities outlined in [6]. For this, we propose an augmented power consumption management model that considers uncontrolled power consumption and generation, day-ahead controllable power, and real-time controllable power. We then use this model in the coordination of prosumer communities taking into account: (i) uncontrolled consumption and generation (real-time and forecast); and (ii) power management ability (real-time and scheduled) to achieve an intended power consumption, both at the agent and community level.

Paper structure. We first present a preliminary discussion on energy management (Section 2), including a brief discussion on policies and markets (Section 2.1), an outline of energy management paradigms (Section 2.2), and a discussion on coordinated energy management (Sections 2.3 and 2.4). Afterwards (Section 3) we present the proposed augmented power consumption management model and (Section 4) we describe the use of the augmented model in the context of a community, in particular for day-ahead coordinated energy management. Finally, we illustrate and validate the proposed augmented coordinated energy management in simulation (Section 5), to later conclude (Section 6).

2. Preliminaries: Government Policies, Markets and Management Paradigms

2.1. Government Policies and Market Structure

Modeling energy systems requires the consideration of many issues, from technical and sustainability issues, to social and economical ones [7]. While these issues vary across countries, geographical locations and time, if we look at the big picture, the differences across countries are minor. In particular there are two key issues related to the introduction of uncontrollable generation and due to government policies trying to modify the generation mix and liberalize the energy market.

We will use the Japanese case to illustrate these issues. Let us first look at some context. From April 2016, Japan is continuing with a long process to deregulate its energy system and to change its energy mix. This process started several years ago, but it was disrupted and sped up after the earthquake and Fukushima-accident in 2011, in particular after all nuclear reactors were shut down. As a result two government policies were introduced to increase renewables and liberalize the retail market.

One such policy is the introduction of Fit-In-Tariff (FIT) programs [8], which in Japan and many countries seek to provide an incentive for the introduction of renewables. While this has promoted the installation of PVs, it has had two consequences. First, it is not clear what users will do after the FIT program period finishes (e.g., in the case of the 10-year program, small producers may not be able to inject power back to the grid). Second, some power systems started to apply restrictions to the further installation of uncontrollable renewables, due to their limited controllable generation capacity (such restrictions have been applied in Kyushu, Japan). These two problems may slow down the integration of renewables, but this could be alleviated with the help of advanced demand energy management systems.

A second policy that has taken place in many countries is the deregularization of the energy market. In the case of Japan, a liberalization process started several years ago and will go through an important change in 2016 [2,9,10], where the power and gas retail markets will be completely opened. In this power market, the retailers need to buy (in advance) power for every 30-min time slot, and later to manage, in real-time, deviations from the intended power consumption to avoid penalties. Thus, a retailer should have the ability to plan (day-ahead) the power usage, to update the plan (hour-ahead), and to manage controllable power (in real-time) under uncontrolled consumption and generation.

In this context we propose an augmented coordinated energy management system for prosumer communities that we think is of interest for Japan and others around the world, for instance

the European Union and New York where power generation and retail is already liberalized and where FIT programs have been used. Before going into the proposed augmented coordinated energy management system, in the remaining of the present section we give a brief discussion on existing energy management paradigms, and present the basic formulation of coordinated energy management.

2.2. Energy Management Paradigms

Supply Management. The conventional power system is designed based on three main assumptions [11–13]: (i) the generation is controllable; (ii) the demand is uncontrollable (but can be forecast); and (iii) the generated power is distributed from a central location to the consumers. Taking these into account, four *supply management* mechanisms are used to maintain stability and reduce economic cost: (i) unit commitment; (ii) economic dispatch; (iii) frequency restoration mechanism; and (iv) contingency reserves. *Unit-commitment* and *dispatch* are used for scheduling generation and for online control of generation, respectively, and they are managed by a system operator seeking to reduce total economic cost. *Frequency restoration* is required due to the difference between nominal demand and scheduled generation, while *contingency reserves* are required to respond when large loss of power supply occurs.

Demand Management. Given that power consumption depends on humans' living activities, in the supply management described above, the power consumption is not controlled. This can cause high consumption peaks, which requires expensive operational reserve just to supply enough power during those high peaks. Thus, demand management methods have been introduced: (i) to reduce peaks of very high demand (to reduce costs); and (ii) to avoid blackouts (in particular at times of energy scarcity).

2.2.1. Demand Management Strategies

Given that energy supports living and work activities, any demand management should: (i) fulfill the user's Quality of Life (QoL), and at least satisfy minimum QoL requirements (i.e., the user has a lower bound in the required energy); (ii) control the power consumption timing (rather than only reducing total consumption); and (iii) consider that part of the power consumption is uncontrollable due to the human living activities. In the context of this trade-off between QoL and power control, a question that rises is who implements the demand management. In that sense, demand management methods can be arranged in two broad categories: demand management from the *supply-side* and from the *demand-side*.

Demand Management from the Supply-Side

Methods in this category are commonly known as Demand Response (DR) [14–17] and used to avoid peaks of high demand (to reduce cost) and blackouts (due to consumption larger than available generation). To avoid confusion, we use the term "Demand Response" only to refer to methods that implement a *demand management from the supply-side*. DR approaches are centralized, where the supply-side manages the demand through an "aggregator" that sends a top-down control signal to the demand (see Figure 1a). The aggregator serves as an intermediary between generation and demand, by managing the demand to achieve an intended power consumption pattern.

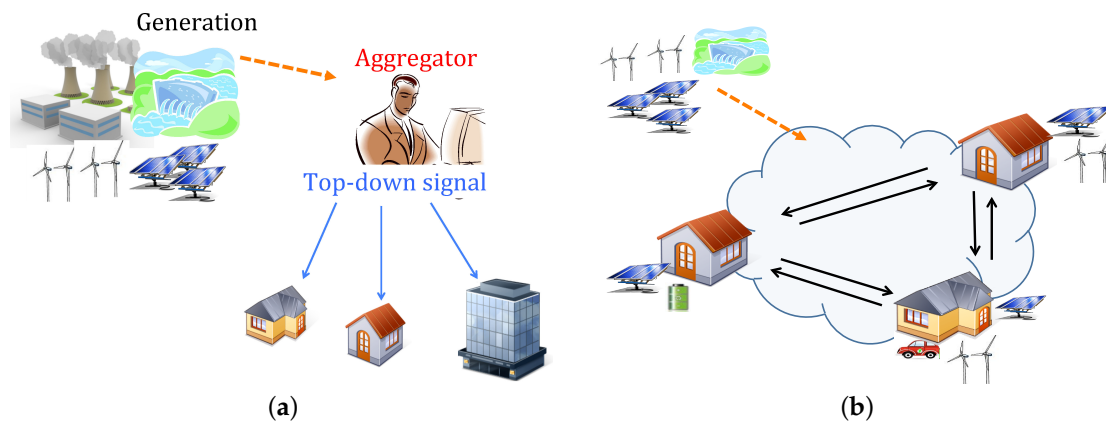


Figure 1. Demand management paradigms implementations: (a) demand management from the supply-side; and (b) demand management from the demand-side.

DR strategies can be grouped in two categories:

- *Event-based*: an aggregator remotely controls appliances (and the associated loss or gain in QoL), with the control taking place at particular events. Examples include direct load control, emergency programs, curtailment programs, and demand bidding programs.
- *Price-based*: an aggregator sends the same price-signal to all users, seeking to modify their consumption patterns. Based on the price signal, each user independently decides its power usage. Examples include time-of-use (TOU), critical-peak-pricing (CPP), and real-time-pricing (RTP).

Among all DR approaches, it has been argued [11] that (event-based) direct load control is the best alternative from the control point-of-view. However, it has the drawback of remotely controlling the appliances, making it difficult to manage QoL and to integrate uncontrollable distributed generation.

On the other hand, price-based DR allows each user to self manage his/her trade-off between QoL and cost, but the price-based top-down control (see Figures 1a and 2a) has limitations in the ability to control aggregated demands [11,18]. There are two main reasons for this. (i) Each user decides his/her power usage without communicating with the aggregator after receiving the price signal. Thus, it works as a *feed-forward control*; (ii) All users receive the same price signal, which may cause them to respond in a similar way (e.g., using power at the same time). Such a feed-forward control that uses the same price signal to control many users requires an accurate model of the users' behavior, model that is difficult to obtain due to the unpredictable nature of human living activities and to privacy issues.

To address these issues, variants of the basic price-based DR approach have been proposed: [19,20] proposed to measure response and to control demand with a (randomized) engineering signal rather than a market price, whereas [21,22] suggested to add constraints to the price based scheme. Dynamic pricing has been also proposed, but it can introduce instability and volatile prices and loads [23].

In summary, DR limitations include: (i) event-based methods cannot manage the consumption pattern without having an important impact on the users' QoL; and (ii) price-based methods cannot fully manage the consumption pattern. In addition, DR approaches cannot provide functionalities such as power exchange or coordination among users, nor handle distributed generation.

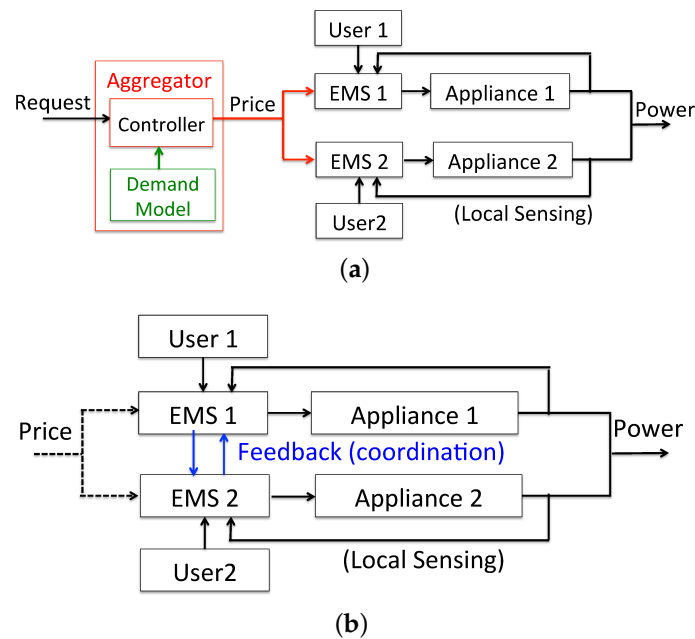


Figure 2. Control schemes. Example for two users, each one consisting of an energy management system (EMS) controlling a single appliance. (a) A *feed-forward* control is realized, with all users responding to the same price signal; (b) A *feedback* control is realized through the coordination (communication) among EMSs.

Demand Management from the Demand-Side

During the last few years, the distributed management of power usage has been proposed (see, e.g., [18,24–27]), where the users implement a distributed control and exchange information to achieve the energy management. In the literature, this kind of approach has been referred to as distributed DR [27] and coordinated DR [18]. These methods can be characterized as *demand management from the demand-side*.

While these methods have shown promising results, most of them address the same issues of demand response, but in a distributed manner. Some of the issues not addressed by these methods include:

- The energy management does not take QoL into account (e.g., in [28–30]): the formulations consider cost-based functions or assume linear / quadratic dynamic models of power usage.
- They do not consider a common goal for the group, but just the goal of each agent in the group.
- They consider not only the management of the demand, but also the management of the grid (transmission, distribution, and energy hubs). Whereas managing the grid is important, we think the energy management of the demand should be done independently of the underlying grid.

We think that a *demand management from the demand-side* approach should address the following challenges: manage the demand in a fully responsive fashion, allow adjusting the consumption pattern in a general way (e.g., to compensate fluctuating uncontrollable renewables), allow agents to manage their own QoL, and allow them to exchange or coordinate their consumption and generation. Existing methods do not address all of these challenges.

2.3. Coordinated Energy Management

Coordinated energy management was proposed in [5], extended in [4], and its concept described in [6]. It belongs to the *demand management from the demand-side* category, but differs from other methods in this category in the problem it tries to solve and in the management approach. In the

present section we will revisit its main ideas and basic formulation. In a nutshell, coordinated energy management seeks:

- To allow each agent to manage its QoL and associated power consumption and generation.
- To allow each user to be a prosumer (i.e., a producer and a consumer).
- To allow prosumers to form a community and jointly manage their power usage taking into account a common goal for the community (e.g., reduce cost, increase use of renewables, etc.)
- To achieve full responsiveness in energy management (e.g., that controllable consumption is able to match uncontrollable generation and consumption at all times, instead of just seeking to reduce economical cost, increase stability or respond to external requests).

This is achieved by enabling the users to communicate and coordinate their power consumption and generation. This communication implements a feedback control loop among EMS agents (see Figure 2b), which enables better responsiveness in the control (i.e., fast and predictable control).

To better illustrate coordinated energy management, in the following we will contrast it against *price-based* demand response, which is the most popular demand response program. We start by noting that price-based demand response can be understood as a best-effort of a group of independent users, while coordinated energy management implements a best-effort of the community (see Figure 2a,b).

2.3.1. Day-Ahead Power Consumption Coordination Formulation

Let us assume a community consisting of $N = |\mathcal{N}|$ agents, with each agent $i \in \mathcal{N}$ having an associated decision variable $x_i \in \mathbb{R}^T$ representing the power consumption profile of agent i , and T the number of time slots. The power used by agent i at time slot t , $x_{i,t}$, can be positive (consumption) or negative (generation). The power profile x_i is controlled by an energy management system (EMS), and we will refer to this EMS as *agent* (an appliance, household, factory, office, etc.).

To model the community, a cost function is associated to each agent, $f_i(x_i)$, and a global cost, $g(\sum_{i=1}^N x_i)$, is shared among all agents $i \in \mathcal{N}$. The cost function $f_i(x_i)$ of agent i can measure QoL, economic cost/benefit, and physical constraints associated x_i , while the cost function $g(\sum_{i \in \mathcal{N}} x_i)$ can measure economic cost/benefit, constraints, and flatness associated to the aggregated profile $\sum_{i \in \mathcal{N}} x_i$. Figure 3a presents a scheme of the coordination and the involved functions, and Figure 3b illustrates the profile-based cost functions (see [5] for agent cost functions and examples).

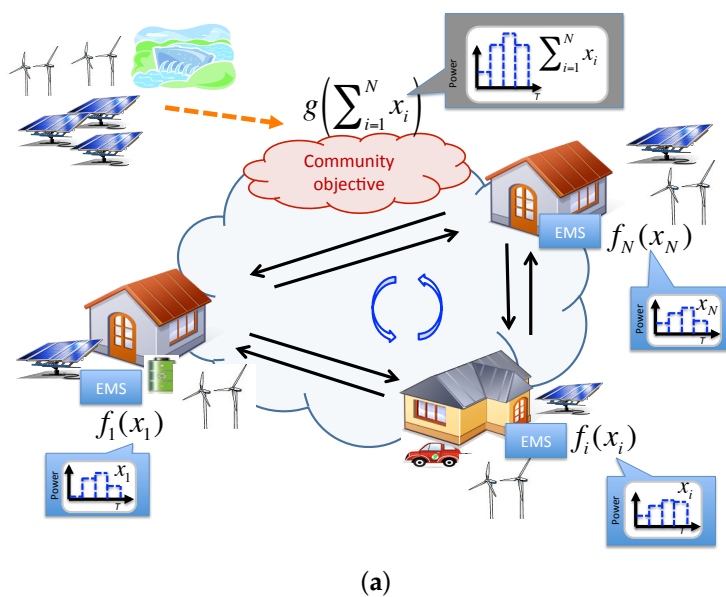


Figure 3. Cont.

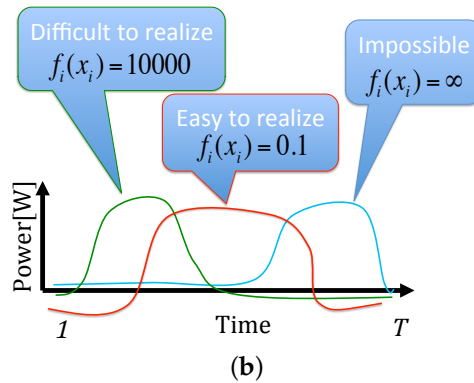


Figure 3. Prosumer community coordination. (a) Prosumer community and the associated community cost $g(\sum_{i=1}^N x_i)$ and agent cost $f_i(x_i)$. The coordinated variable x_i represents the power consumption of agent i ; (b) The agent’s cost function $f_i(x_i)$ measures the difficulty to achieve x_i , which can be associated to quality of life (QoL), physical constraints and economic cost.

To coordinate the power usage taking into account the agents’ and the global cost functions, the community solves the following optimization problem (known as the sharing problem):

$$\underset{(x_i)_{i \in \mathcal{N}}}{\text{minimize}} \sum_{i \in \mathcal{N}} f_i(x_i) + g\left(\sum_{i \in \mathcal{N}} x_i\right) \tag{P1}$$

with $x_i \in \mathbb{R}^T \forall i \in \mathcal{N}$ the decision variables. Note that the power price is not a decision variable.

2.3.2. Distributed Coordination Protocol

To solve problem (P1), the protocol introduced in [5] is used (extensions of this protocol have been presented in [4,31,32]). This protocol is based on the Alternating Direction Method of Multipliers (ADMM) [33], and it iteratively solves Problem (P1):

$$\begin{aligned} x_i^{k+1} &:= \arg \min_{x_i} f_i(x_i) + \frac{\rho}{2} \|x_i - x_i^k + b^k\|_2^2, \forall i \in \mathcal{N} \\ \text{with } b^k &:= \bar{x}^k - \bar{z}^k + \bar{v}^k \\ \bar{z}^{k+1} &:= \arg \min_{\bar{z}} g(N\bar{z}) + \frac{N\rho}{2} \|\bar{z} - \bar{x}^{k+1} - \bar{v}^k\|_2^2 \\ \bar{v}^{k+1} &:= \bar{v}^k + \bar{x}^{k+1} - \bar{z}^{k+1} \end{aligned} \tag{1}$$

with iteration index k , and where $\bar{v} \in \mathbb{R}^T$ is a vector of Lagrange multipliers [34], $\rho > 0$ a constant. Here we have used the notation \bar{a} to refer to the average of a set of variables $\{a_i\}_{i \in \mathcal{N}}$ (i.e., $\bar{a} = \frac{1}{N} \sum_{i \in \mathcal{N}} a_i$). This algorithm yields convergence without assumptions such as strict convexity of f_i and g [33].

The iterative algorithm in Equation (1) allows a distributed negotiation (see Figure 4b): The first step in Equation (1) is solved concurrently by each agent (agent i only needs to know b^k), while the second and third steps are evaluated by a coordinator, which aggregates $\{x_i^{k+1}\}_i$, to later calculate \bar{x}^{k+1} , \bar{z}^{k+1} and \bar{v}^{k+1} , and finally broadcast b^{k+1} to all agents. Thus, to take part of the coordination, agent i needs to solve the problem $\text{prox}_{f_i/\rho}(v) = \arg \min_x f_i(x) + \frac{\rho}{2} \|x - v\|_2^2$, i.e., to implement a proximal operator [35,36], while the coordinator has to implement a proximal operator and a linear update. The broadcast variable b^k guides the coordination and measures the gap between \bar{x}^k and \bar{z}^k plus the scaled Lagrange multipliers \bar{v}^k . After convergence $\bar{x}^K = \bar{z}^K$, and the equality $b^K = \bar{v}^K$ is fulfilled, values that can be interpreted as clearing prices of an exchange market [33]. Thus, the coordination determines the optimal power consumption and the clearing prices.

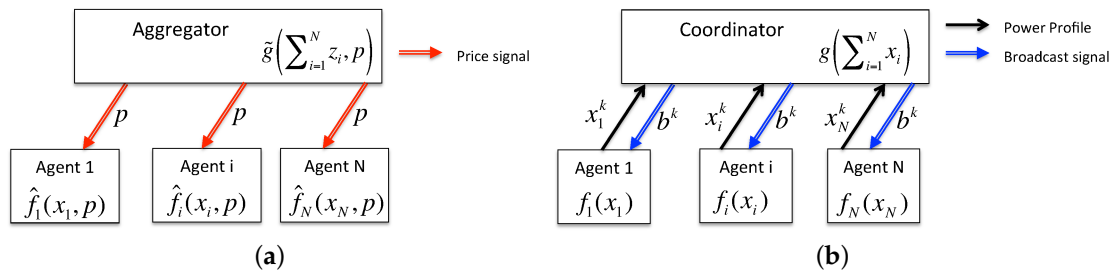


Figure 4. Management architectures. (a) In price-based demand response (DR) the aggregator determines the price signal and then each agent independently determines its power usage; (b) In coordinated energy management, the agents, with the help of a coordinator, iteratively minimize the community objective and each agent’s objective.

This protocol is a power profile-based, with the profiles x_i^k communicated (negotiated) by the agents via the coordinator, and it differs largely from existing methods. In event-based DR methods (e.g., direct load control) the appliances’ control variables (device starting time, A/C set point, etc.) are managed by an aggregator, while in the case of price-based DR, the control is done through price-signals.

2.4. Illustrative Example

We illustrate the basic coordination approach in a day-ahead planning scenario, where N agents, each consisting of a single appliance balance their power consumption. In this setting, $x_i \in \mathbb{R}^T$ corresponds to the power consumption profile of agent i , with $T = 144$ the number of time slots (10-min per time slot; for a total duration of 24 h), and $x_{i,t}$ the power used by agent i at time slot t . The results are presented for coordinated energy management and compared with a Time-of-Use (TOU) price-based DR.

2.4.1. Coordinated Energy Management

We assume the community seeks to flatten the aggregated power profile $v = \sum_i x_i$, with shared cost given by $g(v) = \beta \|v\|_2^2$, with $\beta = 2 \times 10^{-6}$ (note that other cost functions are possible: to match a predefined consumption profile, to minimize peak consumption, etc. [4,5]). For the agents, we consider a simplified model to illustrate the benefits of the coordination (see [5] for a generative probabilistic model of agents/appliances that can be built using machine learning methods). The dissatisfaction of agent i for selecting a profile x_i is measured by:

$$f_i(x_i) = \min_{t_i \in \mathbb{U}_i} \|t_i - t_i^0\|_2^2 / \sigma_i^2 + \Pi[x_i = \psi_i(t_i)], \text{ with } \Pi[v] = \begin{cases} 0 & \text{if } v \text{ is true} \\ +\infty & \text{otherwise} \end{cases} \quad (2)$$

where t_i^0 is agent’s i preferred power usage starting time, σ_i a measure of agent’s i starting time flexibility (large σ_i implies larger flexibility), and $\{\psi_i(t_i)\}_{t_i \in \mathbb{U}_i}$ the set of allowed profiles. In the experiments, the agents have a preferred starting time t_i^0 uniformly distributed in [50,75].

Second, each agent can have a load that can only be shifted, with profiles of the form (in $\{\psi_i(t_i)\}_{t_i \in \mathbb{U}_i}$):

$$x_i = (\underbrace{0, \dots, 0}_{t_i}, \underbrace{1000, \dots, 1000}_{T_d}, \underbrace{0, \dots, 0}_{t_i^r}), \text{ with } t_i + T_d + t_i^r = T \quad (3)$$

and $T_d = 18$ the consumption duration, t_i the starting time (control variable), and t_i^r the remaining time.

2.4.2. Price-Based Demand Response

We implement a simple price-based demand response in a framework similar to coordinated energy management. We note that most price-based demand response programs can be formulated as a two-step process (see Figures 1a and 4a). First, an aggregator determines the price signal using an approximated model of the aggregated demand. Second, each user independently realizes its power usage taking into account the received price signal, but without communicating again with the aggregator nor with other users. This two-step process can be formalized as the following optimization problem:

$$\begin{aligned} \bar{y}, p^* &= \underset{\bar{y}, p}{\operatorname{argmin}} \tilde{g}(N\bar{y}, p) \\ x_i^* &= \underset{x_i}{\operatorname{argmin}} \hat{f}_i(x_i, p^*) \quad \forall i \in \mathcal{N} \end{aligned} \quad (\text{P2})$$

The function $\tilde{g}(N\bar{y}, p)$ is minimized by the aggregator and depends on the energy price p that the agents pay, and the average power profile $\bar{y} \in \mathbb{R}^T$. We can think of p as price vector of the same dimension T as \bar{y} . The function $\hat{f}_i(x_i, p)$, minimized by agent i , measures the cost of agent i for selecting a profile x_i given the energy price p . Given that we do not have a model of \tilde{g} , we evaluate the response of users to various price signals p (instead of estimating the optimal price, which by itself is a difficult problem). The cost of agent i is given by $\hat{f}_i(x_i, p) = f_i(x_i) + \|x_i\|_{W_p}^2$, with $W_p = \operatorname{diagonal}(p)$ and $p \in \mathbb{R}^T$ a price vector, and agent i independently solves its optimization problem (second equation in Problem (P2)).

2.4.3. Results and Discussion

We consider the case of $N = 40$ agents, with $\sigma_i = 3$ for all agents, and analyze the obtained aggregated profiles. In Figure 5a, we can observe the profiles obtained for demand response with a price signal of the form $p(\alpha) = (1, \dots, 1, \alpha, \dots, \alpha, 1, \dots, 1)$, for $\alpha \in \{1, 1.2, \dots, 2.2\}$, while in Figure 5b we can observe the power profiles obtained by the coordinated energy management during the iterations of a single negotiation process. The best case of price-based DR obtained a peak consumption about 6 kW (for $\alpha = 1.6$), while coordination obtains a peak consumption of about 3 kW after 100 iterations (we use a value $\rho = 0.1 \times 10^{-6}$ to control the convergence speed of the iterative algorithm). Also, price-based DR generates an aggregated profile that is always in the range $[50, 96]$, while in the case of coordination the load is spread over the range $[40, 110]$. Hence, in this example, coordinated energy management performs a better control, almost halving the maximum peak and flattening the profile over a wider range.

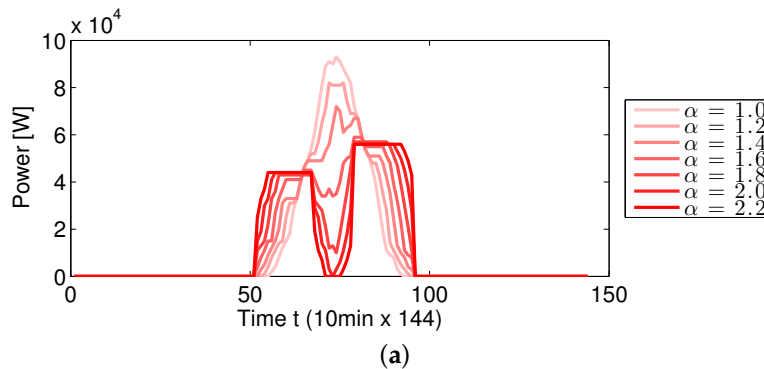


Figure 5. Cont.

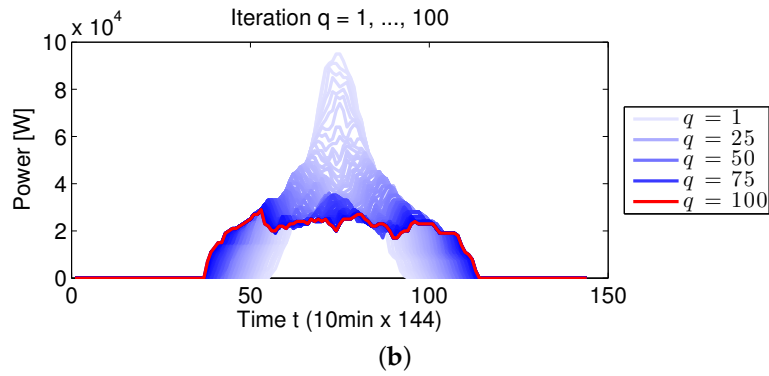


Figure 5. Aggregated profiles. (a) Obtained power profiles for various DR price signals; (b) Evolution of the aggregated coordination profiles. Note that the best case of price-based DR has a peak consumption of 6 kW, while for coordination the peak consumption is 3 kW.

We note that we have used a very simple price-based DR with a flat critical peak price being applied for a continuous period of time (a critical peak price (CPP)). Using price signals that are not flat can improve the results for DR [6], but the coordination still obtains better results. Thus, DR requires finding an appropriated price signal or using additional mechanisms (see also the discussion variants of the basic price-based DR in Section 2.2.1). This illustrates that determining the optimal price signal is one of the main difficulties of price-based DR, because it requires having an accurate model of the agent’s response to price signals. On the other hand, coordinated energy management does not use a price-based control, and therefore does not requires a model of the agent’s response to price signals, but instead the agents use a power-profile based coordination to determine their power consumption.

3. Augmented Prosumer Management Model

As discussed, we need an energy management system that considers each user as a potential *prosumer*, and not just as a *consumer*, and for this we need a prosumer management model. To model a prosumer, we assume she has controlled and uncontrolled appliances, possibly having storage capacity (e.g., a battery), and (un)controlled generation (e.g., PV), as shown in Figure 6. Such prosumer can share part of her controlled and uncontrolled power resources if part of a community.

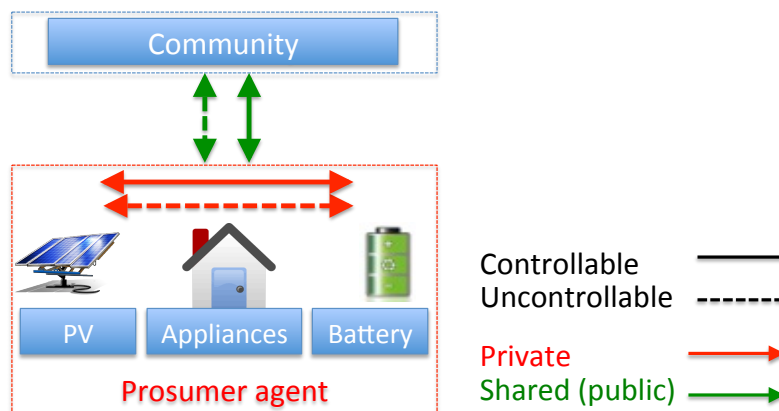


Figure 6. A *prosumer* agent has uncontrolled and controlled power resources (storage, generation, appliances, etc.), and part of the resources can be *shared* with the community.

In this context, a prosumer *agent* (we will the term *agent* to refer to the energy management system used by the prosumer) has two primary goals: (i) To plan *off-line* (in advance) the intended power consumption. (ii) To achieve in *real-time* the intended power consumption. A third goal, not considered in the current paper, consists of updating the power consumption plan. The off-line and real-time management goals are intrinsic to most energy markets: there are costs due to the intended power consumption and due to deviations from the intended consumption. At the retailer/utility level, these costs are managed in separate programs and for a group of users (e.g., TOU and CPP for day-ahead and real-time managements), but they should be managed at the prosumer level in an integrated manner.

Due to the nature of human living activities and to external conditions (e.g., weather), occasionally, an agent will not be able to achieve its intended power consumption. But, if the prosumer belongs to a community, the agents in the community can help each other by compensating (counterbalancing) each other’s deviations. In the following we present an augmented model for such prosumer.

3.1. Augmented Prosumer Model

We consider three aspects to model the power consumption (and generation) of a prosumer agent: (i) controlled/uncontrolled; (ii) off-line/real-time; and (iii) shared/private resources. Based on these three aspects, we decompose the power consumption in 8 components, as presented in Figure 7. The top/bottom of the figure indicates off-line / real-time consumption. The left-/right side indicates controllable/uncontrollable resources. Shared/private resources are shown in the outer/inner parts of the diagram. Note that here off-line refers to an energy management that is done in advance: week-ahead, day-ahead, hour-ahead, etc.

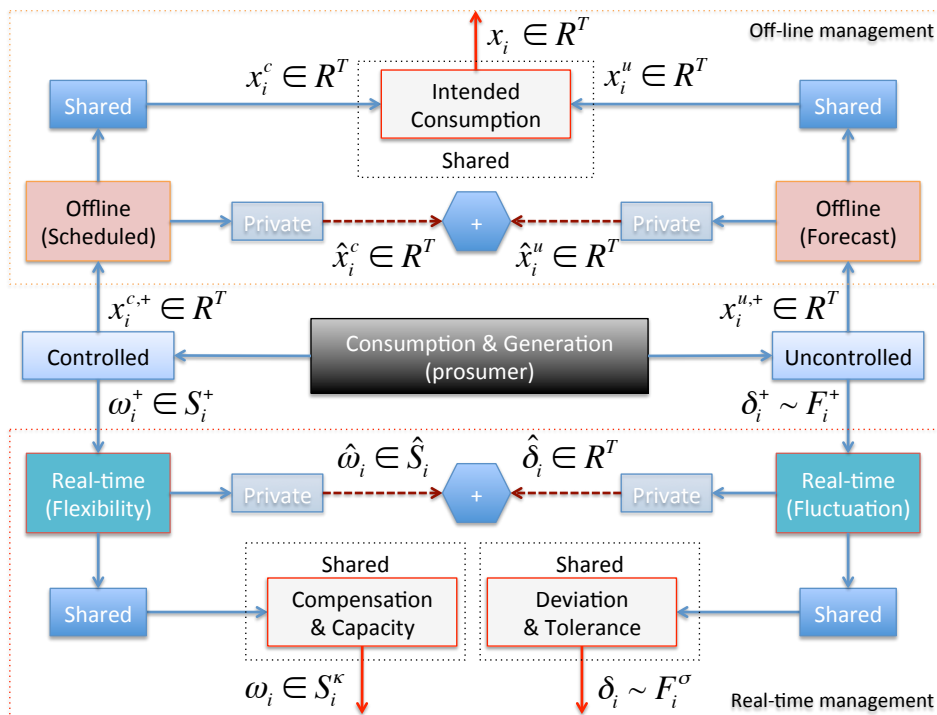


Figure 7. Augmented prosumer model. The power consumption is decomposed based on three aspects: controlled/uncontrolled, off-line/real-time, and shared/private resources, giving a total of eight components. In total, three components are shared (shown in red boxes/arrows) and can be jointly managed with the community: the intended power consumption x_i , the deviation $\delta_i \sim F_i^\sigma$, and the compensation $\omega_i \in S_i^\kappa$. See main text for details.

3.1.1. Power Consumption Decomposition

The power consumption of agent i is decomposed in controlled and uncontrolled components.
 (i) The controlled component is given by $x_i^{c,+} + \omega_i^+ \in \mathbb{R}^T$, and it is further decomposed in off-line controllable power $x_i^{c,+} = x_i^c + \hat{x}_i^c$, and real-time controllable power ω_i^+ (*flexibility*);
 (ii) The uncontrolled component is given by $x_i^{u,+} + \delta_i^+ \in \mathbb{R}^T$, and it is further decomposed in off-line uncontrolled power $x_i^{u,+} = x_i^u + \hat{x}_i^u$, and real-time uncontrolled power δ_i^+ (*fluctuation*). The private off-line components add to zero ($\hat{x}_i^c + \hat{x}_i^u = 0$), and they are not considered in the following. The private real-time components (controlled and uncontrolled) add to zero ($\hat{\omega}_i + \hat{\delta}_i = 0$), and we will use this relation to manage part of the fluctuation.

The real-time controllable power is decomposed as $\omega_i^+ = \omega_i + \hat{\omega}_i$ with $\omega_i^+ \in S_i^+$, where the set S_i^+ represents the degree of control of ω_i^+ , and where $\omega_i \in S_i^K$ is the shared real-time controllable power (the *compensation*) and $\hat{\omega}_i \in \hat{S}_i^K$ is the private real-time controllable power. The relation between the sets is given by $S_i^+ = S_i^K \oplus \hat{S}_i^K$, with \oplus the Minkowski sum, and where we call S_i^K the *capacity* (set). We recall that the Minkowski sum of the sets S_i and S_j is given by $S_i \oplus S_j = \{a + b \mid a \in S_i, b \in S_j\}$, and it is also known as the sumset.

The real-time uncontrolled power is decomposed as $\delta_i^+ = \delta_i + \hat{\delta}_i$, with $\delta_i^+ \sim F_i^+$, where the function F_i^+ represents the degree of fluctuation of δ_i^+ (we take F_i^+ as the probability density function associated to δ_i^+ or as an indicator function of the values δ_i^+ can take), and where $\delta_i \sim F_i^\sigma$ is the shared real-time uncontrollable power (the *deviation*) and $\hat{\delta}_i \sim \hat{F}_i^\sigma$ is the real-time uncontrollable power. We call F_i^σ the *tolerance* (set). The relation between these functions is given by $F_i^+ = F_i^\sigma * \hat{F}_i^\sigma$, with $*$ being the convolution operation. We note that the Minkowski sum and the convolution operator are related: the support of the convolution of two indicator functions can be expressed as the Minkowski sum of the support of the indicator functions.

The controlled resources are used for three purposes: (i) to schedule consumption (off-line), represented by x_i^c ; (ii) to minimize deviations from the plan (in real-time), represented by $\hat{\omega}_i$; and (iii) to compensate deviations of other agents (in real-time), represented by ω_i . On the other hand, the uncontrolled part of the power consumption is decomposed in three parts: (i) power consumption forecast (off-line), represented by x_i^u ; (ii) private fluctuation eliminated by the agent, represented by $\hat{\delta}_i$; and (iii) deviation from the intended power consumption, represented by δ_i .

3.1.2. Shared Power Resources

Agent i can share three resources: its *intended consumption*, its *deviation* and its *compensation* (see Figure 7). While the *intended consumption* is managed off-line, the *deviation* and *compensation* are managed in real-time. However, an off-line management should consider what *deviations* may be observed in real-time, and what is the available *compensation* ability. For this the *tolerance* and *capacity* are also shared. The shared resources are:

- *Intended consumption.* It is given by $x_i = x_i^c + x_i^u \in \mathbb{R}^T$, with x_i^c the shared scheduled power and x_i^u the shared forecast power (x_i^u may include expected PV generation, A/C consumption, etc.).
- *Compensation and capacity.* The *compensation* is given by $\omega_i \in S_i^K$ and represents the shared real-time controllable power. The set S_i^K represents the *capacity* to control power consumption in real-time. We use the term *capacity* to refer to the maximum ability to control the power consumption. Examples include controlling a battery, a lighting (by changing the illumination level), and an A/C (by changing the temperature set-point). Thus, agent i plans the set S_i^K off-line and controls $\omega_i \in S_i^K$ in real-time.
- *Deviation and tolerance.* The *deviation* $\delta_i \sim F_i^\sigma$ can be derived from $\hat{\delta}_i^+ = \delta_i + \hat{\delta}_i$ and $\hat{\omega}_i = -\hat{\delta}_i$, obtaining: $\delta_i = \hat{\delta}_i^+ - \hat{\omega}_i$. Thus, the amount of shared deviation δ_i depends on the fluctuation and it is managed using the private real-time controllable power $\hat{\omega}_i$. The function F_i^σ represents the *tolerance* for the deviation δ_i and it can be modeled using a probability density function or an indicator function of the values that δ_i may take (we give an example of this later).

An agent that acts independently (not in a community) minimizes its deviations ($\delta_i \approx 0$) and does not provide compensation ($\omega_i = 0$). However, such agent cannot eliminate all deviations unless it has a large ability to control its power consumption. On the contrary, if the agent is part of a community, it can receive help from others to minimize its deviation, and it can help others to compensate their deviations. Thus, an agent can manage its *intended consumption* x_i , *compensation* ω_i , *capacity* S_i^k , *deviation* δ_i , and *tolerance* F_i^σ , for its own benefit, while also receiving help from the community and contributing to it.

3.2. Augmented Device Model

A prosumer agent consists of one or more devices (appliances, storage, generation, etc.), so we need to integrate these devices in the prosumer model. To do this, we first make an augmented model for each device. Once we have the power decomposition model for each device $p = 1, \dots, P$: $x_i^p, \omega_i^p \in S_i^p, \hat{\omega}_i^p \in \hat{S}_i^p, \delta_i^p \sim F_i^p$ and $\hat{\delta}_i^p \sim \hat{F}_i^p$, the corresponding components are aggregated:

- *Intended consumption*: $\sum_{p=1}^P x_i^p$, with $x_i^p \in \mathbb{R}^T$ the intended consumption of device p .
- *Compensation* (shared and private) $\omega_i = \sum_{p=1}^P \omega_i^p$ and $\hat{\omega}_i = \sum_{p=1}^P \hat{\omega}_i^p$, and *capacity* (shared and private) $S_i = S_i^1 \oplus \dots \oplus S_i^P$ and $\hat{S}_i = \hat{S}_i^1 \oplus \dots \oplus \hat{S}_i^P$.
- *Deviation* (shared and private) $\delta_i = \sum_{p=1}^P \delta_i^p$ and $\hat{\delta}_i = \sum_{p=1}^P \hat{\delta}_i^p$, and *tolerance* (shared and private) $F_i = F_i^1 * \dots * S_i^P$ and $\hat{F}_i = \hat{F}_i^1 * \dots * \hat{F}_i^P$.

Thus, the capacity and tolerance sets are aggregated using the Minkowski sum or the convolution operator.

This is illustrated in Figure 8 for the shared components.

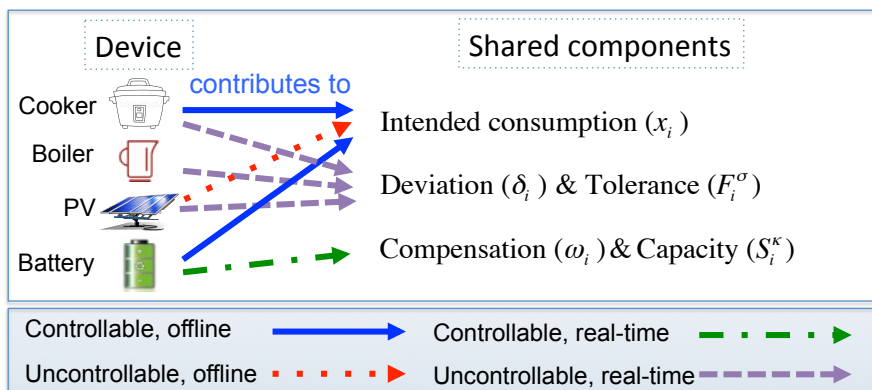


Figure 8. Device aggregation example. A rice cooker can be scheduled (contributes to the intended consumption) or used on-demand (contributes to the deviation). A battery can flatten the intended consumption and provide capacity for compensation. Devices can also contribute to private components (not shown in the figure).

To build each device’s model we require knowledge about the device: for controllable devices we need a control model and/or sensed data, and for uncontrolled devices we can use historical sensed data. The parameters of such models can be learned using machine learning or statistical learning methods.

4. Augmented Coordinated Energy Management in Prosumer Communities

We assume a community of $N = |\mathcal{N}|$ agents, where agent $i \in \mathcal{N}$ has the ability to manage its power consumption using the augmented model presented in the previous section. The question is how to use this model to manage the intended power consumption, the deviation and the compensation at the community level. This is done with the help of a coordinator, as illustrated

in Figure 9. Each agent coordinates, off-line, the intended power consumption $x_i \in \mathbb{R}^T$, the capacity (set) S_i^κ , and the tolerance F_i^σ , while the deviation $\delta_i \sim F_i^\sigma$ and the compensation $\omega_i \in S_i^\kappa$ are managed in real-time.

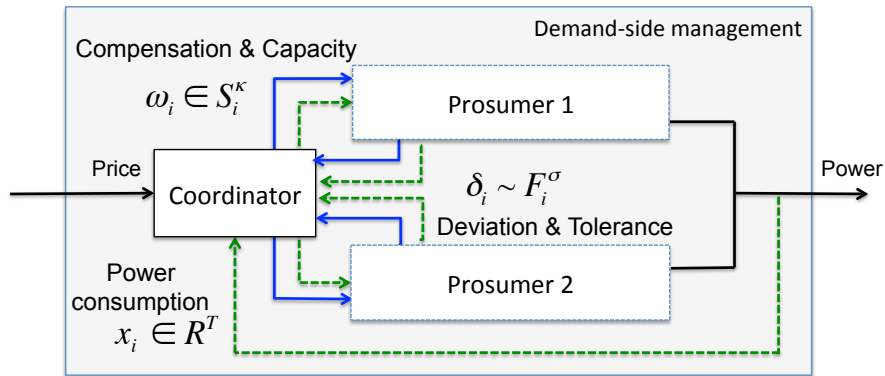


Figure 9. Prosumer community coordination scheme (example for two prosumers). The prosumers coordinate off-line and real-time control variables via a coordinator. The dotted green lines indicate off-line management: power consumption x_i , capacity S_i^κ , tolerance F_i^σ . The solid blue lines indicate real-time management: compensation ω_i and deviation δ_i .

During the real-time management, the community minimizes the deviation $\Delta = \sum_i \delta_i$ using the community compensation $\Omega = \sum_i \omega_i$ such that the deviation is compensated $\Delta + \Omega = \sum_i (\delta_i + \omega_i) \approx 0$, with each agent minimizing δ_i while fulfilling that $\delta_i \sim F_i^\sigma$ or $\delta_i \in \text{supp}(F_i^\sigma)$.

In the off-line management the community manages its intended consumption $x = \sum_i x_i$, its capacity Ψ^κ and tolerance Σ^σ , with its capacity given by $\Psi^\kappa = S_1^\kappa \oplus \dots \oplus S_N^\kappa$, and its tolerance given by $\Sigma^\sigma = F_1^\sigma * \dots * F_N^\sigma$. To achieve the real-time compensation of deviation ($\Omega + \Delta \approx 0$), the community needs enough capacity to compensate the deviations ($\text{supp}(\Sigma^\sigma) \subset \Psi^\kappa$), which could be ensured off-line.

4.1. Augmented Day-Ahead Coordination

In the off-line management, the community coordinates its intended consumption $x = \sum_i x_i$, capacity Σ^σ and tolerance Ψ^κ . To do this, we parametrize the capacity and tolerance of each agent i as $S_i^\kappa = S_i^\kappa(\kappa_i)$ and $F_i^\sigma = F_i^\sigma(\sigma_i)$, with $\kappa_i, \sigma_i \in \mathbb{R}^T$. Furthermore, we only allow a symmetric capacity set $S_i^\kappa(\kappa_i)$ and a symmetric tolerance $F_i^\sigma(\sigma_i)$ (private sets/functions do not need to be symmetric). The set S_i^κ is symmetric if $\forall \omega_i \in S_i^\kappa$, with $\omega_i = (\omega_{i,1}, \dots, \omega_{i,t}, \dots, \omega_{i,T})$, we have that $(\omega_{i,1}, \dots, -\omega_{i,t}, \dots, \omega_{i,T}) \in S_i^\kappa$. Then, we can write the community capacity as $\Psi(\kappa) = S_1^\kappa \oplus \dots \oplus S_N^\kappa$ with $\kappa = \sum_i \kappa_i$, and the community tolerance as $\Sigma(\sigma) = F_1^\sigma * \dots * F_N^\sigma$ with $\sigma = \sum_i \sigma_i$.

Then, we can formulate the augmented day-ahead coordination as a *sharing problem* (similar to Problem (P1)):

$$(x_i^*, \sigma_i^*, \kappa_i^*)_{i \in \mathcal{N}} = \arg \min_{(x_i, \sigma_i, \kappa_i)_{i \in \mathcal{N}}} \sum_{i \in \mathcal{N}} f_i(x_i, \sigma_i, \kappa_i) + g(\sum_{i \in \mathcal{N}} x_i, \sum_{i \in \mathcal{N}} \sigma_i, \sum_{i \in \mathcal{N}} \kappa_i) \quad (\text{P3})$$

where $f_i(x_i, \sigma_i, \kappa_i)$ is the cost of the agent $i \in \mathcal{N}$, with $x_i, \sigma_i, \kappa_i \in \mathbb{R}_+^T$ the decision variables of agent i , and $g(x, \sigma, \kappa)$ is the cost shared among all agents $i \in \mathcal{N}$. This optimization problem can be solved using the ADMM-based algorithm in Equation (1) and the distributed implementation in Figure 4b by simply concatenating the profiles x_i, σ_i, κ_i , and defining the concatenated broadcast signal.

Agent cost

The cost function of agent i , with $u_i \in \mathcal{U}_i$ the device control variable, is formulated as:

$$f_i(x_i, \sigma_i, \kappa_i) = \min_{u_i \in \mathcal{U}_i} f_i^u(u_i) + f_i^{x|u}(x_i, u_i) + f_i^{\sigma, \kappa|u}(\sigma_i, \kappa_i, u_i) + f_i^x(x_i) + f_i^\sigma(\sigma_i) + f_i^\kappa(\kappa_i) \quad (4)$$

The first three components of Equation (4) depend on the control signal u_i :

- $f_i^u(u_i)$ can measure loss in QoL associated to the device operation mode (due to control signal u_i),
- $f_i^{x|u}(x_i, u_i)$ can represent soft-constraints (e.g. encode achievable profiles x_i due to control u_i),
- $f_i^{\sigma, \kappa|u}(\sigma_i, \kappa_i, u_i)$: can measure the agent's ability to control deviation,

where the control variable u_i may include appliance mode control, battery charge/discharge control, generation control, etc. The last three components in Equation (4) can be associated to:

- $f_i^x(x_i)$: economical cost of profile x_i ,
- $f_i^\sigma(\sigma_i)$: penalty of deviating from the power profile plan, and
- $f_i^\kappa(\kappa_i)$: benefit of reserving capacity for the community.

Community cost

Given $x = \sum_{i \in \mathcal{N}} x_i$, $\sigma = \sum_{i \in \mathcal{N}} \sigma_i$ and $\kappa = \sum_{i \in \mathcal{N}} \kappa_i$ (the community's aggregated power, deviation and capacity, respectively), the shared cost function for a community is defined as:

$$g(x, \sigma, \kappa) = g^x(x) + g^{\sigma, \kappa}(\sigma, \kappa) \quad (5)$$

where the components of g can measure:

- $g^x(x)$: the cost associated to the intended community aggregated power consumption x , and
- $g^{\sigma, \kappa}(\sigma, \kappa)$: the degree of capacity relative to tolerance, where ideally, the community capacity should be able manage any tolerance: i.e. $\text{supp}(\Sigma(\sigma)) \subset \text{supp}(\Omega(\kappa))$.

4.2. Augmented Real-Time Coordination

We outline a possible protocol for the real-time coordination: every time an agent i cannot follow its intended consumption profile ($\delta_{i,t} \neq 0$), it sends a request to the *coordinator* indicating its corresponding deviation $\delta_{i,t}$. Once the *coordinator* has received agent's i deviation, as well as other agent's deviations, the community compensates the aggregated community deviation. The compensation applied by each agent j to compensate the deviation $\sum_i \delta_{i,t}$ is determined by the coordinator. A simple compensation management consists of a proportional control: $\omega_{j,t} = \sum_i \delta_{i,t} \frac{\kappa_{j,t}}{\sum_j \kappa_{j,t}}$. i.e., using reserved capacity the deviation can be compensated. The details of such control are out-of-scope of the present article.

5. Simulation Results

We consider two scenarios. The first scenario seeks to illustrate the augmented agent model and the augmented day-ahead coordination. The second scenario seeks to validate the augmented coordination using actual power consumption data. In both scenarios batteries provide off-line and real-time control.

5.1. Augmented Agent and Coordination Example (Scenario 1)

We consider an scenario where a community of $N = 40$ *prosumer* agents coordinate their power usage, with each agent having three devices: an appliance a that can be scheduled, a battery b that can be controlled, and uncontrolled PV g . This augmented agent model is based on the agent in Section 2.3, but we have added a battery and PV generation. This scenario illustrates

how the augmented agent model is built and provides example results for the off-line (day-ahead) coordination.

5.1.1. Device Models

Appliance

We consider a controllable appliance a , with a power profile $x_i^a = \psi_i(\tau_i)$, where $\tau_i \in \Theta_i$ is the control variable representing the starting time (it is the same model used in Section 3.2; see Equation (3), etc.). We assume that once the appliance a has been scheduled, its power consumption x_i^a does not change. Thus, this device does not contribute deviation nor compensation: $S_i^a = \{0\}$ and $\hat{S}_i^a = \{0\}$ (i.e., $\omega_i^a = \hat{\omega}_i^a = 0$), and $F_i^a(\delta_i^a) = 0 \forall \delta_i^a \in \mathbb{R}^T$ and $\hat{F}_i^a(\hat{\delta}_i^a) = 0 \forall \hat{\delta}_i^a \in \mathbb{R}^T$ (i.e., $\delta_i^a = \hat{\delta}_i^a = 0$).

Battery

We assume a battery b with storage capacity $C_i = 700$ Wh, maximum charge/discharge rate $y_i^{max} = \pm 100W$, and an initial/end charge $C_i^0 = C_i^T = C_i/2$. The battery provides control ability for flattening the prosumer's off-line plan, private real-time control, and compensation. The battery power consumption is $y_i^b = x_i^b + \hat{\omega}_i^b + \omega_i^b$, with its state-of-charge (SOC) given by $SOC_i^b = \mathbf{1}_T C_i^0 + \Delta d \mathbf{L} y_i^b \in \mathbb{R}^T$, with $\Delta d = 1/6[h]$ the duration of a time slot in hours (for $T = 144$) and:

$$\mathbf{1}_T = \begin{pmatrix} 1 \\ 1 \\ \vdots \\ 1 \end{pmatrix} \in \mathbb{R}^T, \mathbf{L} = \begin{pmatrix} 1 & 0 & \cdots & 0 \\ 1 & 1 & \ddots & \vdots \\ \vdots & \vdots & \ddots & 0 \\ 1 & 1 & \cdots & 1 \end{pmatrix} \in \mathbb{R}^{T \times T} \quad (6)$$

We allow the SOC to be in the range $[C_i^{min}, C_i^{max}]$, thus $\mathbf{1}_T C_i^{min} \leq SOC_i^b \leq \mathbf{1}_T C_i^{max}$, and we can write:

$$\mathbf{1}_T C_i^{min} \leq \mathbf{1}_T C_i^0 + \Delta d \mathbf{L} (x_i^b + \omega_i^b + \hat{\omega}_i^b) \leq \mathbf{1}_T C_i^{max} \quad (7)$$

from where we have $S_i^{b,+} = S_i^k * \hat{S}_i^k \subset [\mathbf{1}_T C_i^{min} - \Delta d \mathbf{L} x_i^b - \mathbf{1}_T C_i^0, \mathbf{1}_T C_i^{max} - \Delta d \mathbf{L} x_i^b - \mathbf{1}_T C_i^0]$. Using a symmetric $S_i^k(\kappa_i) = \{\kappa \mid -\kappa_i \leq \kappa \leq \kappa_i, \kappa \in \mathbb{R}^T\}$ parametrized by κ_i and Equation (7), we then write :

$$\begin{aligned} \mathbf{1}_T C_i^{min} &\leq \mathbf{1}_T C_i^0 + \Delta d \mathbf{L} x_i^b \pm \Delta d (\kappa_i^b + \hat{\kappa}_i^b) \leq \mathbf{1}_T C_i^{max} \\ \kappa_i^{min} &\leq \kappa_i^b \leq \kappa_i^{max} \\ \hat{\kappa}_i^{min} &\leq \hat{\kappa}_i^b \leq \hat{\kappa}_i^{max} \end{aligned} \quad (8)$$

with the equations implicitly defining $S_i^{b,+}$, where $\mathbf{0}_T \leq \kappa_i^{min} \leq \kappa_i^{max} \leq \mathbf{1}_T C_i^{max}$ and $\mathbf{0}_T \leq \hat{\kappa}_i^{min} \leq \hat{\kappa}_i^{max} \leq \mathbf{1}_T C_i^{max}$. Note that there are three variables x_i^b , κ_i^b and $\hat{\kappa}_i^b$, where $\hat{\kappa}_i^b$ represents the battery private "capacity" set. Note that in this formulation we have enforced that the capacity at one time-slot does not affect the capacity at a different time slot.

PV Generation

We consider a simple PV model. We assume the weather forecast says it will be cloudy, but it might be sunny at times. The PV output (cloudy case) will be $\bar{x}_i^s \in \mathbb{R}^T$, but it may vary in the range $[\bar{x}_i^s, \bar{x}_i^s + \bar{\sigma}_i^s]$ with $\bar{\sigma}_i^s \in \mathbb{R}^T$. See Figure 10a. We model this with a PV output $x_i^s = \bar{x}_i^s$ and a fluctuation

in $\delta_i^+ \in [0, \bar{\sigma}_i]$ (we assume there is no likelihood information of PV generation, but we know the upper and lower bound at each time). We recall that $F_i^{g,+} = F_i^\sigma * \hat{F}_i$, and $\delta_i^g = \delta_i^\sigma + \hat{\delta}_i$, where we can define:

$$F_i^{g,+}(\sigma_i) = \begin{cases} 1 & \text{if } \sigma_i \in [0, \bar{\sigma}_i], \bar{\sigma}_i \in \mathbb{R}^T \\ 0 & \text{otherwise.} \end{cases} \quad (9)$$

Note that if the probability density function were available for the PV (or some appliances), alternative definitions for the tolerance F_i^g could be given, e.g.,: $F_i^g = \mathcal{N}(\bar{x}_i^g, \sigma_i^g)$ for a Gaussian distribution, $F_i^g = \mathcal{U}(-\sigma_i^M, \sigma_i^M)$ for a uniform distribution, etc.

By parametrizing F_i and \hat{F}_i using σ_i and $\hat{\sigma}_i$ respectively, we can rewrite the (day-ahead) PV model:

$$\begin{aligned} x_i^g &= \bar{x}_i^g \\ 0 &\leq \sigma_i^g + \hat{\sigma}_i^g \leq \bar{\sigma}_i^g \end{aligned} \quad (10)$$

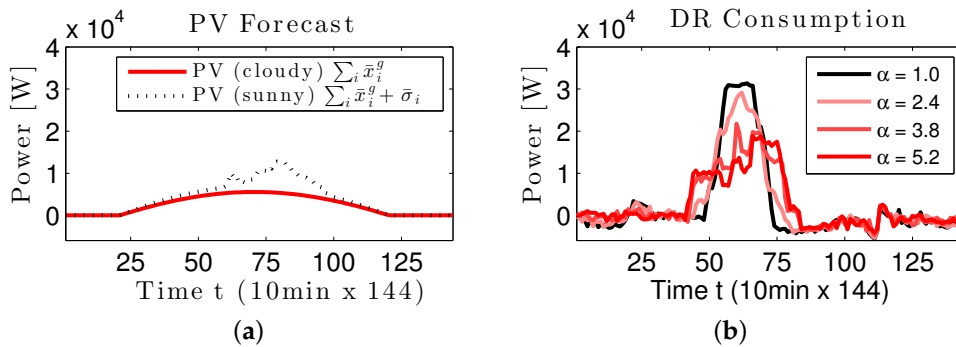


Figure 10. Generation and Demand Response (DR) profiles. (a) Photo-voltaic (PV) generation assumes it will be cloudy, but with some possible hours of clear sky; (b) Price-based DR total consumption profiles (includes generation, scheduled appliance and managed battery): Each curve is obtained using a different price signal. Note the scale difference with respect to Figure 11a in the y-axis.

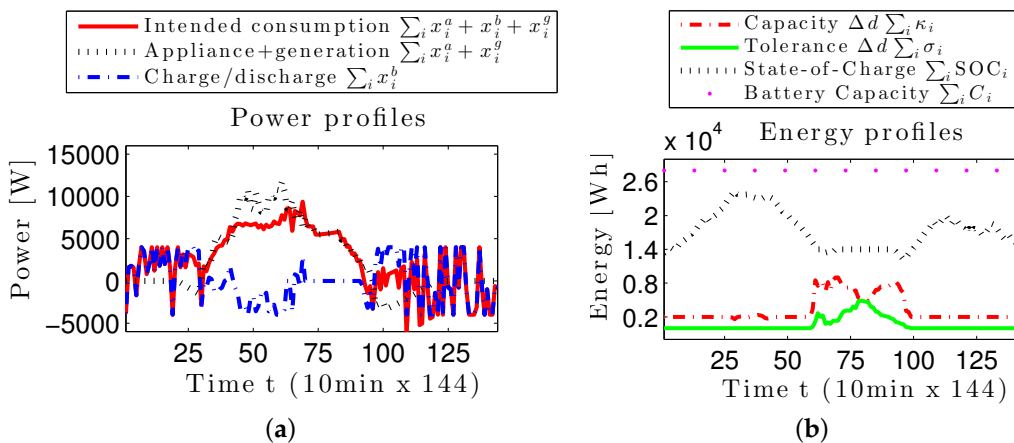


Figure 11. Augmented day-ahead coordination results. (a) Intended consumption, appliance + generation, and battery (dis)charge. The coordination obtains an intended consumption with a peak below 10 kW (DR obtains a peak in the range [20,36] kW; see Figure 10); (b) The capacity is always larger than the tolerance, and complements the state-of-charge (SOC). The capacity and tolerance are shown in Wh (by multiplying them by Δd .)

5.1.2. Device Model Aggregation

We aggregate the device models using the derived equalities, inequalities and parametrization above, instead of explicitly using the capacity and tolerance sets. We first recall that the *intended consumption* is given by $x_i = x_i^a + x_i^b + x_i^s$ thus we can write it as:

$$x_i = \psi_i(\tau_i) + x_i^b + \bar{x}_i^s \tag{11}$$

where $\tau_i \in \Theta_i$, \bar{x}_i^s is fixed, and x_i^b is related to the shared capacity and tolerance.

As for the tolerance, from the equality $\hat{\delta}_i = \hat{\omega}_i$, we can set $\hat{\sigma}_i = \hat{\kappa}_i$. We also have that $\sigma_i = \sigma_i^s$ and $\hat{\kappa}_i = \hat{\kappa}_i^b$. Then, by setting the private capacity to manage *any* private deviations in Equation (10), we can write:

$$0 \leq \sigma_i + \hat{\kappa}_i = \bar{\sigma}_i \tag{12}$$

Then, combining Equations (12) and (8) we get the set of inequalities that define the relation between the tolerance, capacity, and intended battery charge/discharge of the agent:

$$\begin{aligned} \mathbf{1}_T C_i^{\min} &\leq \mathbf{1}_T C_i^0 + \mathbf{L}x_i^b \pm \Delta d (\kappa_i + \bar{\sigma}_i - \sigma_i) \leq \mathbf{1}_T C_i^{\max} \\ \kappa_i^{\min} &\leq \kappa_i \leq \kappa_i^{\max} \\ \sigma_i^{\min} &\leq \sigma_i \leq \sigma_i^{\max} \\ -y_i^{\max} &\leq x_i^b \leq y_i^{\max} \\ C_i^1 + \Delta d \mathbf{L}x_{i,T}^b &= C_i^T \end{aligned} \tag{13}$$

with $\sigma_i^{\max} = \bar{\sigma}_i^s$ and $\sigma_i^{\min} = 0$. Here we have added a constraint to the final capacity $C_i^1 + \Delta d \mathbf{L}x_{i,T}^b$ and a charge rate constraint that only considers the consumption x_i^b . The capacity and tolerance are given by $S_i^\kappa(\kappa_i) = \{\kappa \mid -\kappa_i \leq \kappa \leq \kappa_i, \kappa \in \mathbb{R}^T\}$ and $F_i^\sigma(\sigma_i) = \text{supp}(\{\sigma \mid -\sigma_i \leq \sigma \leq \sigma_i, \sigma \in \mathbb{R}^T\})$. Note that the tolerance in Equation (13) is not necessarily symmetric, but it is considered symmetric when shared.

5.1.3. Cost Functions

Agent cost. The cost function of agent i is defined as:

$$f_i(x_i, \sigma_i, \kappa_i) = \min_{\tau_i, y_i \in \mathcal{U}_i} f_i^\tau(\tau_i) + f_i^{x|\tau, y}(x_i, \tau_i, y_i) + f_i^{\sigma, \kappa|y}(\sigma_i, \kappa_i, y_i) \tag{14}$$

with τ_i (appliance starting time), and y_i (the battery dis/charge plan) the agent's internal control variables. For clarity we have changed notation, and used y_i for the battery intended consumption, i.e., $y_i = x_i^b$.

The function $f_i^\tau(\tau_i) = \|\tau_i - \tau_i^0\|_2^2 / s_i^2$, as in Section 2.4, measures the loss in deviating from the preferred starting time for an appliance whose control is defined by its start time τ_i . We assume that the appliance is scheduled and that it does not provide control ability during the day.

Using the constraint in Equation (11) we relate control variables to the intended power consumption x_i :

$$f_i^{x|\tau, y}(x_i, \tau_i, y_i) = \Pi[x_i = \psi_i(\tau_i) + y_i + \bar{x}_i^s] \tag{15}$$

with $\psi_i(\tau_i)$ the appliance power usage, y_i the battery intended power usage, and $\bar{x}_i^s \in \mathbb{R}^T$ the forecast PV generation.

The function $f_i^{\sigma, \kappa | y}(\sigma_i, \kappa_i, y_i)$ encodes allowed tolerance and capacity while fulfilling constraints:

$$\begin{aligned}
 f_i^{\sigma, \kappa | y}(\sigma_i, \kappa_i, y_i) = & \beta_\sigma \|\sigma_i\|^2 + \beta_\kappa \|\kappa_i\|^2 + \beta_y \|y_i\|^2 \\
 & + \Pi[\mathbf{1}_T C_i^{\min} \leq \mathbf{1}_T C_i^0 + \mathbf{L} x_i^b \pm \Delta d (\kappa_i + \bar{\sigma}_i - \sigma_i) \leq \mathbf{1}_T C_i^{\max}] \\
 & + \Pi[\kappa_i^{\min} \leq \kappa_i \leq \kappa_i^{\max}] \\
 & + \Pi[\sigma_i^{\min} \leq \sigma_i \leq \sigma_i^{\max}] \\
 & + \Pi[-y_i^{\max} \leq x_i^b \leq y_i^{\max}] \\
 & + \Pi[\Delta d \mathbf{L} x_{i,T}^b = C_i^T - C_i^1]
 \end{aligned} \tag{16}$$

The terms in $\beta_\sigma \|\sigma_i\|^2 + \beta_\kappa \|\kappa_i\|^2 + \beta_y \|y_i\|^2$ flatten the tolerance, capacity and battery consumption.

Community Cost. We use the community cost as in Equation (5):

$$\begin{aligned}
 g(x, \sigma, \kappa) = & g^x(x) + g^{\sigma, \kappa}(\sigma, \kappa), \text{ with} \\
 g^x(x) = & \beta_3 \|x\|^2 \\
 g^{\sigma, \kappa}(\sigma, \kappa) = & \Pi[\Delta d \sigma_t < \Delta d \kappa_t - C_\kappa \forall t]
 \end{aligned} \tag{17}$$

with C_κ a minimum gap between deviation and capacity.

Using the defined cost functions, the day-ahead community coordination is formulated as in Problem (P3), and solved using the ADMM algorithm in Equation (1) and the distributed implementation in Figure 4b. The implementation details for solving the optimization problems above are not included for clarity. In a nutshell, the equations are solved at the device-agent-community level using a hierarchical architecture (similar to the one used in [4] for inter-community coordinator). The optimization problems at the agent and at coordinator include solving a quadratic programming problem.

The parameter values were set as follows $C_i^{\min} = 0.05C_i$, $C_i^{\max} = 0.95C_i$, $\kappa_i^{\min} = \mathbf{0}_T$, $\kappa_i^{\max} = C_i \mathbf{1}_T$, $C_i^0 = C_i^T = C_i/2$, $\beta_\sigma = 0.5$, $\beta_\kappa = 0.1$, $\beta_y = 0.01$, and $C_\kappa = 50[Wh]$.

5.1.4. Experimental Results

For comparison purposes, in addition to the augmented day-ahead coordination, we also include the results of price-based DR. The device models and parameters used for coordinated energy management and for price-based DR are identical. For price-based DR, we use the price-based control model described in Section 2.4, but here each user has a battery that is used to flatten the intended power consumption, as well as to eliminate fluctuations in real-time. Given that in DR the agents are not part of a community, they do not need to share capacity nor to help each other to compensate deviations. However, each agent needs to manage its possible deviations by itself.

When comparing the results (below) to the ones in Section 2.4, one should have in mind the three additions in the current setup: (i) The augmented day-ahead management considers that a real-time management will take place; (ii) PV generation is added and a battery is managed; (iii) The battery is managed for flattening the intended power consumption and for real-time compensation of deviation. These apply to DR and coordination. The results of the simulations are presented in Figures 10 and 11.

Figure 10b. Price-based DR *with batteries* can reduce the consumption peak, with the consumption peak being about (20 kW) in the best case. Note that this is similar to the result of the non-augmented coordination *without batteries* in Section 2.4; see Figure 5b.

Figure 11a. The coordinated intended power consumption is presented (each agent manages appliances, battery dis/charge and generation). We can see that the coordination helps further reducing the largest consumption peak due to the appliances. The coordination obtains a flattened

profile for the community intended consumption ($\sum_i x_i$), with a small consumption peak (10 kW). This peak is half the one obtained by *DR with batteries* (see previous point; Figure 10b).

Figure 11b. The obtained tolerance and capacity are coordinated, with the tolerance being lower than the capacity at all times. This shows that the augmented coordination does not only manage the power consumption (flattening the consumption and reducing the maximum peak in this example), but it also manages the aggregated capacity (the community real-time control ability) and tolerance.

Figure 11b. This figure also shows the trade-off between the battery charge-discharge and the capacity. We can observe that the state-of-charge is large until the time slot $t = 45$, where the batteries start to discharge to help reducing the large consumption peak (see Figure 11a). Note that the state-of-charge is complementary to the capacity, meaning e.g., that when the battery is almost full, the capacity is small, while when the state-of-charge is half the capacity, the capacity achieves its maximum.

In summary, the *augmented day-ahead coordination* plans the intended power consumption, obtaining a flattened the power profile, while coordinating capacity and tolerance for a real-time management.

5.2. Augmented Coordination Validation (Scenario 2)

We apply the augmented coordinated energy management in a second scenario consisting of a community of prosumers having uncontrolled consumption and distributed batteries. The goal is to validate the proposed methodology using actual power consumption data. We use a prosumer agent model similar to the one used in the previous section, but now the agent does not have PV generation and it cannot schedule appliances. On the other hand, each agent has appliance power consumption that is not controlled and fluctuates freely. As before each agent has a controllable battery.

In this scenario we use historical power consumption data (i) to build the augmented prosumer model used in the off-line coordination; and (ii) to validate the obtained coordination results using consumption data from the same households. The historical data for each household is split in a training data (to build the augmented model) and a test data (for validation). In this way we can evaluate how does the obtained off-line coordination would behave in the real-time coordination. More specifically, we study whether the community could compensate the actual deviation in real-time.

We follow the augmented formulation presented in Section 4.2. Each agent i has an uncontrolled consumption, for which historical consumption data is available, and a controllable battery of capacity $C_i = q_i 700 \text{ Wh}$. The parameter q_i defines the battery capacity of agent i (we use various battery sizes, parametrized by q_i). As before, the battery provides ability to control the power consumption: to flatten the intended power consumption, to manage deviations, and to manage compensation ability.

The cost function of agent i is defined as (it does not consider a scheduled appliance):

$$f_i(x_i, \sigma_i, \kappa_i) = \min_{y_i \in \mathcal{U}_i} f_i^{x|y}(x_i, y_i) + f_i^{\sigma, \kappa|y}(\sigma_i, \kappa_i, y_i) \quad (18)$$

with y_i the battery dis/charge plan of the agent (i.e., the agent's internal control variable). As before, for clarity we write y_i for the battery intended consumption ($y_i = x_i^b$). The intended power consumption x_i depends on the forecast appliance power consumption ($\bar{x}_i^a \in \mathbb{R}^T$) and on the battery power usage (y_i):

$$f_i^{x|y}(x_i, y_i) = \Pi[x_i = \bar{x}_i^a + y_i] \quad (19)$$

For the battery cost function $f_i^{\sigma, \kappa|y}(\sigma_i, \kappa_i, y_i)$ we use the same model as in Equation (16), and for the community cost function we use the same cost as Equation (17): $g(x, \sigma, \kappa) = g^x(x) + g^{\sigma, \kappa}(\sigma, \kappa)$, with $g^x(x) = \beta_3 \|x\|^2$ and $g^{\sigma, \kappa}(\sigma, \kappa) = \Pi[\Delta d \sigma_t < \Delta d \kappa_t - C_\kappa \forall t]$, with $C_\kappa = 50[\text{Wh}]$.

Historical operation power consumption data was used to build the agent model and to validate the community coordination. This sensed data corresponds to consumption data for $N = 37$ households collected in 2003 at various locations across Japan (residential consumption data from the energy consumption DB available at <http://tkkankyo.eng.niigata-u.ac.jp/HP/HP/database/japan2/index.htm> on 2016/06/04). The original data was available at 1 min resolution, but it was averaged for the used time-slot duration (we use a 10 min time-slot for day-ahead ($T = 144$ time-slots, for a total of 24 h) and 1 h time-slots for week-ahead coordination ($T = 120$, 5 days)). The consumption model of agent i used during the coordination is defined by three parameters: the consumption range $[\sigma_i^{min}, \sigma_i^{max}]$, with $\sigma_i^{min}, \sigma_i^{max} \in \mathbb{R}^T$ in Equation (16), and the forecast power consumption \bar{x}_i^a in Equation (19). We simply estimated \bar{x}_i^a as the mid-value of the consumption range $\bar{x}_i^a = (\sigma_i^{min} + \sigma_i^{max}) / 2$. The range $[\sigma_i^{min}, \sigma_i^{max}]$ was obtained for each agent using historical operational data (of that agent) as follows. For each time t , we first estimated the minimum and maximum power consumption for a period including 1 h before and after time t considering data for the same weekday at the same month. Once these maximum and minimum bounds were estimated, we took 1.2 times the minimum and 0.8 times of maximum as the upper and lower fluctuation bounds, respectively. Examples of these values can be observed in Figure 12. We note that the actual consumption is outside these bounds not more than a handful of times a day for a few agents (e.g., agent 1 at times $t = 10, t = 120$, and $t = 140$, and agent 6 at time $t = 40, t = 120$ and $t = 130$), which can be considered as the user deviating from its common living pattern from time to time.

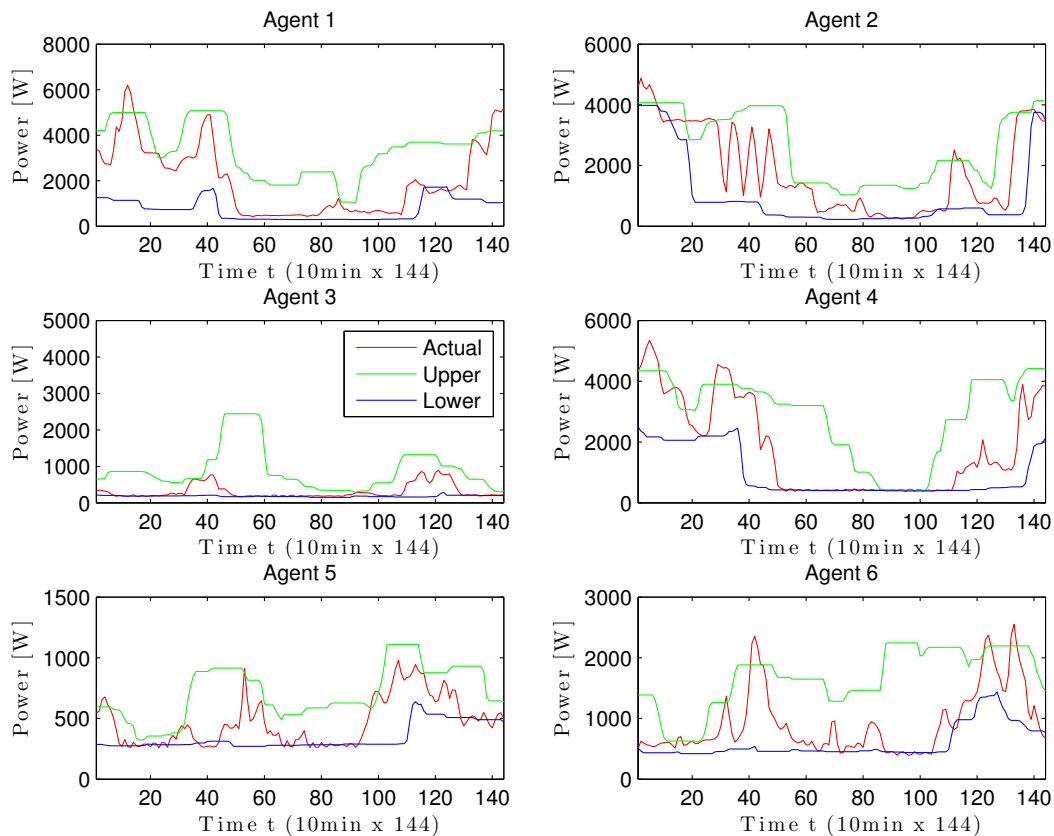


Figure 12. Actual consumption and estimated fluctuation range (“upper” and “lower” in the figure) for 6 out of the 37 households used in the experiments. Note that the figures have different scales. See main text for details on the estimation of fluctuation range.

The battery capacity of agent i is given by $C_i = q_i 700$, and we consider three cases for the community’s distribution of battery capacities: $q_i \in \{0.1, 0.2, \dots, 0.5\}$ (tiny), $q_i \in \{1\}$ (small), and

$q_i \in \{1, 2, \dots, 5\}$ (mid-size). In each case the community average battery size was $\bar{C} = 0.3 \times 700$ (tiny), $\bar{C} = 700$ (small), $\bar{C} = 3 \times 700$ (middle). In addition to presenting results for various battery sizes, we also consider two off-line cases: day-ahead coordination and week-ahead coordination.

5.2.1. Results

Day-Ahead Augmented Coordination

Figure 13 summarizes the results for the augmented day-ahead coordination. In the figure, each row corresponds to different battery sizes (from top to bottom: tiny, small, mid size), and the columns show: (Left) tolerance, deviation, capacity and compensation; (Center) intended consumption and actual consumption, and (Right) imbalance. The imbalance for each time-slot t is measured by: $100 \left| \frac{\sum_i \chi_{i,t} - \sum_i x_{i,t} + (\delta_{i,t} + \omega_{i,t})}{\sum_i x_{i,t}} \right|$, with $\chi_{i,t}$ the actual power consumption of agent i at time t . From Figure 13 we observe that:

- When a tiny battery size per agent ($\bar{C} = 0.3 \times 700 \text{ Wh}$) is considered, the community does not have enough capacity to compensate all deviations Figure 13a, cannot flatten the intended power profile Figure 13b, and generates some imbalance Figure 13c.
- When a small battery size ($\bar{C} = 700 \text{ Wh}$) is considered (second row), the community has more capacity to compensate deviations Figure 13d, flattens the intended power profile Figure 13e, and eliminates almost all imbalance Figure 13f.
- When a mid battery size ($\bar{C} = 3 \times 700 \text{ Wh}$) is considered, the community has a large capacity Figure 13g, furthers flattens the intended power consumption profile Figure 13h and generates no imbalance Figure 13i.

Week-Ahead Augmented Coordination

Figure 14 summarizes the results for the augmented week-ahead coordination. These results are very similar to the ones obtained for day-ahead coordination:

- A tiny battery size per agent ($\bar{C} = 0.3 \times 700 \text{ Wh}$) can slightly reduce imbalance but cannot flatten the intended power profile Figure 14a–c.
- A small battery size ($\bar{C} = 700 \text{ Wh}$) (second row) has much more capacity to compensated deviations, slightly flattens the intended power profile, and eliminates almost all imbalance Figure 14d–f.
- A mid battery size ($\bar{C} = 3 \times 700 \text{ Wh}$) obtains a large community capacity and compensates all deviations, while furthers flattening the intended power consumption profile and generating no imbalance Figure 14g–h.

In summary, these results indicate that a community of agents coordinating their control ability, here given by distributed batteries, could eliminate imbalance and flatten the intended power consumption when a mid size-battery capacity ($\bar{C} = 3 \times 700 \text{ Wh}$) is installed at each household. Even when the agents use a small battery ($\bar{C} = 700 \text{ Wh}$), the community could eliminate almost all imbalance, while slightly flattening the power consumption profile, thanks to the coordination of intended power consumption, capacity and tolerance. Note that the used community cost function gives more priority to having enough capacity when required over flattening the power consumption (in Equation (17) a hard constraint was used for the tolerance and capacity). Thus, if required, more importance can be given to flattening the intended power consumption by using a soft-constraint on the tolerance and capacity.

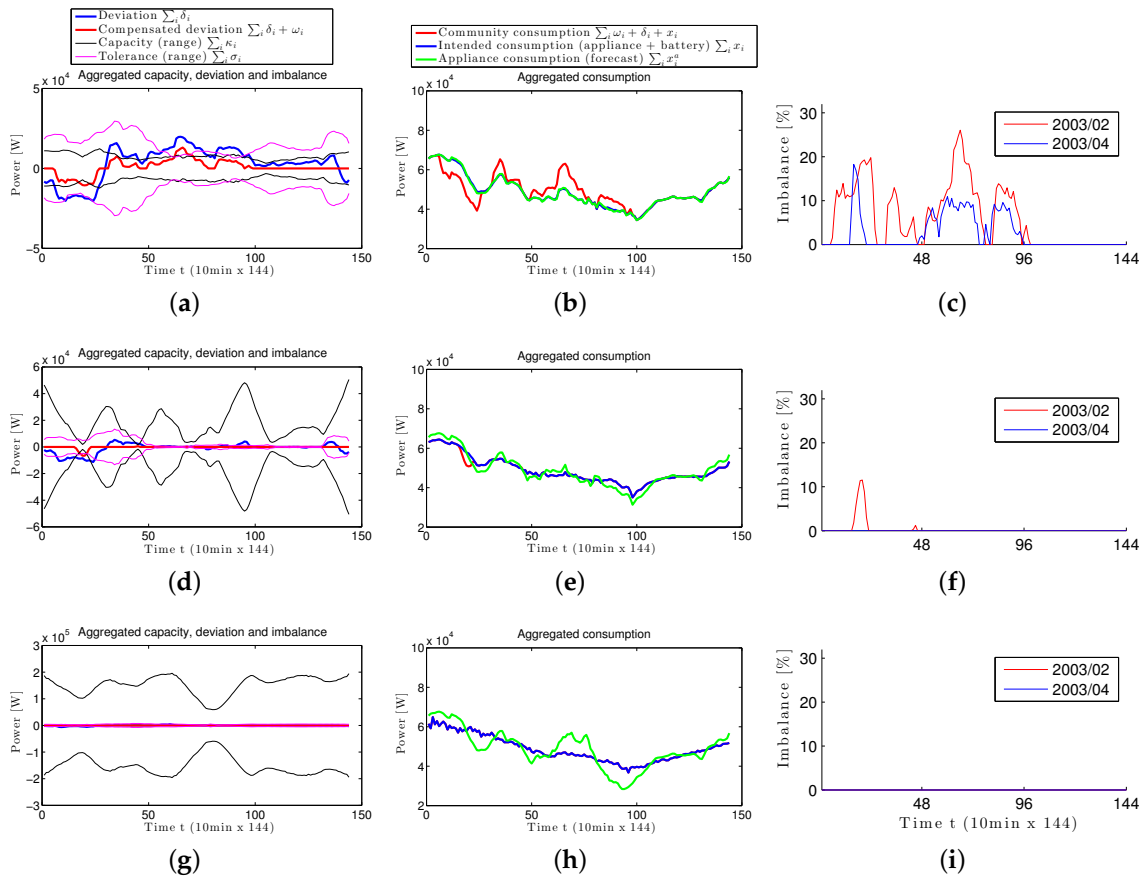


Figure 13. Augmented day-ahead coordination. Date: 2003/02. Rows indicate battery size: $\bar{C} \in \{0.3 \times 700, 700, 3 \times 700\} Wh$. Left column: capacity, tolerance, deviation and compensated deviation. Middle column: actual, intended and appliance consumption. Right column: community imbalance (see main text for definition) for two different dates (2003/02 and 2003/04). Note: the figures have different scales in the y-axis for easier visualization. (a) $\bar{C} = 0.3 \times 700 Wh$; (b) $\bar{C} = 0.3 \times 700 Wh$; (c) $\bar{C} = 0.3 \times 700 Wh$; (d) $\bar{C} = 700 Wh$; (e) $\bar{C} = 700 Wh$; (f) $\bar{C} = 700 Wh$; (g) $\bar{C} = 3 \times 700 Wh$; (h) $\bar{C} = 3 \times 700 Wh$; (i) $\bar{C} = 3 \times 700 Wh$.

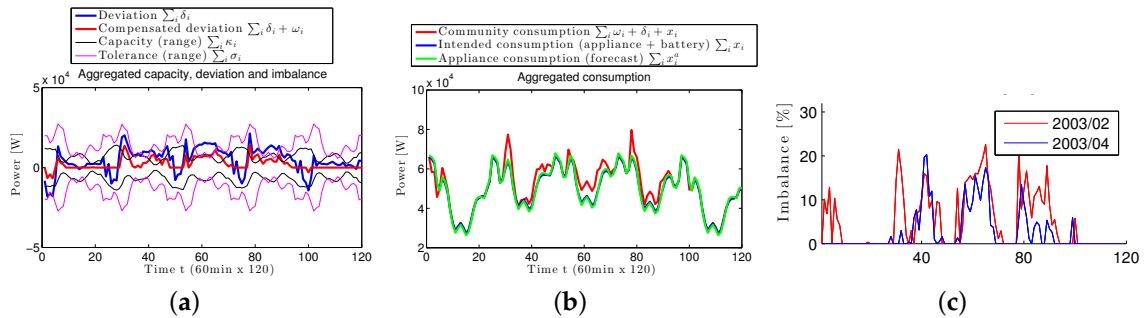


Figure 14. Cont.

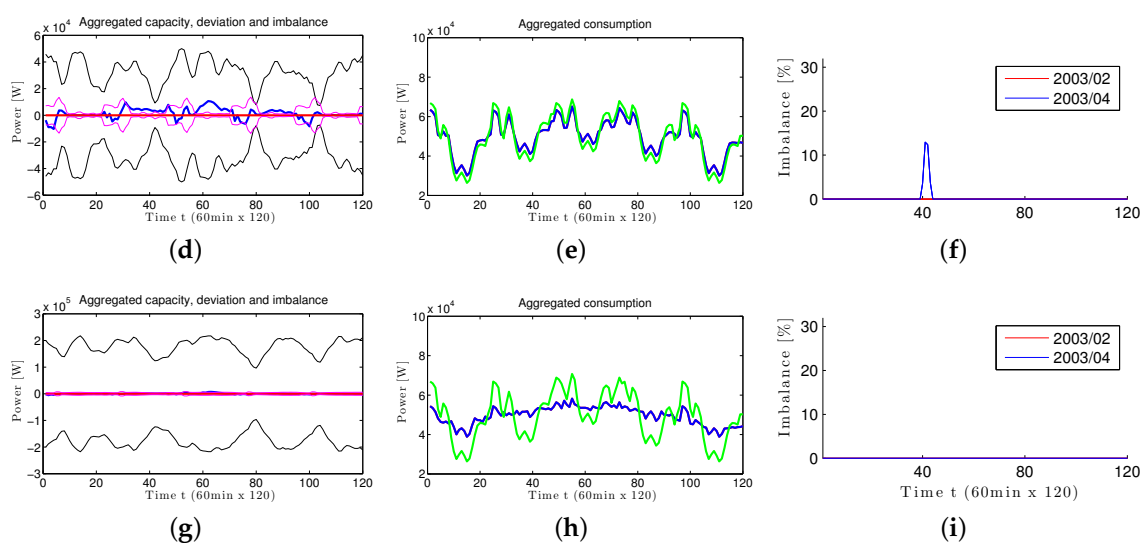


Figure 14. Augmented week-ahead coordination. Date: 2003/02. Rows indicate battery size: $\bar{C} \in \{0.3 \times 700, 700, 3 \times 700\}$ Wh. Left column: capacity, tolerance, deviation and compensated deviation. Middle column: actual, intended and appliance consumption. Right column: community imbalance (see main text for definition) for two different dates (2003/02 and 2003/04). Note: the figures have different scales in the y-axis for easier visualization. (a) $\bar{C} = 0.3 \times 700$ Wh; (b) $\bar{C} = 0.3 \times 700$ Wh; (c) $\bar{C} = 0.3 \times 700$ Wh; (d) $\bar{C} = 700$ Wh; (e) $\bar{C} = 700$ Wh; (f) $\bar{C} = 700$ Wh; (g) $\bar{C} = 3 \times 700$ Wh; (h) $\bar{C} = 3 \times 700$ Wh; (i) $\bar{C} = 3 \times 700$ Wh.

6. Conclusions

We have presented an augmented model for coordinated energy management for prosumer communities that allows users in a community to jointly manage their power consumption and generation. The proposed energy management implements a “demand management from the demand-side” approach where each user is a potential producer and consumer (i.e., a prosumer) that manages its Quality of Life, and where all agents receive help from the community and contribute to it.

The proposed augmented coordination scheme uses a control strategy that implements a feedback in the control, giving the community a large ability to manage the its power resources, and furthermore it considers off-line and real-time ability to manage a power under controlled and uncontrolled devices. This is done using an augmented agent management model that is integrated in a community coordination protocol. This augmented model manages, in its off-line stage, each agent’s intended power consumption, (compensation) capacity and (deviation) tolerance such that in real-time the agent and community has control ability to minimize deviations in real-time.

We presented results to in two scenarios where we illustrate the augmented model and its use in the community coordination. In the first case we observed that the proposed approach presented good control capabilities, allowing to flatten the power consumption while reserving control ability for a real-time management. In this scenario we observed that the augmented coordination has a better control ability than a simple price-based demand response program. In the second case we use actual consumption data to validate that the off-line management reserves enough control resources for the real-time management. In this results we observed that the community obtained a flattened intended power consumption, while coordinating capacity and tolerance for a real-time coordinated management, even when small size batteries are installed by the prosumers, thus successfully coordinating the ability to control the power consumption under uncontrolled consumption.

We believe that the proposed augmented coordinated energy management is a compelling solution for enhancing the power system, for implementing a prosumer society where the users can

help each other, and for enabling the further introduction of distributed renewables, all this by putting the focus on the demand-side (namely on the user) instead of on the grid or the generation-side. As future work we are interested in (i) studying how the community can implement the real-time management, in particular taking into account distributed uncontrollable generation; (ii) analyzing user incentive and fairness issues, as well as allowing each prosumer to select his/her preferred energy type and energy source; and (iii) testing the proposed approach in a real-world system.

Acknowledgments: This work was partially supported the i-Energy joint research chair, Kyoto University, and by NEC Corporation, Japan.

Author Contributions: Rodrigo Verschae wrote the paper and designed the experiments. Takekazu Kato and Takashi Matsuyama gave guidance and helped improve the research quality of the paper.

Conflicts of Interest: The authors declare no conflict of interest.

References

1. Stern, D.I. Modeling international trends in energy efficiency. *Energy Econ.* **2012**, *34*, 2200–2208.
2. Nesheiwat, J.; Cross, J.S. Japan's post-Fukushima reconstruction: A case study for implementation of sustainable energy technologies. *Energy Policy* **2013**, *60*, 509–519.
3. Matsuyama, T. i-Energy: Smart demand-side energy management. In *Smart Grid Applications and Developments*; Mah, D., Hills, P., Li, V.O., Balme, R., Eds.; Green Energy and Technology, Springer: London, UK, 2014; pp. 141–163.
4. Verschae, R.; Kawashima, H.; Kato, T.; Matsuyama, T. Coordinated energy management for inter-community imbalance minimization. *Renew. Energy* **2016**, *87*, 922–935.
5. Kawashima, H.; Kato, T.; Matsuyama, T. Distributed mode scheduling for coordinated power balancing. In Proceedings of the 2013 IEEE International Conference on Smart Grid Communications (SmartGridComm), Vancouver, BC, Canada, 21–24 October 2013; pp. 19–24.
6. Verschae, R.; Kato, T.; Kawashima, H.; Matsuyama, T. A cooperative distributed protocol for coordinated energy management in prosumer communities. In Proceedings of the Singapore-Japan Joint Workshop on Ambient Intelligence and Sensor Networks (ASN 2015), Singapore, Singapore, 4–5 December 2015.
7. Rylatt, R.M.; Snape, J.R.; Allen, P.; Ardestani, B.M.; Boait, P.; Boggasch, E.; Fan, D.; Fletcher, G.; Gammon, R.; Lemon, M.; et al. Exploring smart grid possibilities: A complex systems modelling approach. *Smart Grid* **2015**, *1*, doi:10.1515/sgrid-2015-0001.
8. Ogimoto, K.; Kaizuka, I.; Ueda, Y.; Oozeki, T. A good fit: Japan's solar power program and prospects for the new power system. *IEEE Power Energy Mag.* **2013**, *11*, 65–74.
9. Ministry of Economy, Trade and Industry. *Report of the Electricity System Reform Expert Subcommittee*; METI, Japan, 2013. Available online: http://www.meti.go.jp/english/policy/energy_environment/electricity_system_reform/pdf/201302Report_of_Expert_Subcommittee.pdf (accessed on 7 July 2016).
10. Goto, M.; Inoue, T.; Sueyoshi, T. Structural reform of Japanese electric power industry: Separation between generation and transmission & distribution. *Energy Policy* **2013**, *56*, 186–200.
11. Callaway, D.; Hiskens, I. Achieving Controllability of Electric Loads. *IEEE Proc.* **2011**, *99*, 184–199.
12. Lannoye, E.; Flynn, D.; O'Malley, M. Evaluation of Power System Flexibility. *IEEE Trans. Power Syst.* **2012**, *27*, 922–931.
13. Sullivan, R.L. *Power System Planning*; McGraw-Hill Inc.: New York, NY, USA, 1977.
14. Barbato, A.; Capone, A. Optimization models and methods for demand-side management of residential users: A survey. *Energies* **2014**, *7*, 5787–5824.
15. Gelazanskas, L.; Gamage, K.A. Demand side management in smart grid: A review and proposals for future direction. *Sustain. Cities Soc.* **2014**, *11*, 22–30.
16. Mahmood, A.; Javaid, N.; Khan, M.A.; Razzaq, S. An overview of load management techniques in smart grid. *Int. J. Energy Res.* **2015**, *39*, 1437–1450.
17. O'Connell, N.; Pinson, P.; Madsen, H.; O'Malley, M. Benefits and challenges of electrical demand response: A critical review. *Renew. Sustain. Energy Rev.* **2014**, *39*, 686–699.
18. Alizadeh, M.; Li, X.; Wang, Z.; Scaglione, A.; Melton, R. Demand-side management in the smart grid: Information processing for the power switch. *IEEE Signal Proc. Mag.* **2012**, *29*, 55–67.

19. Boait, P.; Ardestani, B.M.; Snape, J.R. Accommodating renewable generation through an aggregator-focused method for inducing demand side response from electricity consumers. *IET Renew. Power Gener.* **2013**, *7*, 689–699.
20. Roscoe, A.J.; Ault, G. Supporting high penetrations of renewable generation via implementation of real-time electricity pricing and demand response. *IET Renew. Power Gener.* **2010**, *4*, 369–382.
21. Rastegar, M.; Fotuhi-Firuzabad, M.; Aminifar, F. Load commitment in a smart home. *Appl. Energy* **2012**, *96*, 45–54.
22. Papadaskalopoulos, D.; Strbac, G. Decentralized, agent-based participation of load appliances in electricity pool markets. In Proceedings of the 21st International Conference on Electricity Distribution, Frankfurt, Germany, 6–9 June 2011.
23. Roozbehani, M.; Dahleh, M.A.; Mitter, S.K. Volatility of Power Grids Under Real-Time Pricing. *IEEE Trans. Power Syst.* **2012**, *27*, 1926–1940.
24. Caron, S.; Kesidis, G. Incentive-based energy consumption scheduling algorithms for the smart grid. In Proceedings of the IEEE International Conference on Smart Grid Communications (SmartGridComm), Gaithersburg, MD, USA, 4–6 October 2010; pp. 391–396.
25. Alizadeh, M.; Chang, T.H.; Scaglione, A. Grid integration of distributed renewables through coordinated demand response. In Proceedings of the IEEE 51st Conference on Decision and Control (CDC), Maui, HI, USA, 10–13 December 2012; pp. 3666–3671.
26. Chang, T.H.; Alizadeh, M.; Scaglione, A. Real-time power balancing via decentralized coordinated home energy scheduling. *IEEE Trans. Smart Grid* **2013**, *4*, 1490–1504.
27. Tsai, S.C.; Tseng, Y.H.; Chang, T.H. Communication-efficient distributed demand response: A randomized ADMM approach. *IEEE Trans. Smart Grid* **2015**, *PP*, 1, doi:10.1109/TSG.2015.2469669.
28. Hug, G.; Kar, S.; Wu, C. Consensus + Innovations approach for distributed multiagent coordination in a microgrid. *IEEE Trans. Smart Grid*, **2015**, *6*, 1893–1903.
29. Rahbari-Asr, N.; Ojha, U.; Zhang, Z.; yuen Chow, M. Incremental welfare consensus algorithm for cooperative distributed generation/demand response in smart grid. *IEEE Trans. Smart Grid* **2014**, *5*, 2836–2845.
30. Del Real, A.; Arce, A.; Bordons, C. An integrated framework for distributed model predictive control of large-scale power networks. *IEEE Trans. Ind. Inform.* **2014**, *10*, 197–209.
31. Verschae, R.; Kawashima, H.; Kato, T.; Matsuyama, T. A distributed hierarchical architecture for community-based power balancing. In Proceedings of the IEEE International Conference on Smart Grid Communications (SmartGridComm), Venice, Italy, 3–6 November 2014; pp. 169–175.
32. Verschae, R.; Kawashima, H.; Kato, T.; Matsuyama, T. A distributed coordination framework for on-line scheduling and power demand balancing of households communities. In Proceedings of the European Control Conference (ECC), Strasbourg, France, 24–27 June 2014; pp. 1655–1662.
33. Boyd, S.; Parikh, N.; Chu, E.; Peleato, B.; Eckstein, J. Distributed optimization and statistical learning via the alternating direction method of multipliers. *Found. Trends Mach. Learn.* **2011**, *3*, 1–122.
34. Boyd, S.; Vandenberghe, L. *Convex Optimization*; Cambridge University Press: Cambridge, UK, 2004.
35. Combettes, P.; Pesquet, J.C. Proximal splitting methods in signal processing. In *Fixed-Point Algorithms for Inverse Problems in Science and Engineering*; Bauschke, H.H., Burachik, R.S., Combettes, P.L., Elser, V., Luke, D.R., Wolkowicz, H., Eds.; Springer Optimization and Its Applications, Springer: New York, NY, USA, 2011; pp. 185–212.
36. Parikh, N.; Boyd, S. Proximal algorithms. *Found. Trends Optim.* **2014**, *1*, 127–239.

